




# Executive Dashboard



Data as of 03/31/2025

## Daily Water Production

● J.H. Fewell (MG) ● O.B. Curtis Conv (MG) ● Total (MG) ● O.B. Curtis Mem (MG)

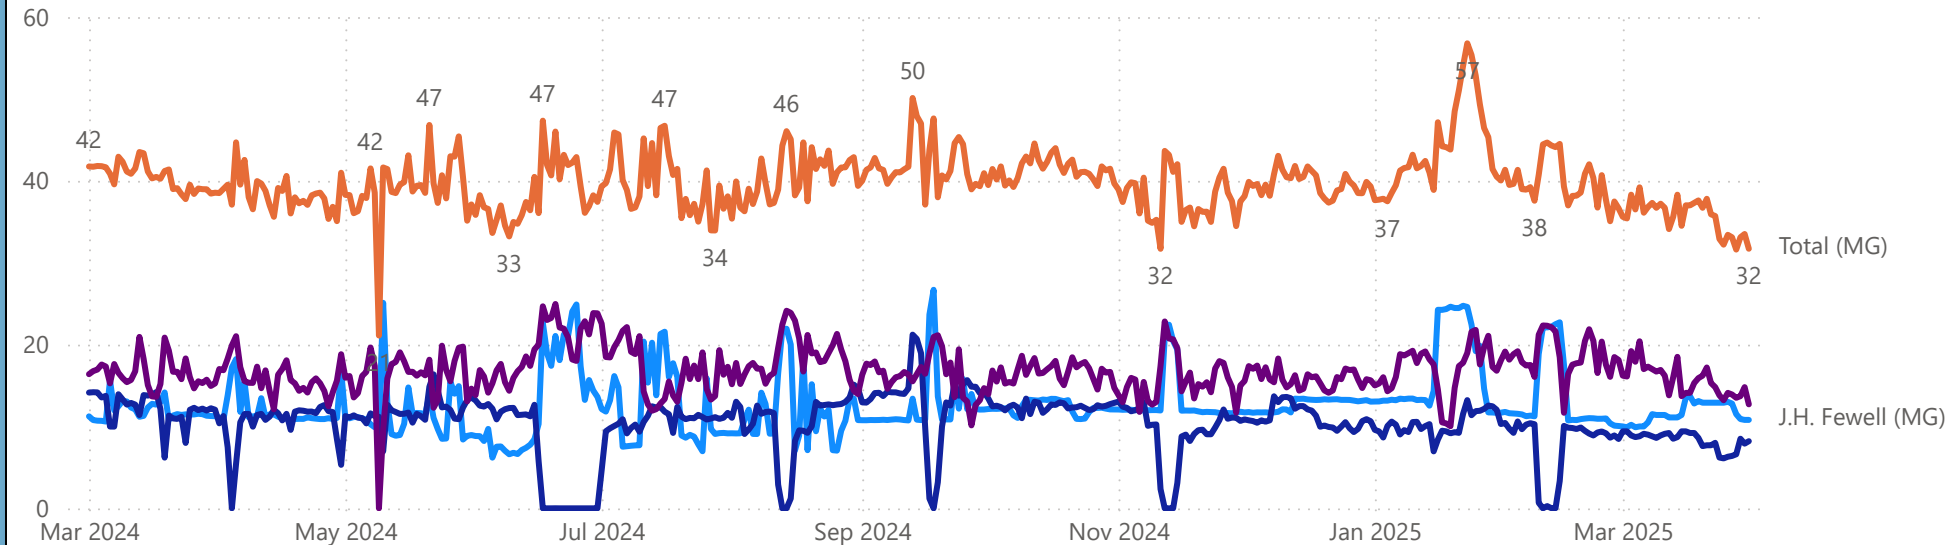

## Water Production MG/Day (YTD)

Total Production (Min)  
21.10

Total Production (Avg)  
39.84

O.B. Curtis Membrane (Avg)  
17.06


O.B. Curtis Conventional (Avg)  
8.80

J.H. Fewell (Avg)  
13.98

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2025	3	March	11.65	8.33	15.66
2025	2	February	13.55	7.69	18.68
2025	1	January	16.69	10.28	16.98
2024	12	December	12.68	11.14	15.87
2024	11	November	13.06	9.05	15.67
2024	10	October	12.35	12.44	16.56

Plant	Average Production Trend (MG/Day)						
	March 2025	March 2024	25'-24' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	11.65	11.88	-1.90%	13.34	13.98	13.98	10-20
O.B. Curtis Conventional	8.33	12.18	-31.65%	9.84	8.80	8.80	10-20
O.B. Curtis Membrane	15.66	16.44	-4.75%	16.56	17.06	17.06	23
Total	35.64	40.50	-12.01%	39.73	39.84	39.84	43-53

## Average Share of Each Plant

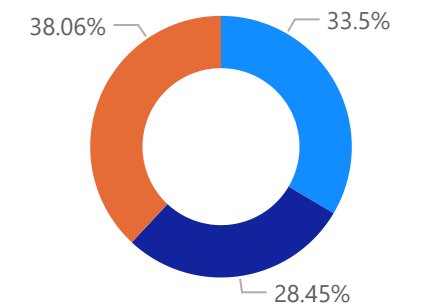


● JHF ● OBC CONV ● OBC MEM




# Executive Dashboard




## Turbidity (JHF)

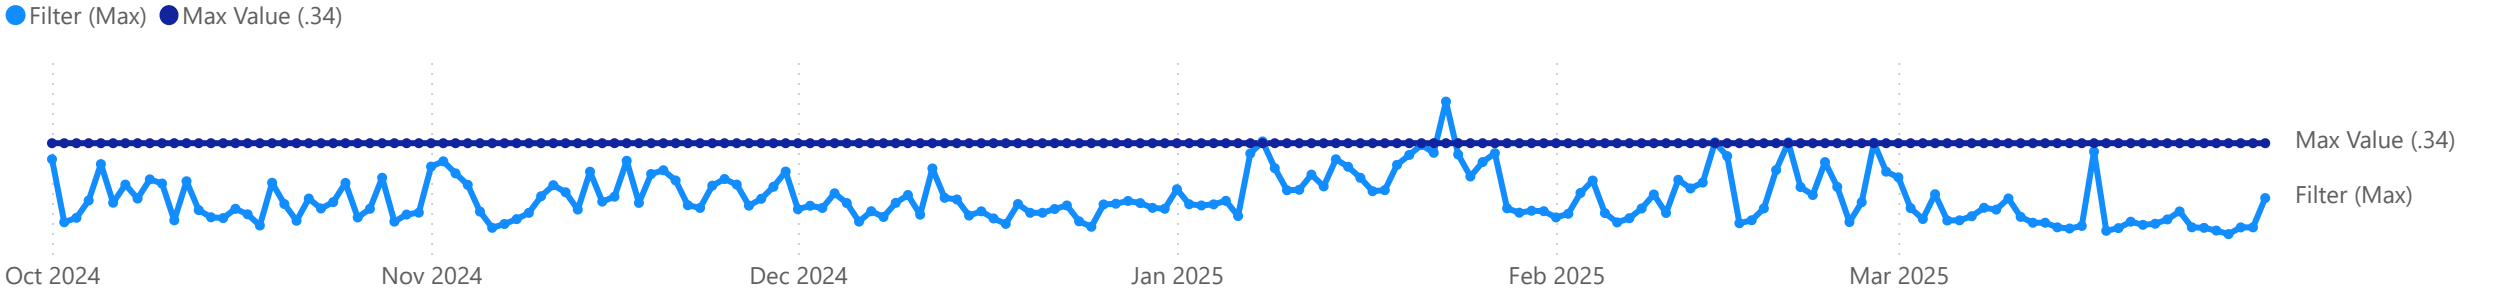

## pH (JHF)

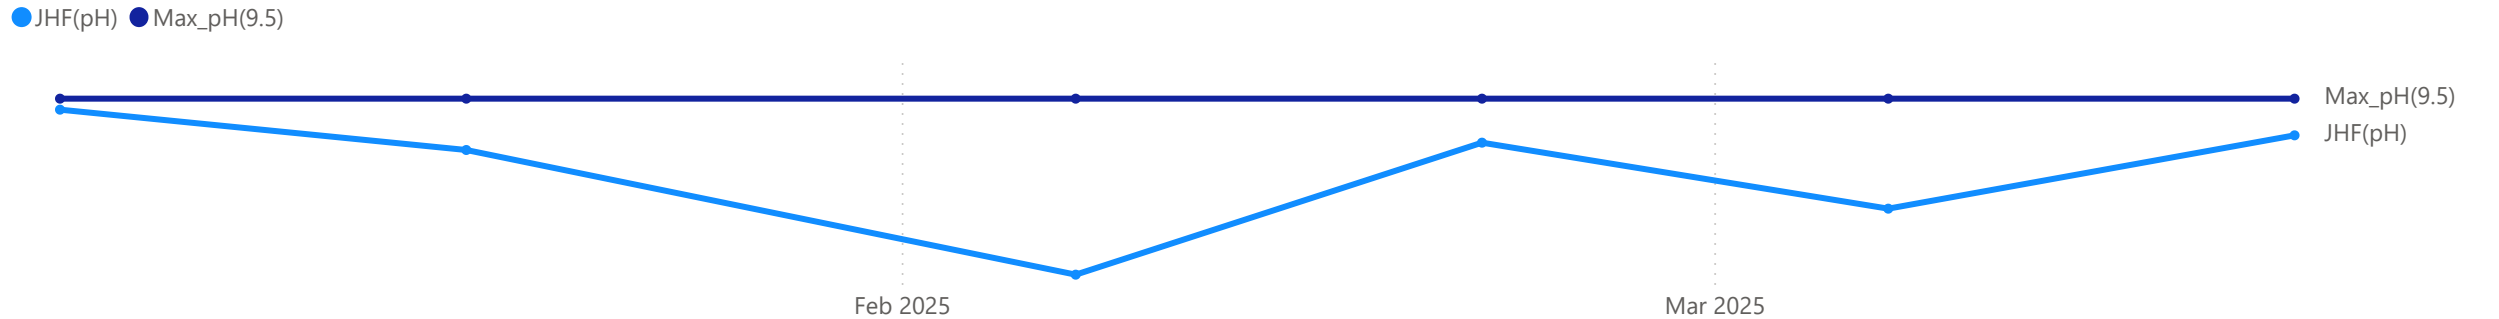

## Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

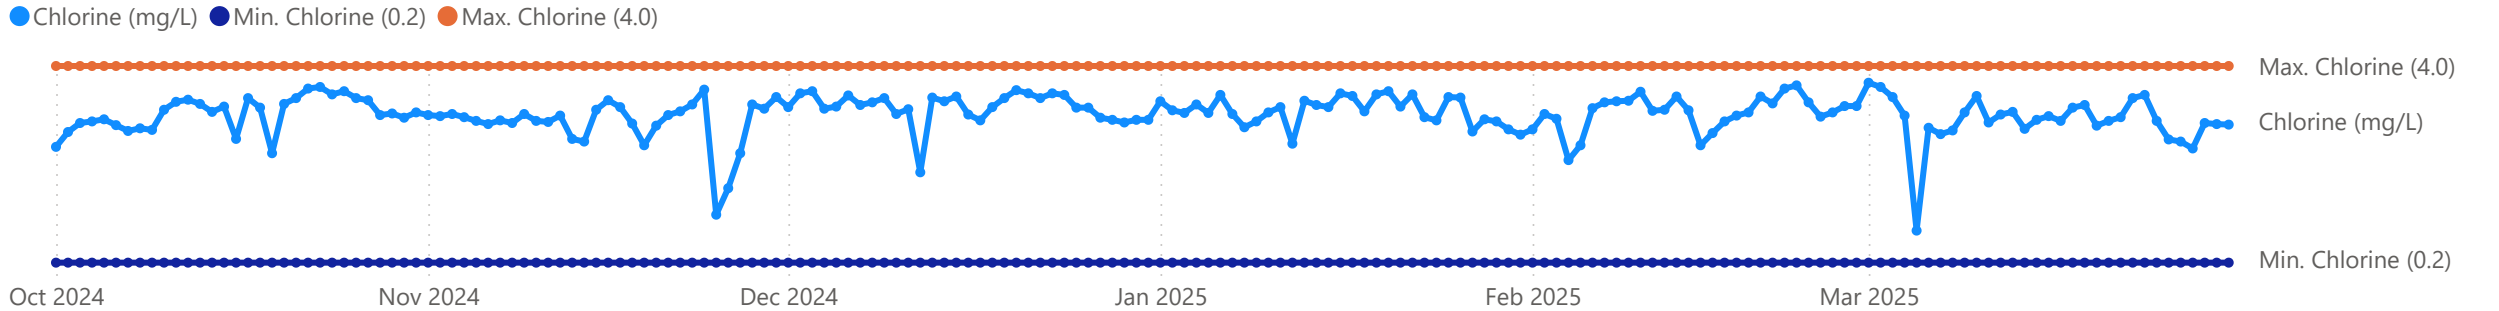




# Executive Dashboard




## Turbidity (OBC1 Conventional)

● CFE (Max) ● Max Turbidity (.34)

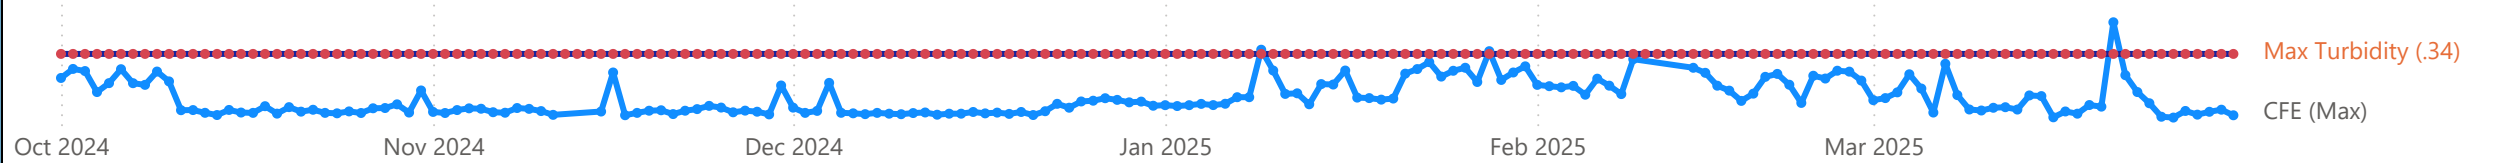


## Turbidity (OBC2 Membrane)

● CFE (Max) ● Max\_Turbidity (.34)

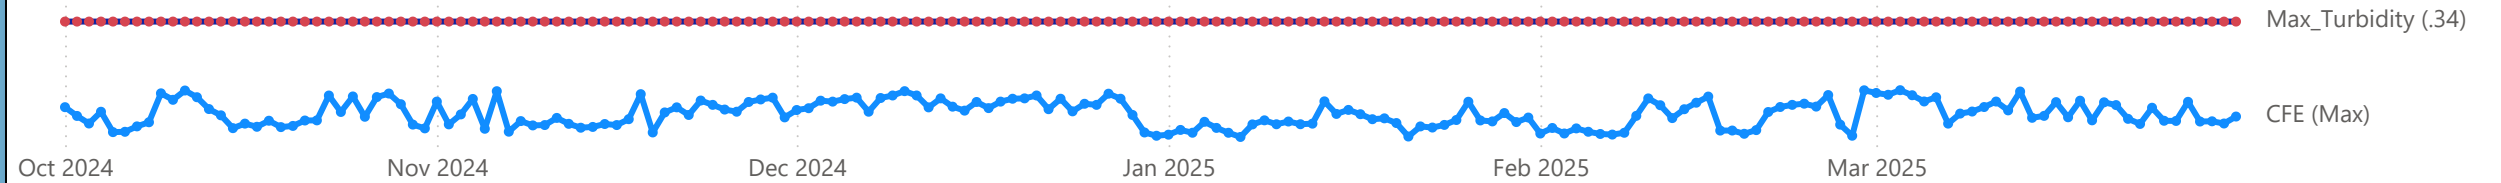

## pH

● OBC(pH) ● Max\_pH(9.5)

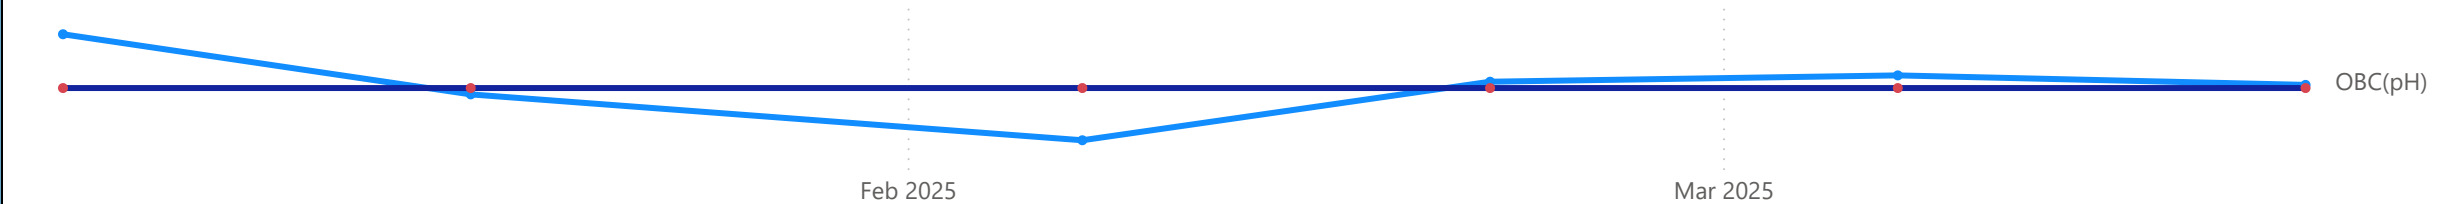





# Executive Dashboard



## OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

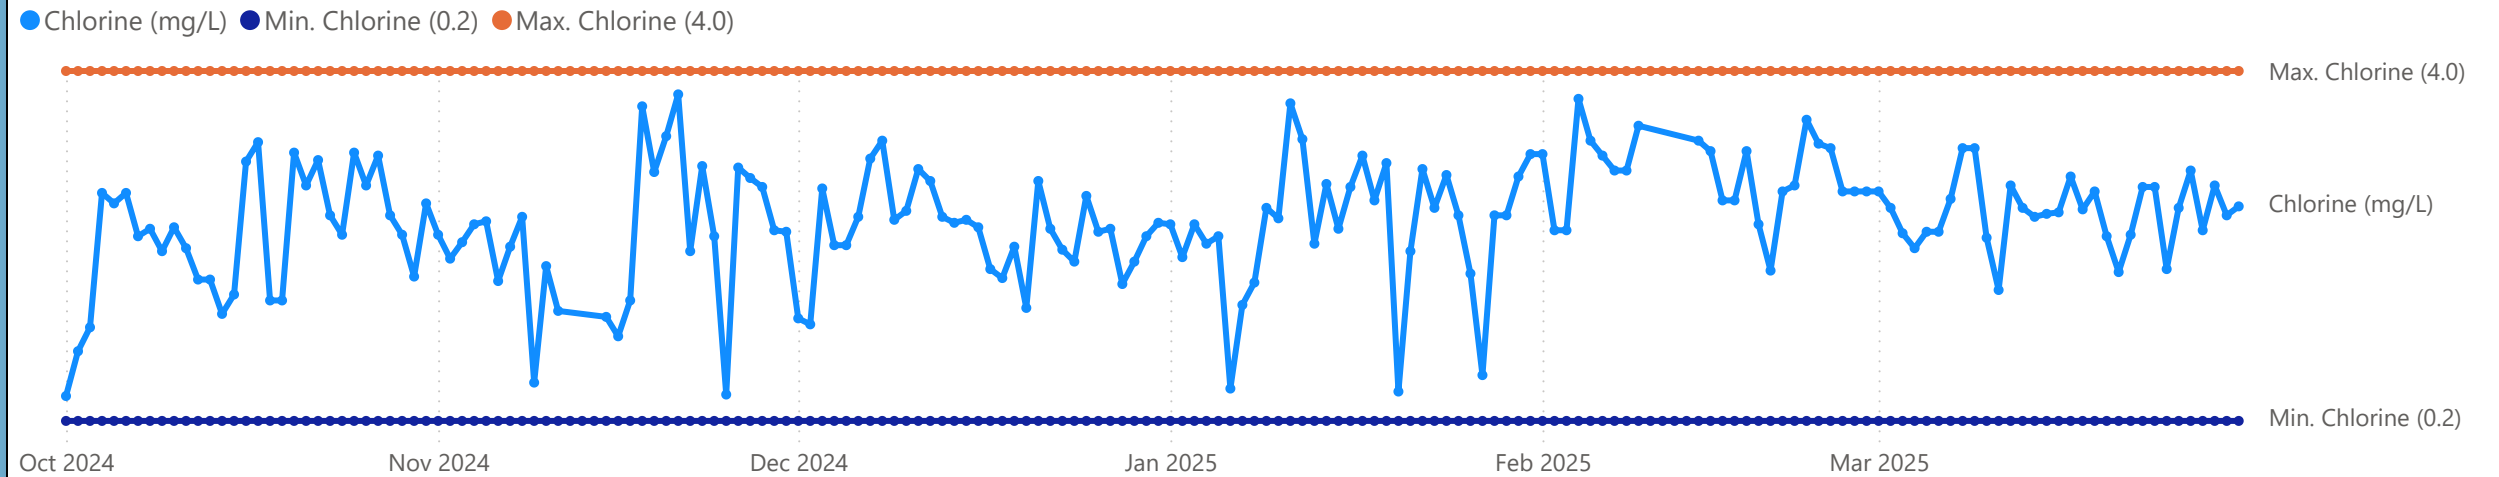

## OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

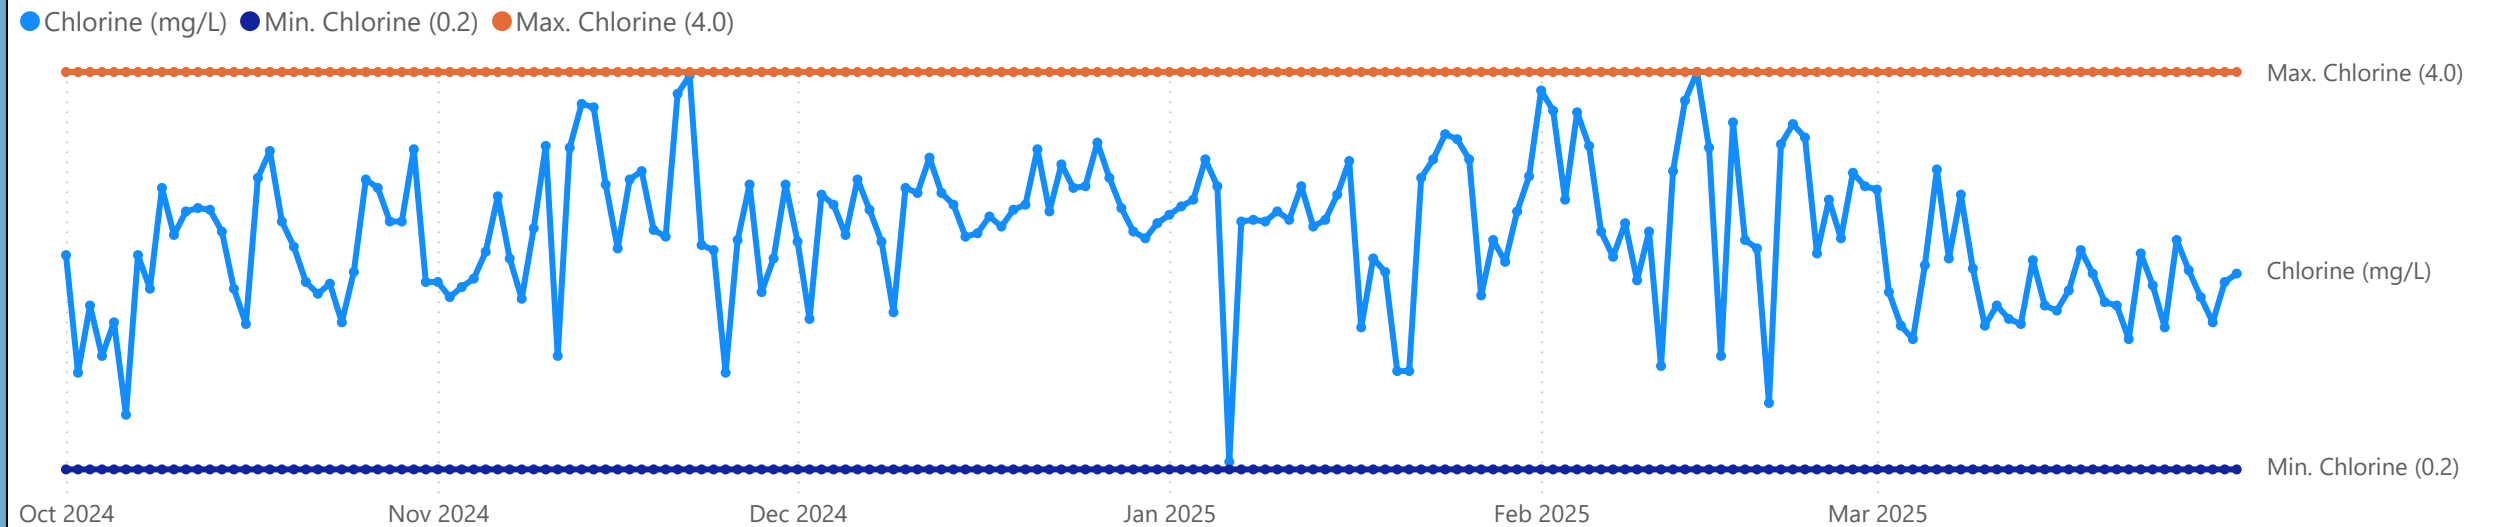





# Executive Dashboard



Select Month

10/01/2024

11/01/2024

12/01/2024

01/01/2025

02/01/2025

0

Count of Locations with Alkanity <15

0

Count of Locations with pH < 8.45

Distribution System Quality Data (Alk)

+

-

Distribution System Quality Data (pH)

+

-

Note: Mississippi Department of Health (MSDH) has approved the reduction of distribution sampling from once per month to once per quarter. The next publication of this slide will be in May 2025.

3 mi

Icon Map Pro

Alkaline Range: Yellow - < 25 Green - >= 25

3 mi

Icon Map Pro

pH Range for all sites: Yellow - < 8.6 Green - >= 8.6 Selected sites: Yellow - < 8 and Green >= 8.0)



# Executive Dashboard



## Count of Locations with pH<8.45, ALK<15

