




Executive Dashboard



Data as of 05/31/2025

Daily Water Production

● J.H. Fewell (MG) ● O.B. Curtis Conv (MG) ● Total (MG) ● O.B. Curtis Mem (MG)

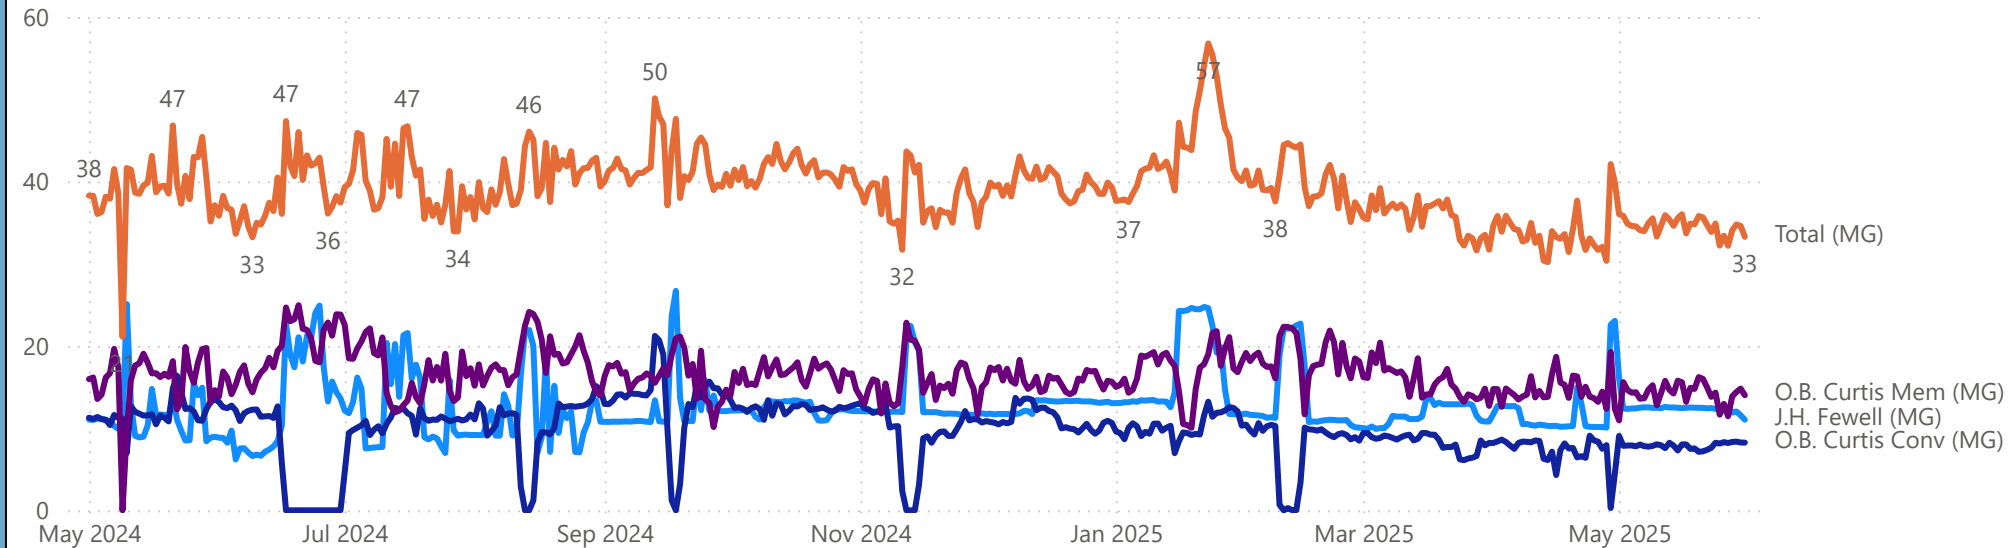

Water Production MG/Day (YTD)

Total Production (Min)
21.10

Total Production (Avg)
37.56

O.B. Curtis Membrane (Avg)
16.00


O.B. Curtis Conventional (Avg)
8.32

J.H. Fewell (Avg)
13.25

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2025	5	May	12.46	7.90	14.23
2025	4	April	11.87	7.30	14.64
2025	3	March	11.65	8.33	15.66
2025	2	February	13.55	7.69	18.68
2025	1	January	16.69	10.28	16.98
2024	12	December	12.68	11.14	15.87

Plant	Average Production Trend (MG/Day)						
	May 2025	May 2024	25'-24' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	12.46	11.44	8.88%	13.16	11.99	13.25	10-20
O.B. Curtis Conventional	7.90	11.79	-33.00%	8.79	7.85	8.32	10-20
O.B. Curtis Membrane	14.23	15.83	-10.14%	15.98	14.84	16.00	23
Total	34.59	39.07	-11.47%	37.92	34.69	37.56	43-53

Average Share of Each Plant

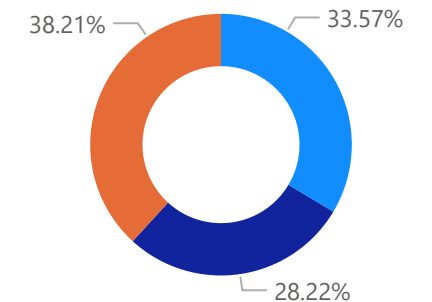

● JHF ● OBC CONV ● OBC MEM




Executive Dashboard




Turbidity (JHF)

● Filter (Max) ● Max Value (.34)

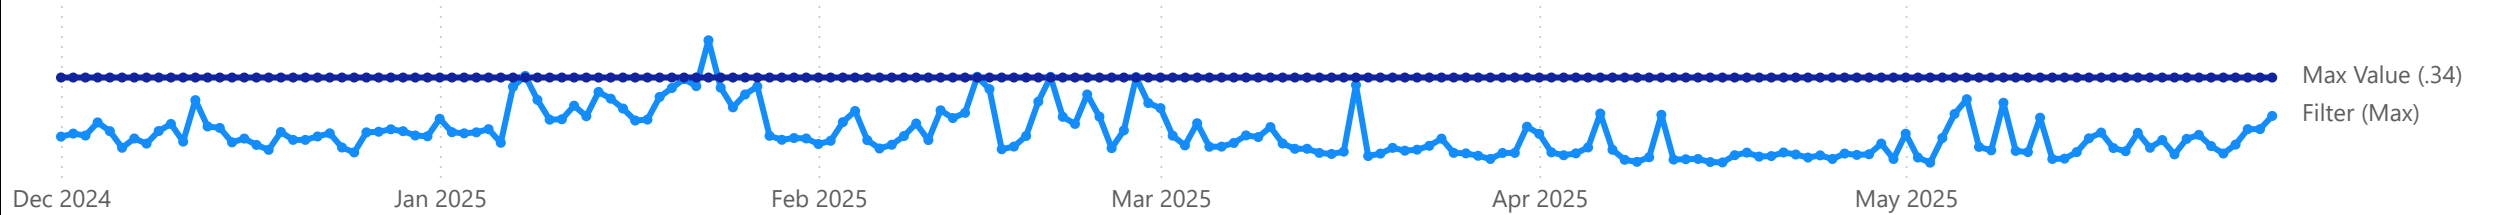


pH (JHF)

● JHF(pH) ● Min_pH(9.0)

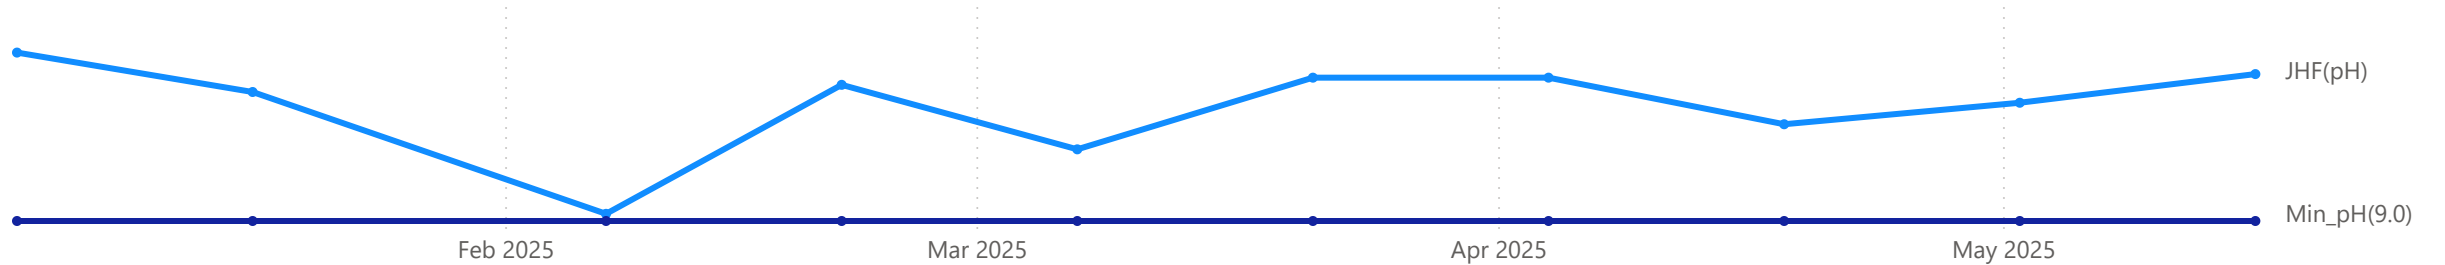

Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

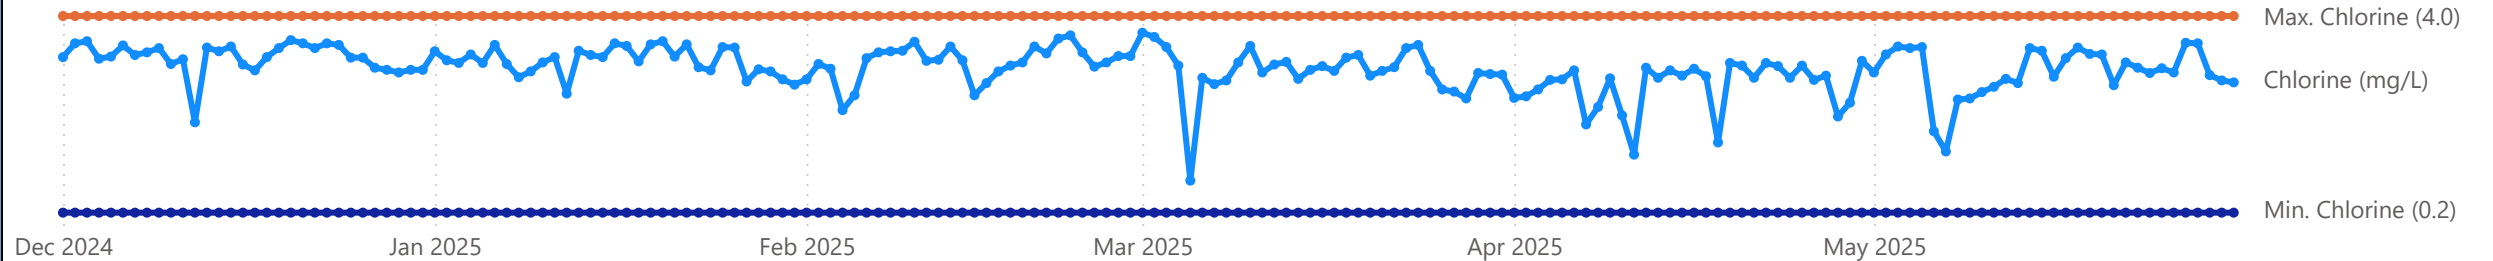




Executive Dashboard




Turbidity (OBC1 Conventional)

● CFE (Max) ● Max Turbidity (.34)

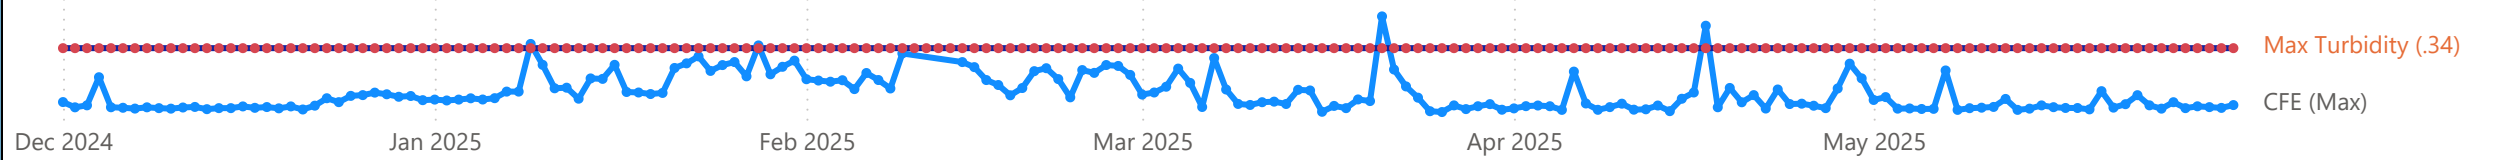


Turbidity (OBC2 Membrane)

● CFE (Max) ● Max_Turbidity (.34)

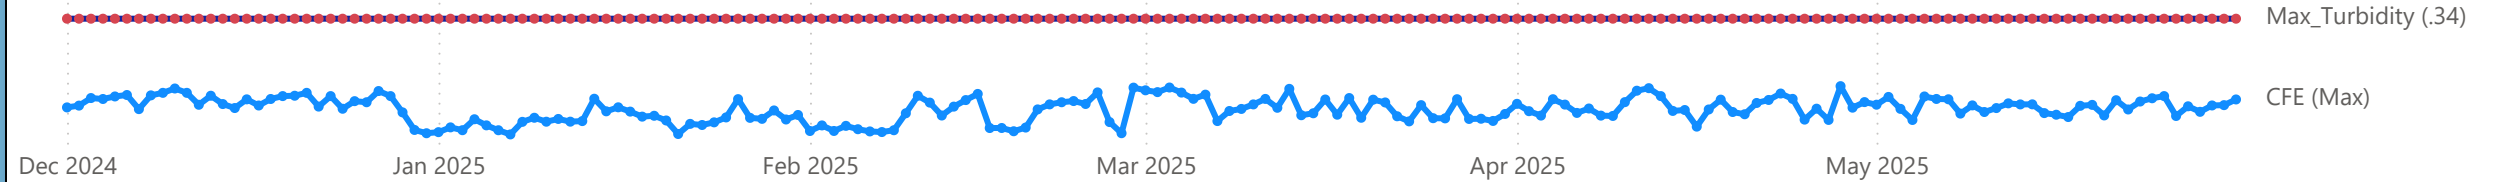

pH

● OBC(pH) ● Min_pH(9.0)

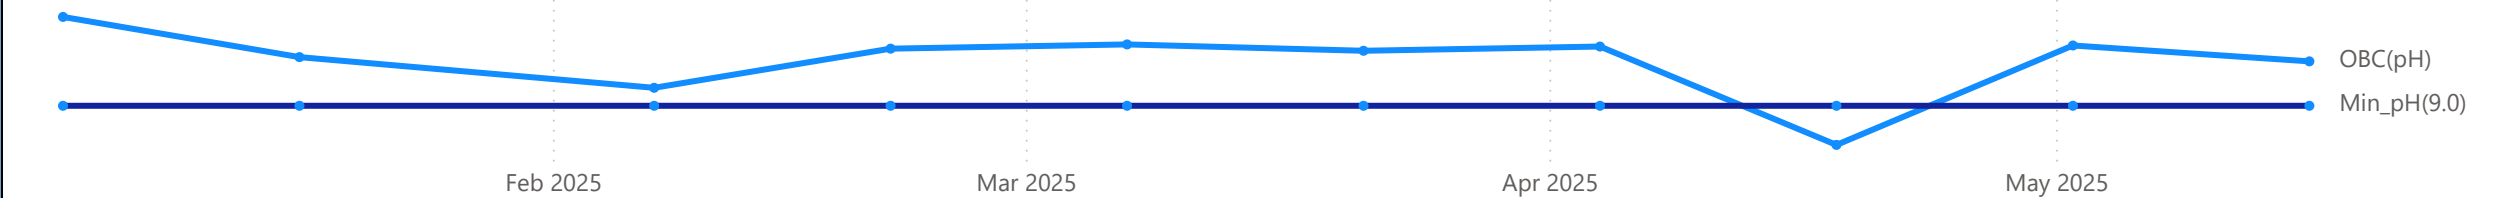




Executive Dashboard



OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

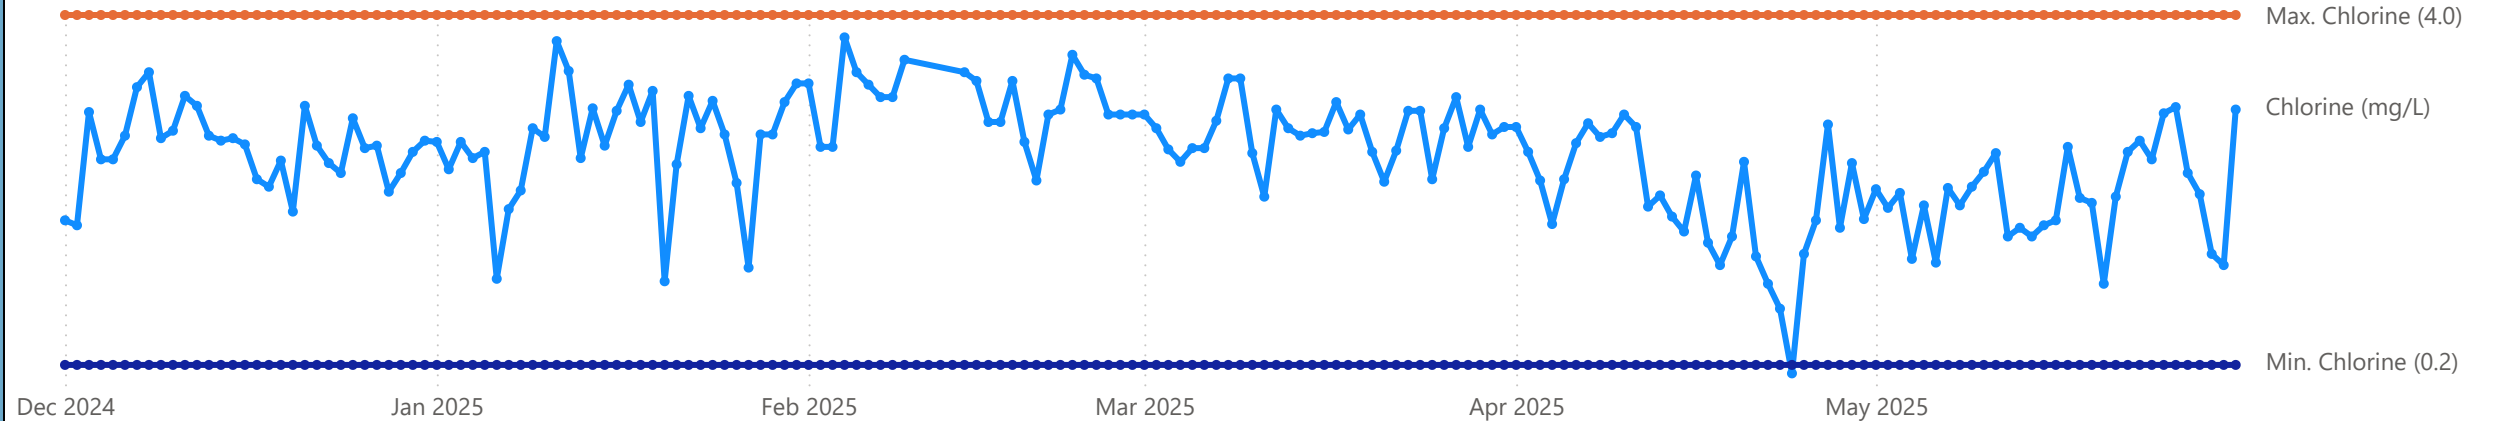

OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

