




Executive Dashboard



Data as of 06/30/2025

Daily Water Production

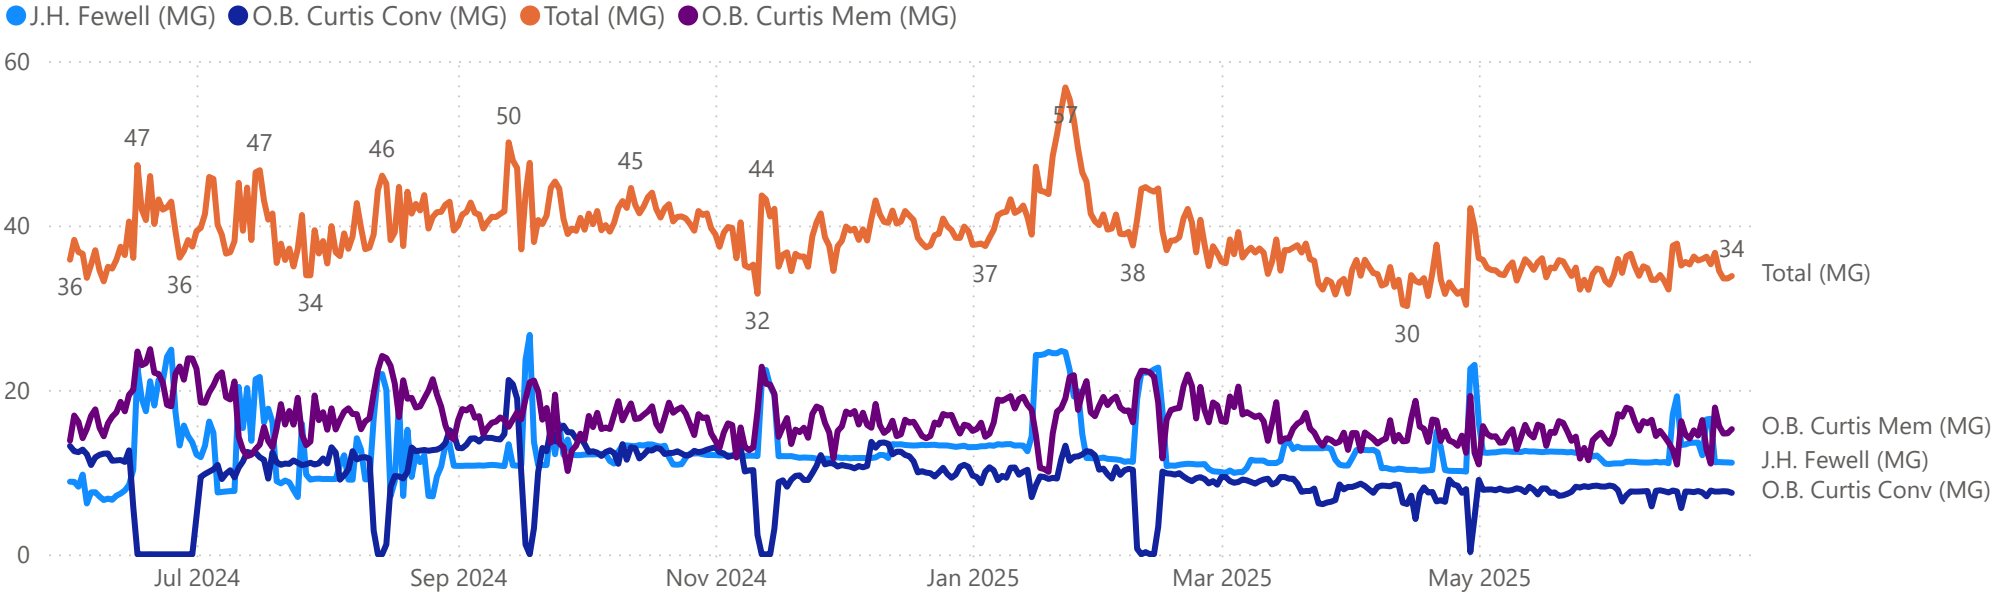

Water Production MG/Day (YTD)

Total Production (Min)
30.19

Total Production (Avg)
37.12

O.B. Curtis Membrane (Avg)
15.83


O.B. Curtis Conventional (Avg)
8.18

J.H. Fewell (Avg)
13.11

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2025	6	June	12.40	7.49	15.02
2025	5	May	12.46	7.90	14.23
2025	4	April	11.87	7.30	14.64
2025	3	March	11.65	8.33	15.66
2025	2	February	13.55	7.69	18.68
2025	1	January	16.69	10.28	16.98

Plant	Average Production Trend (MG/Day)						
	June 2025	June 2024	25'-24' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	12.40	12.95	-4.27%	13.05	12.09	13.11	10-20
O.B. Curtis Conventional	7.49	6.21	20.72%	8.60	7.76	8.18	10-20
O.B. Curtis Membrane	15.02	19.21	-21.83%	15.84	14.89	15.83	23
Total	34.91	38.37	-9.02%	37.49	34.74	37.12	43-53

Average Share of Each Plant

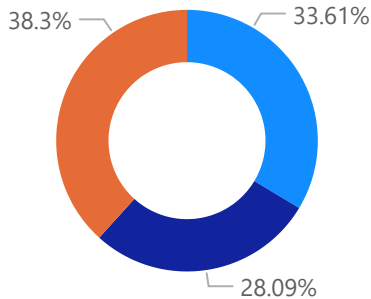

● JHF ● OBC CONV ● OBC MEM




Executive Dashboard




Turbidity (JHF)

● Filter (Max) ● Max Value (.34)

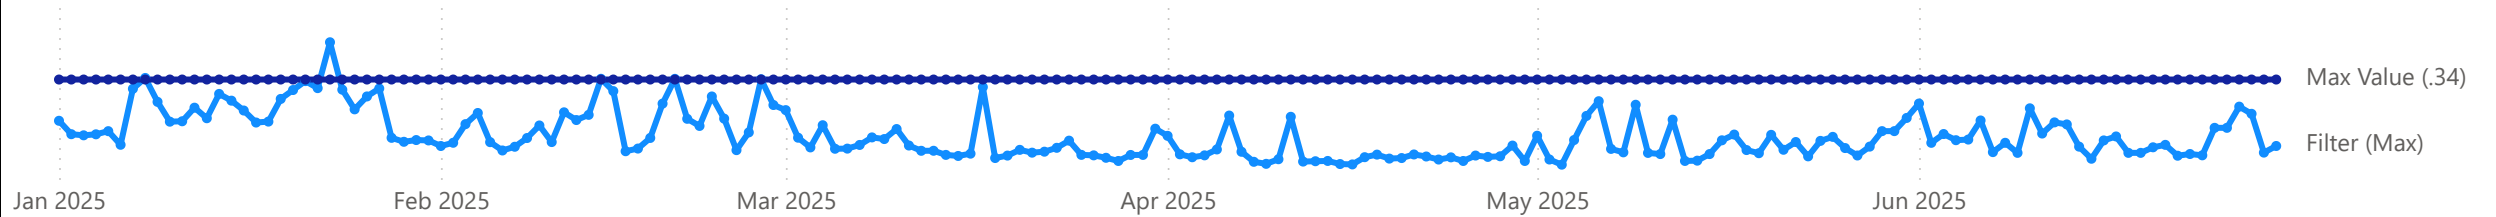


pH (JHF)

● JHF(pH) ● Min_pH(9.0)

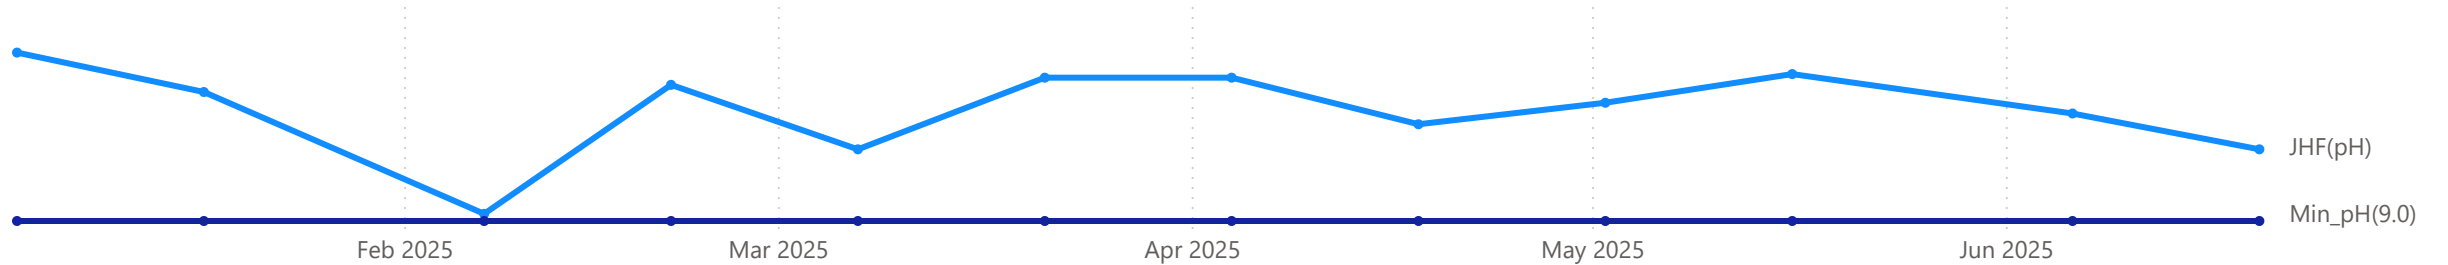

Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

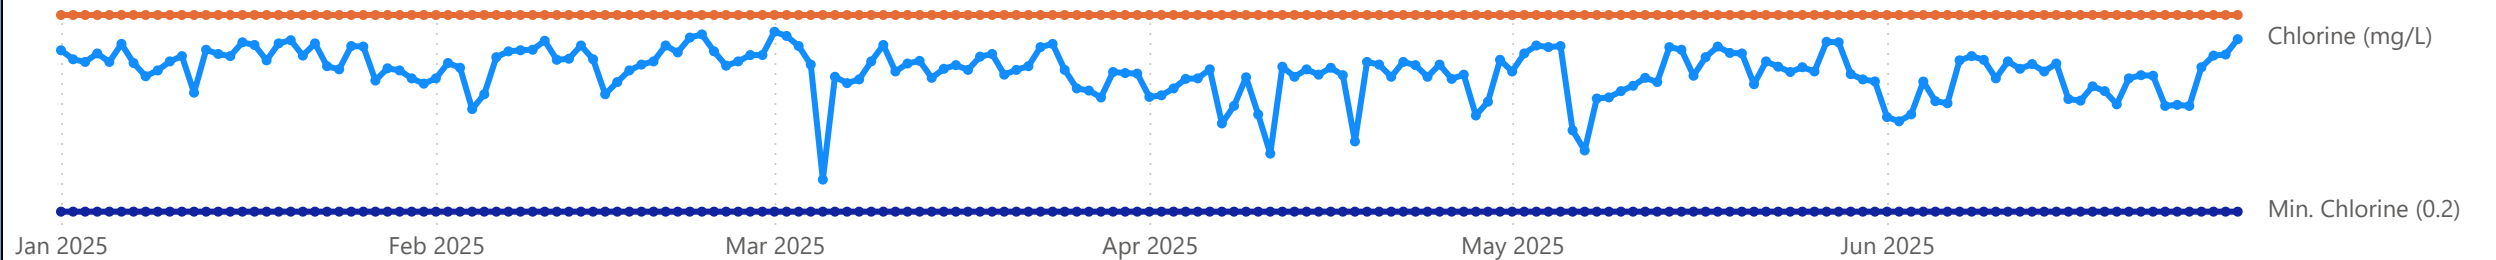




Executive Dashboard




Turbidity (OBC1 Conventional)

● CFE (Max) ● Max Turbidity (.34)

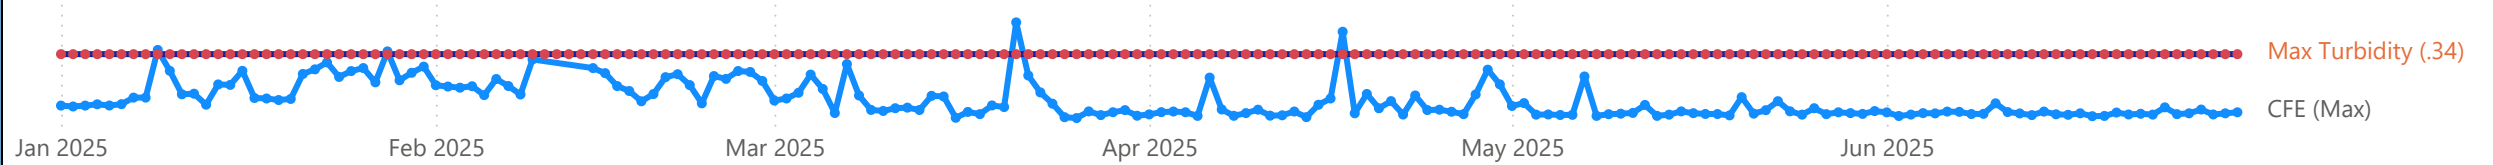


Turbidity (OBC2 Membrane)

● CFE (Max) ● Max_Turbidity (.34)

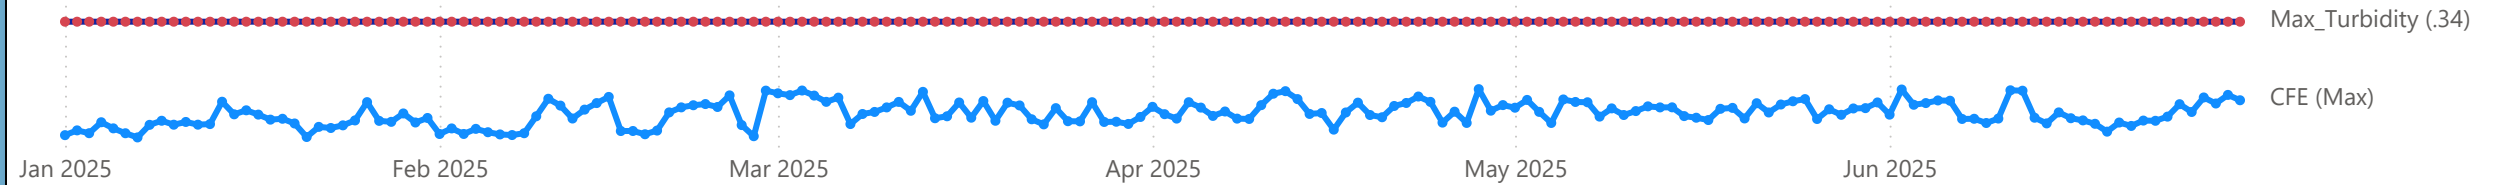

pH

● OBC(pH) ● Min_pH(9.0)

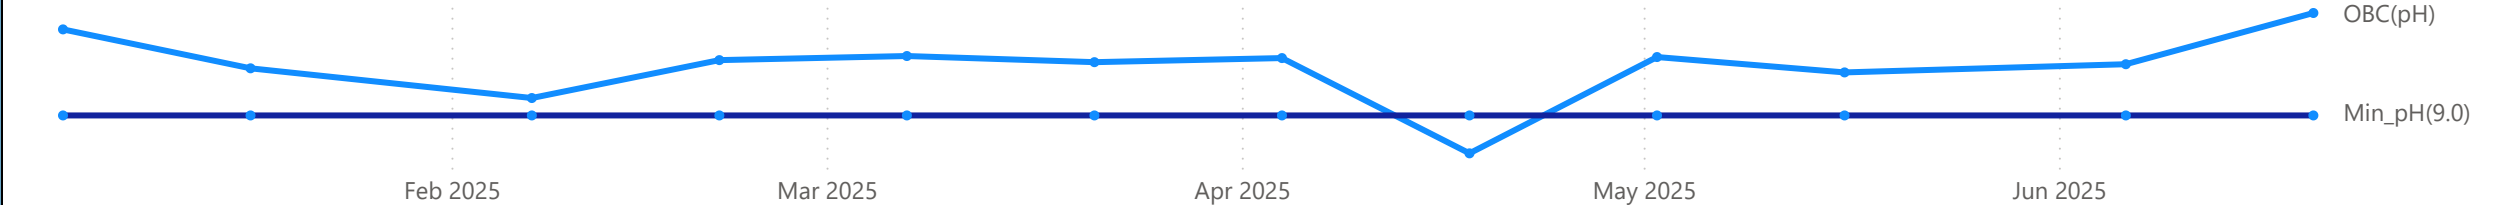




Executive Dashboard



OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

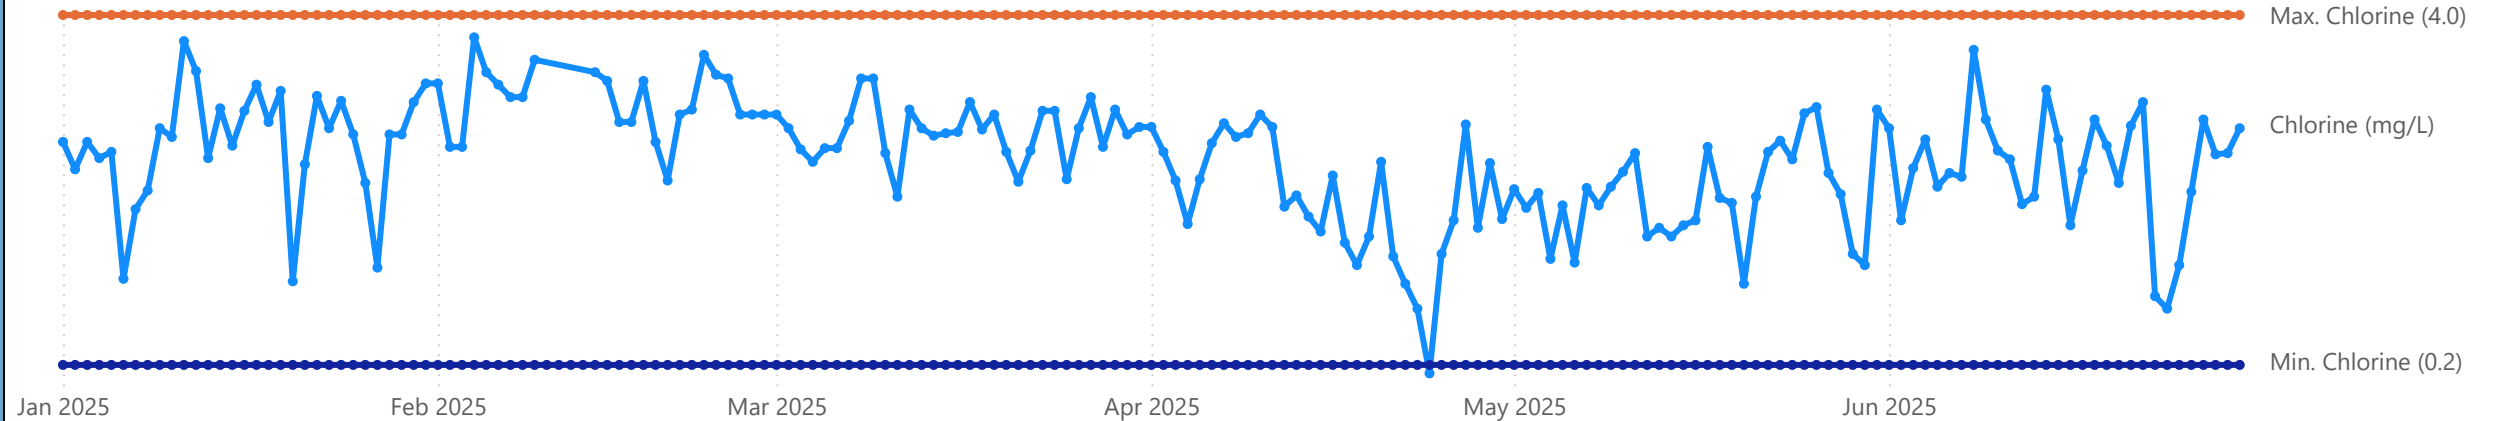

OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

