




Executive Dashboard



Data as of 07/31/2025

Daily Water Production

● J.H. Fewell (MG) ● O.B. Curtis Conv (MG) ● Total (MG) ● O.B. Curtis Mem (MG)

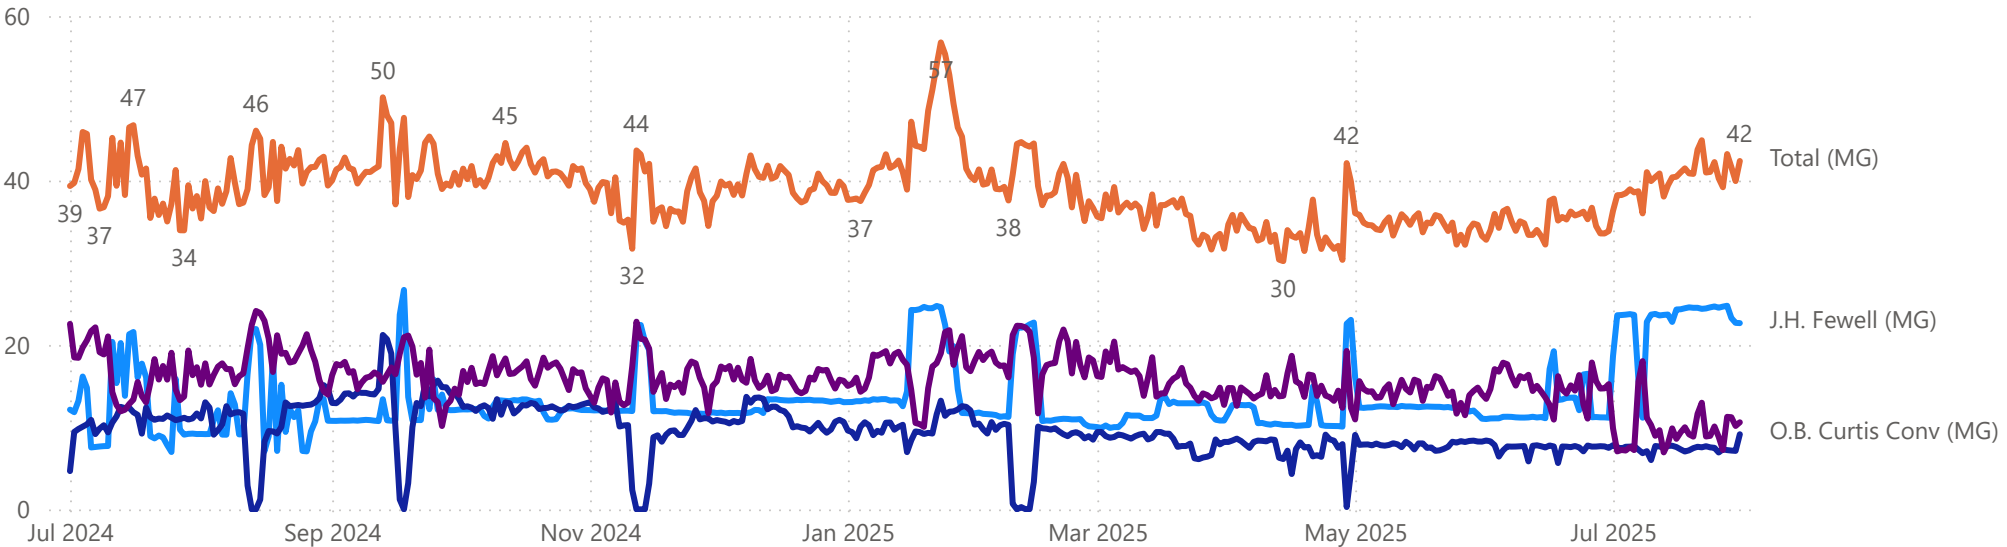


Water Production MG/Day (YTD)

Total Production (Min)	30.19
Total Production (Avg)	37.58
O.B. Curtis Membrane (Avg)	14.94
O.B. Curtis Conventional (Avg)	8.07
J.H. Fewell (Avg)	14.56

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2025	7	July	23.07	7.43	9.74
2025	6	June	12.40	7.49	15.02
2025	5	May	12.46	7.90	14.23
2025	4	April	11.87	7.30	14.64
2025	3	March	11.65	8.33	15.66
2025	2	February	13.55	7.69	18.68

Plant	Average Production Trend (MG/Day)						
	July 2025	July 2024	25'-24' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	23.07	12.29	87.79%	14.21	16.01	14.56	10-20
O.B. Curtis Conventional	7.43	10.67	-30.39%	7.68	7.61	8.07	10-20
O.B. Curtis Membrane	9.74	16.71	-41.73%	14.57	12.97	14.94	23
Total	40.24	39.67	1.44%	36.46	36.60	37.58	43-53

Avg Production Share by WTP (Rolling 6 months)

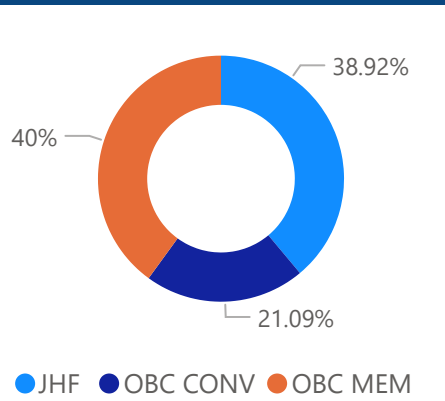




Executive Dashboard




Turbidity (JHF)

● Filter (Max) ● Max Value (.34)

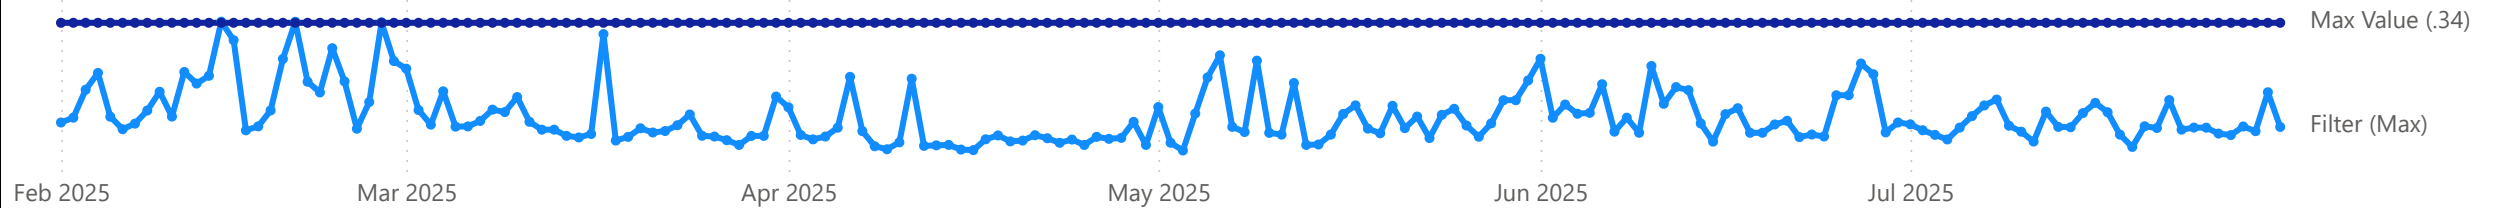


pH (JHF)

● JHF(pH) ● Min_pH(9.0)

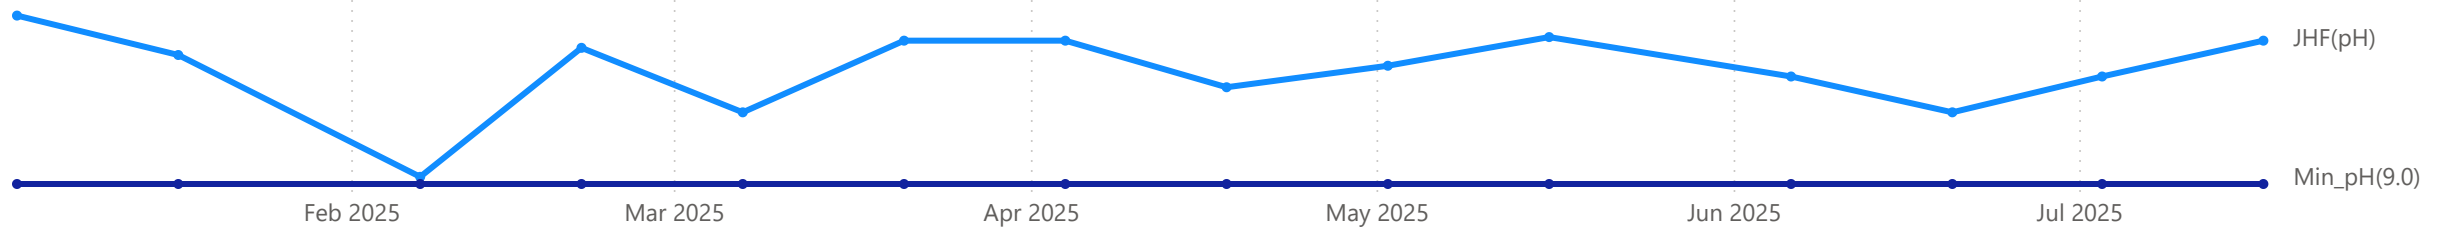

Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

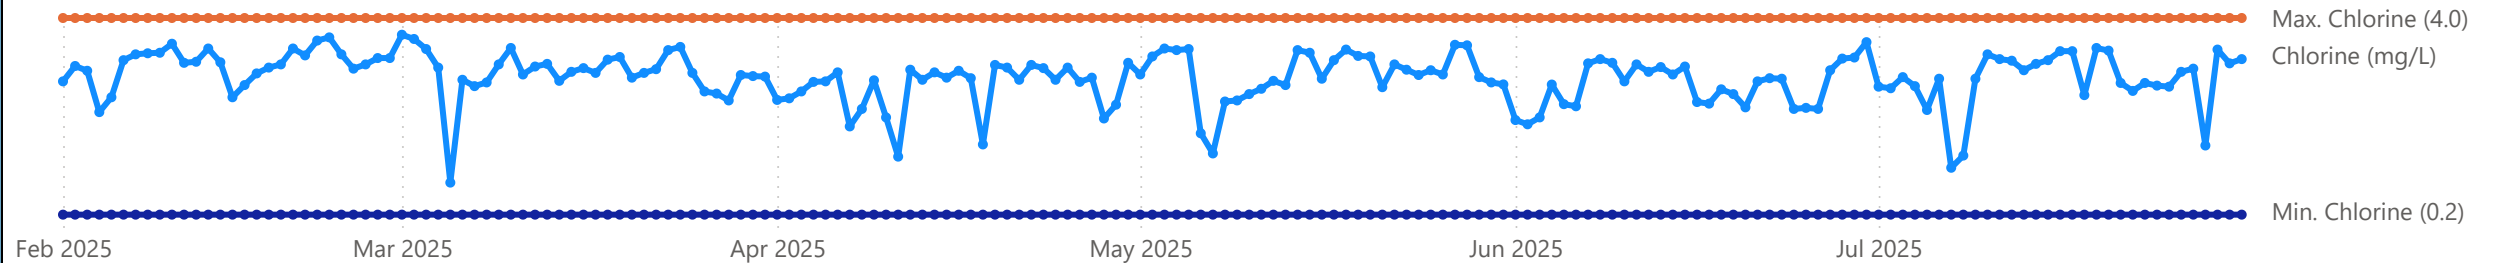




Executive Dashboard




Turbidity (OBC1 Conventional)

● CFE (Max) ● Max Turbidity (.34)

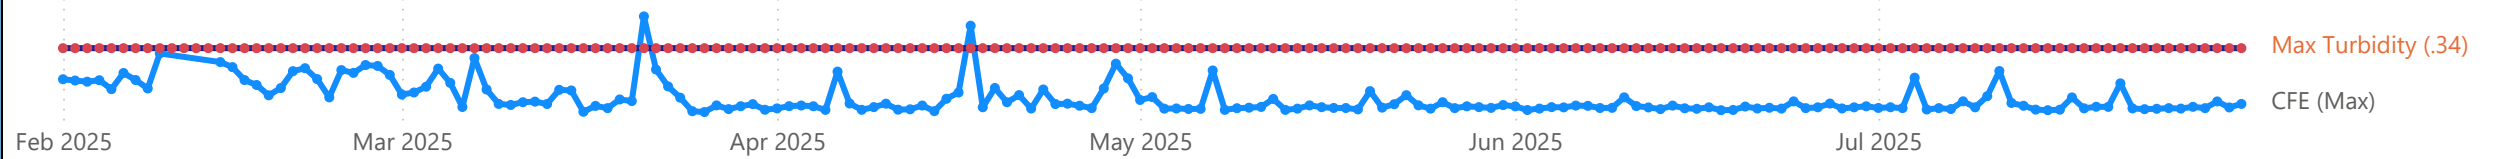


Turbidity (OBC2 Membrane)

● CFE (Max) ● Max_Turbidity (.34)

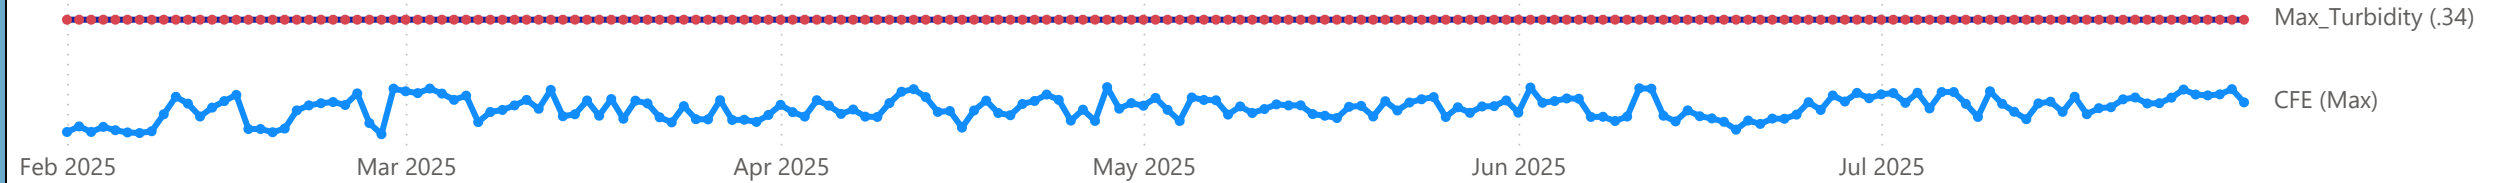

pH

● OBC(pH) ● Min_pH(9.0)

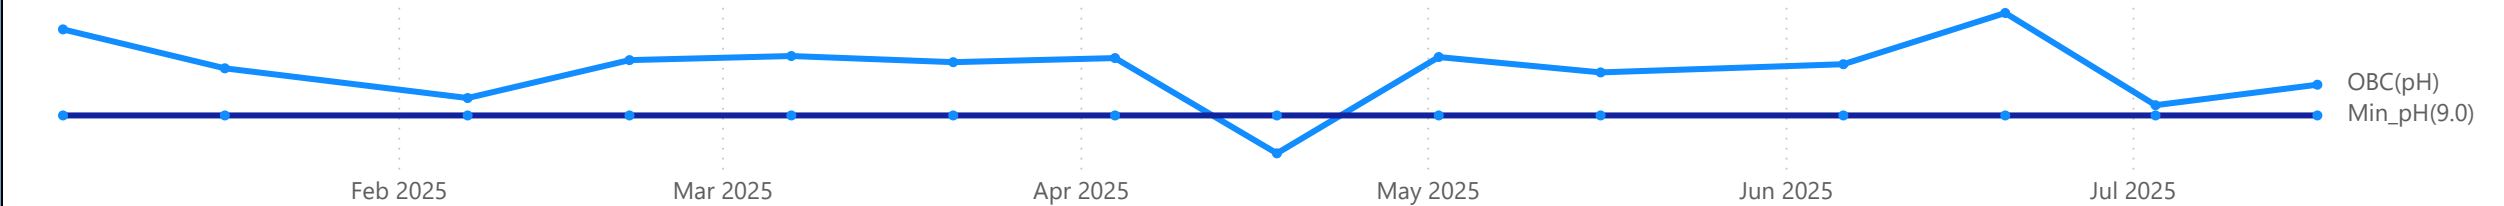



Executive Dashboard



OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)



OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

