




Executive Dashboard



Data as of 08/31/2025

Daily Water Production

● J.H. Fewell (MG) ● O.B. Curtis Conv (MG) ● Total (MG) ● O.B. Curtis Mem (MG)

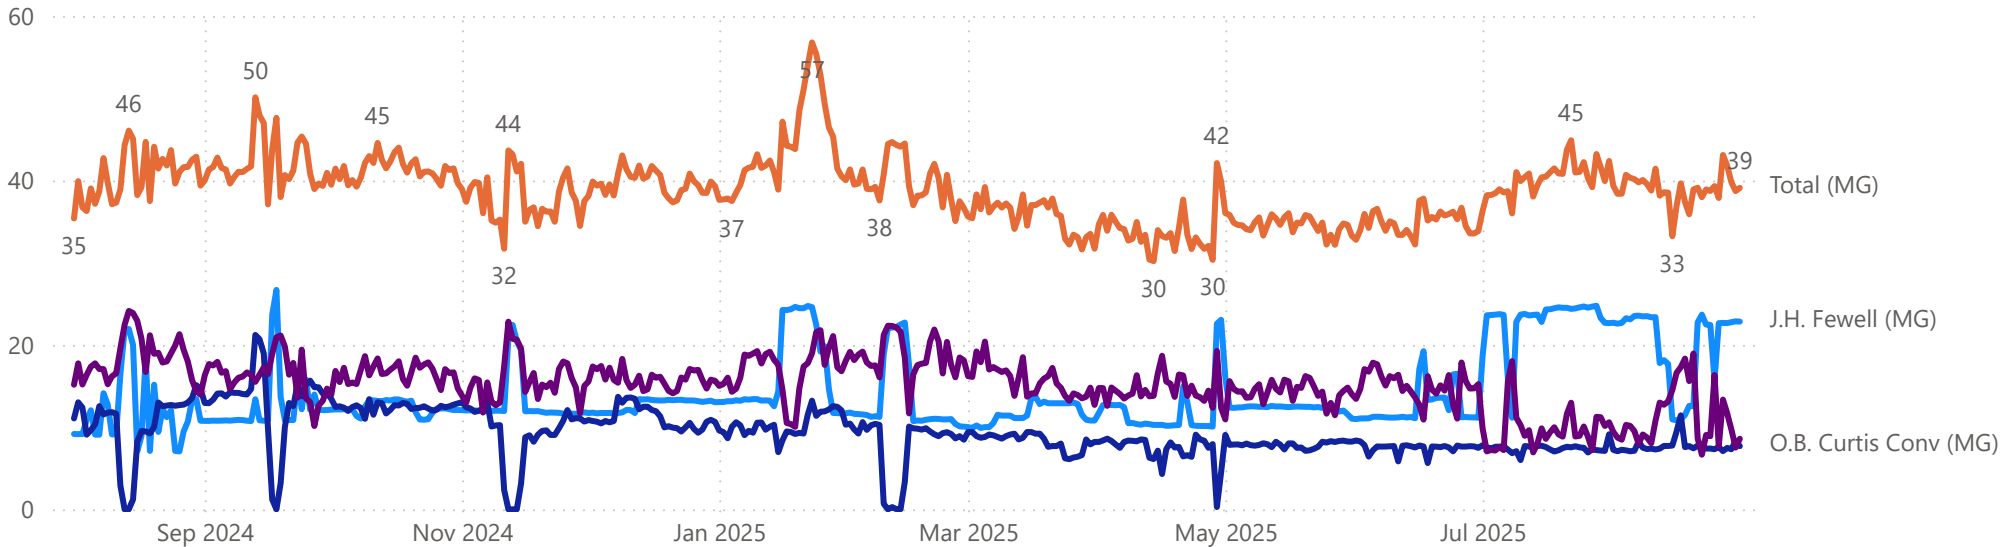

Water Production MG/Day (YTD)

Total Production (Min)
30.19

Total Production (Avg)
37.76

O.B. Curtis Membrane (Avg)
14.47


O.B. Curtis Conventional (Avg)
8.02

J.H. Fewell (Avg)
15.26

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2025	8	August	20.04	7.67	11.27
2025	7	July	23.07	7.43	9.74
2025	6	June	12.40	7.49	15.02
2025	5	May	12.46	7.90	14.23
2025	4	April	11.87	7.30	14.64
2025	3	March	11.65	8.33	15.66

Plant	Average Production Trend (MG/Day)						
	August 2025	August 2024	25'-24' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	20.04	11.85	69.19%	15.31	18.57	15.26	10-20
O.B. Curtis Conventional	7.67	10.34	-25.83%	7.68	7.53	8.02	10-20
O.B. Curtis Membrane	11.27	18.34	-38.57%	13.39	11.97	14.47	23
Total	38.98	40.53	-3.82%	36.38	38.08	37.76	43-53

Avg Production Share by WTP (Rolling 6 months)

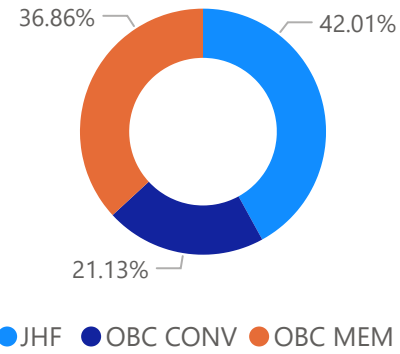





Executive Dashboard




Turbidity (JHF)

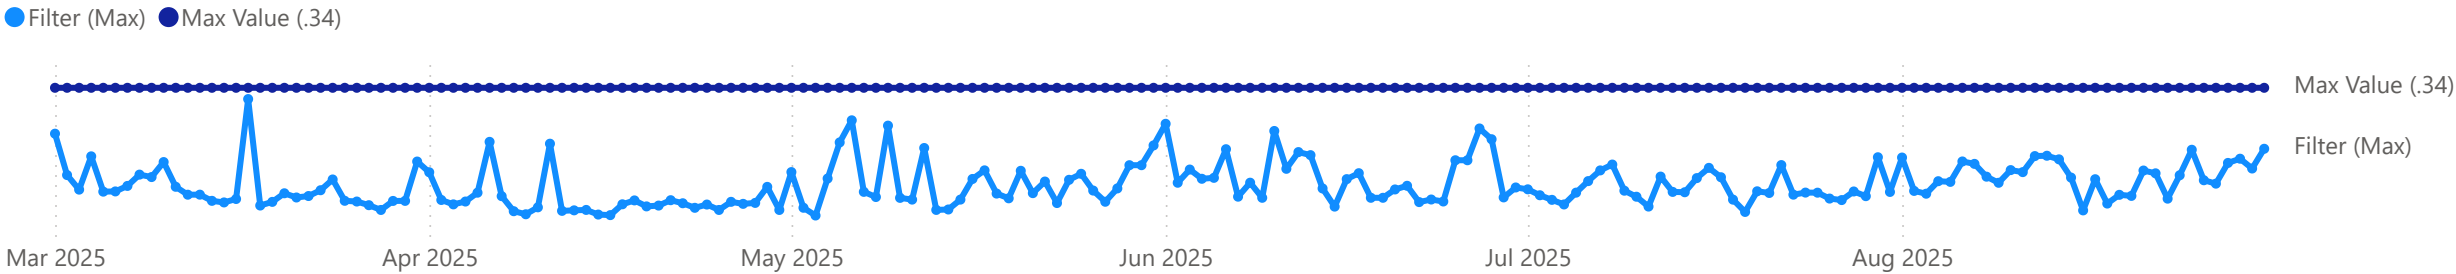

pH (JHF)

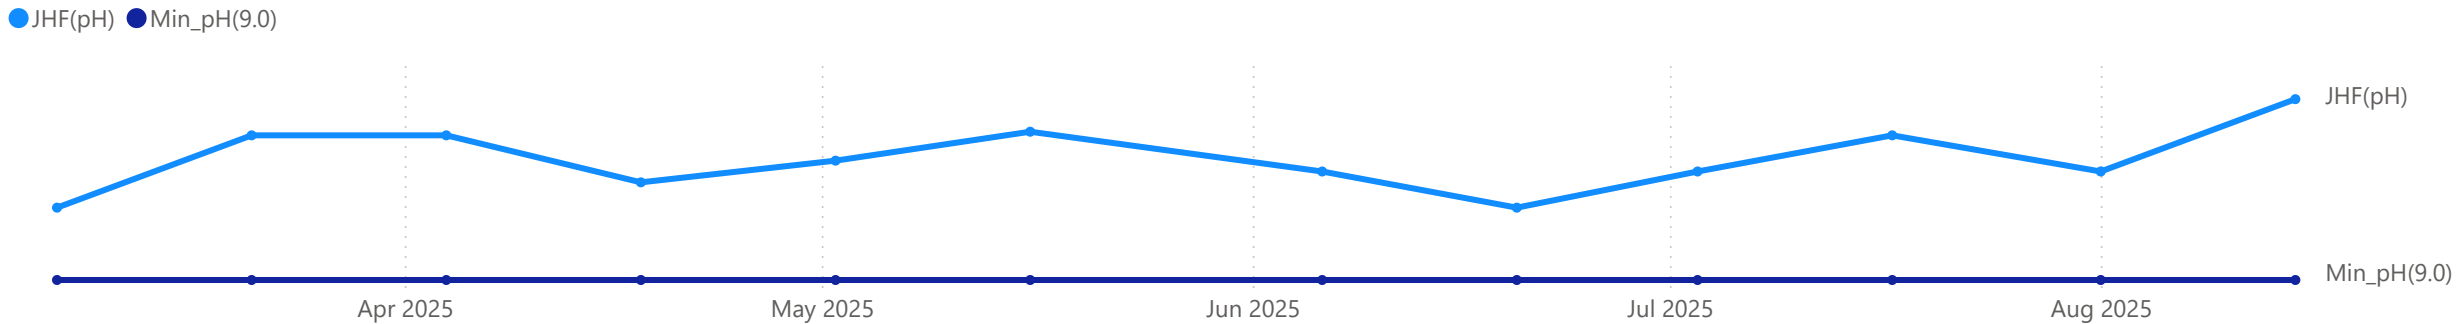

Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

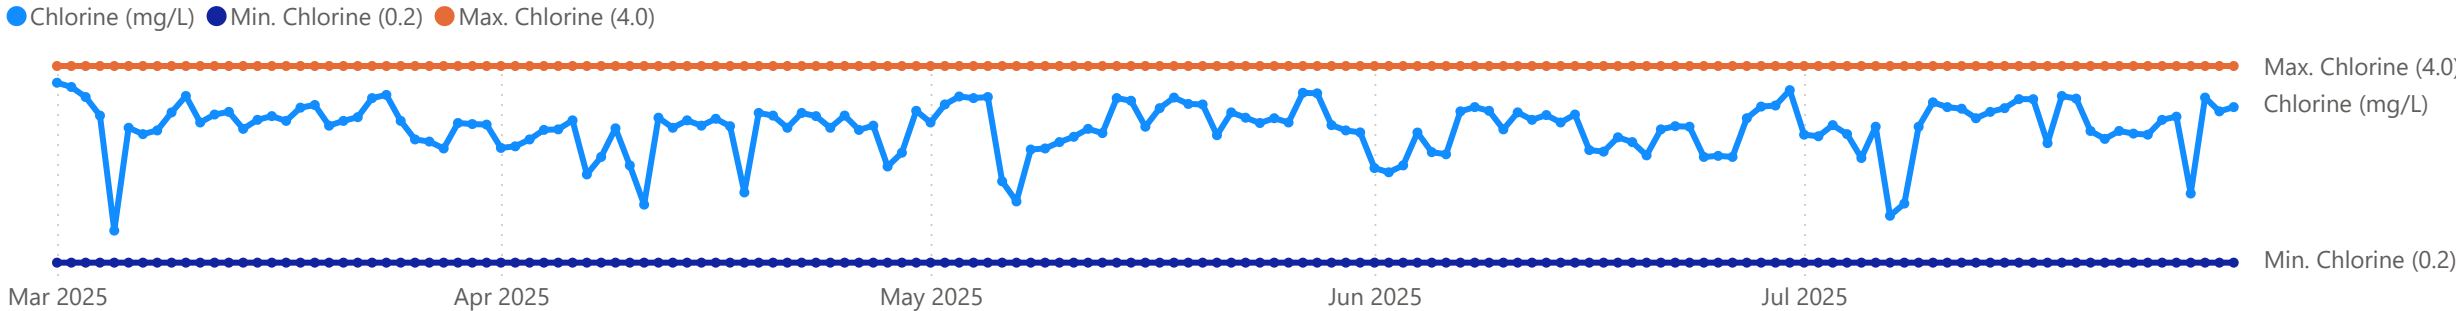




Executive Dashboard




Turbidity (OBC1 Conventional)

● CFE (Max) ● Max Turbidity (.34)

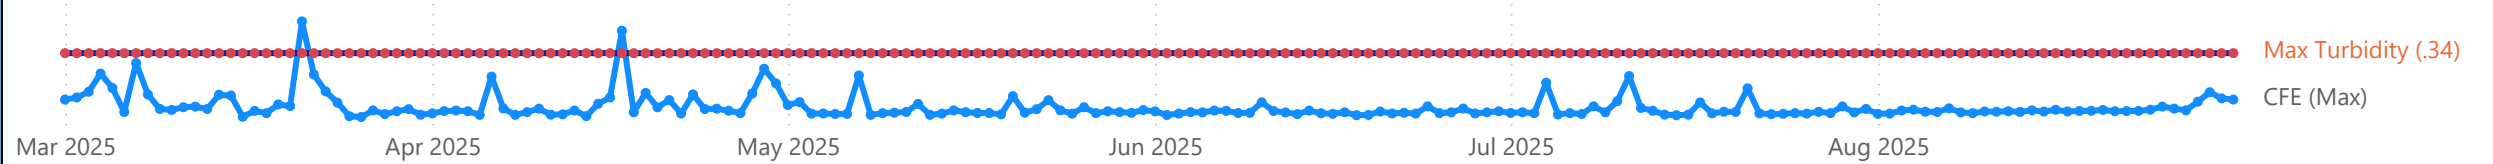


Turbidity (OBC2 Membrane)

● CFE (Max) ● Max_Turbidity (.34)

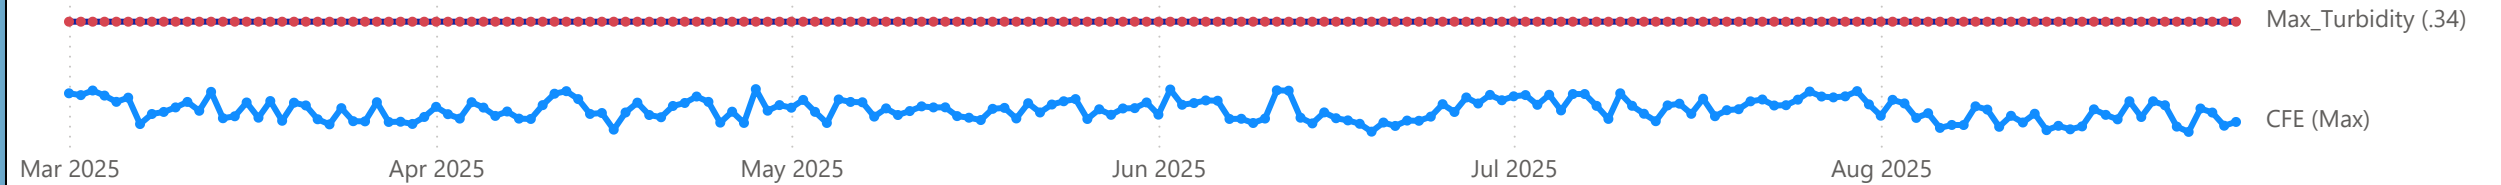

pH

● OBC(pH) ● Min_pH(9.0)

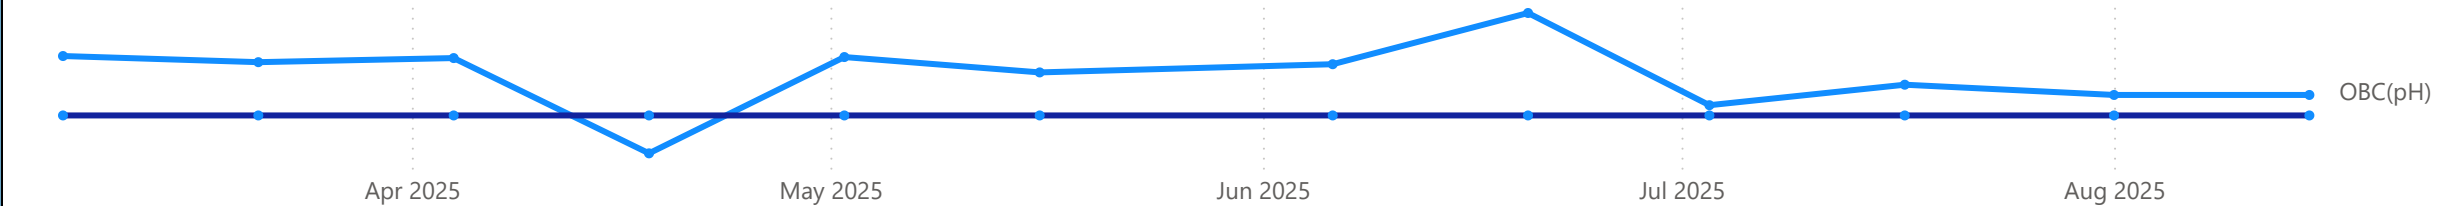




Executive Dashboard




OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

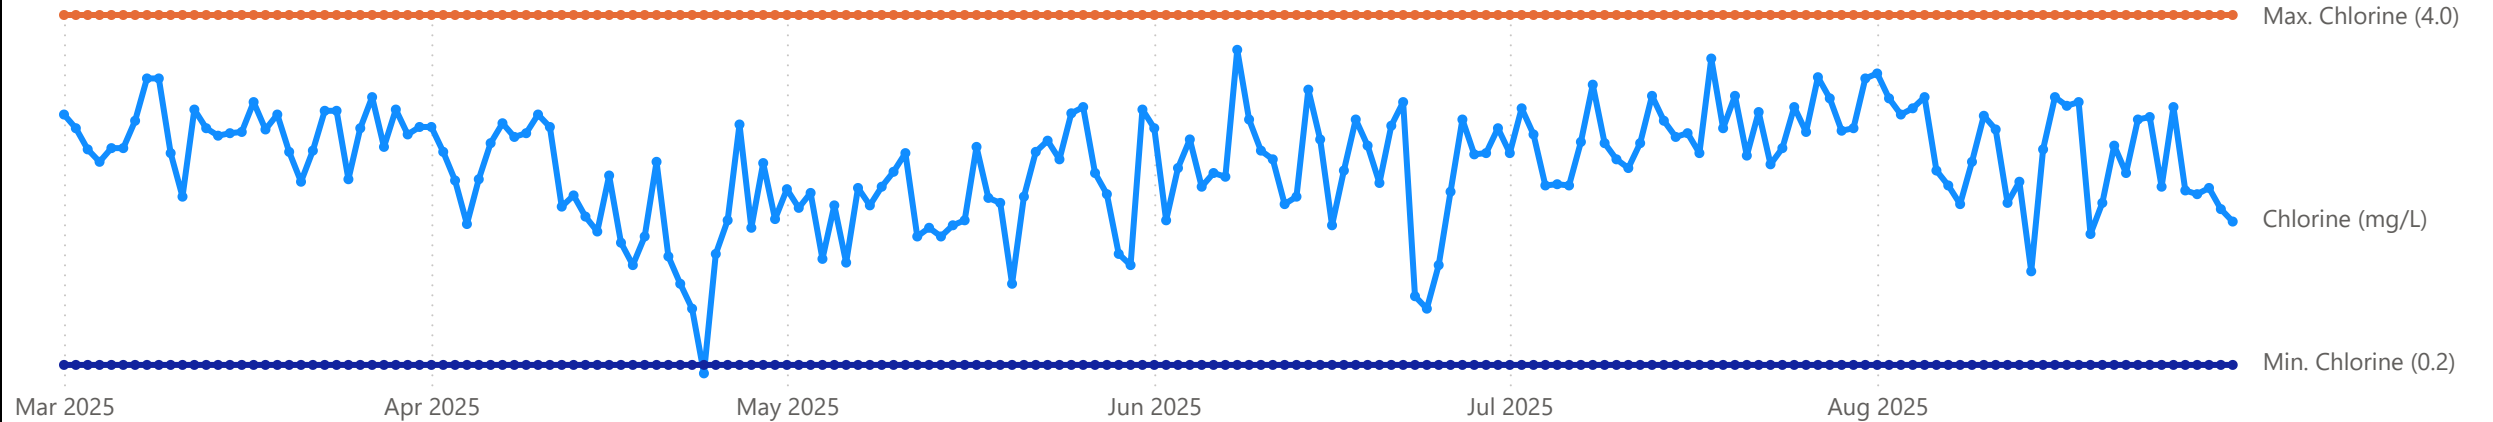

OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

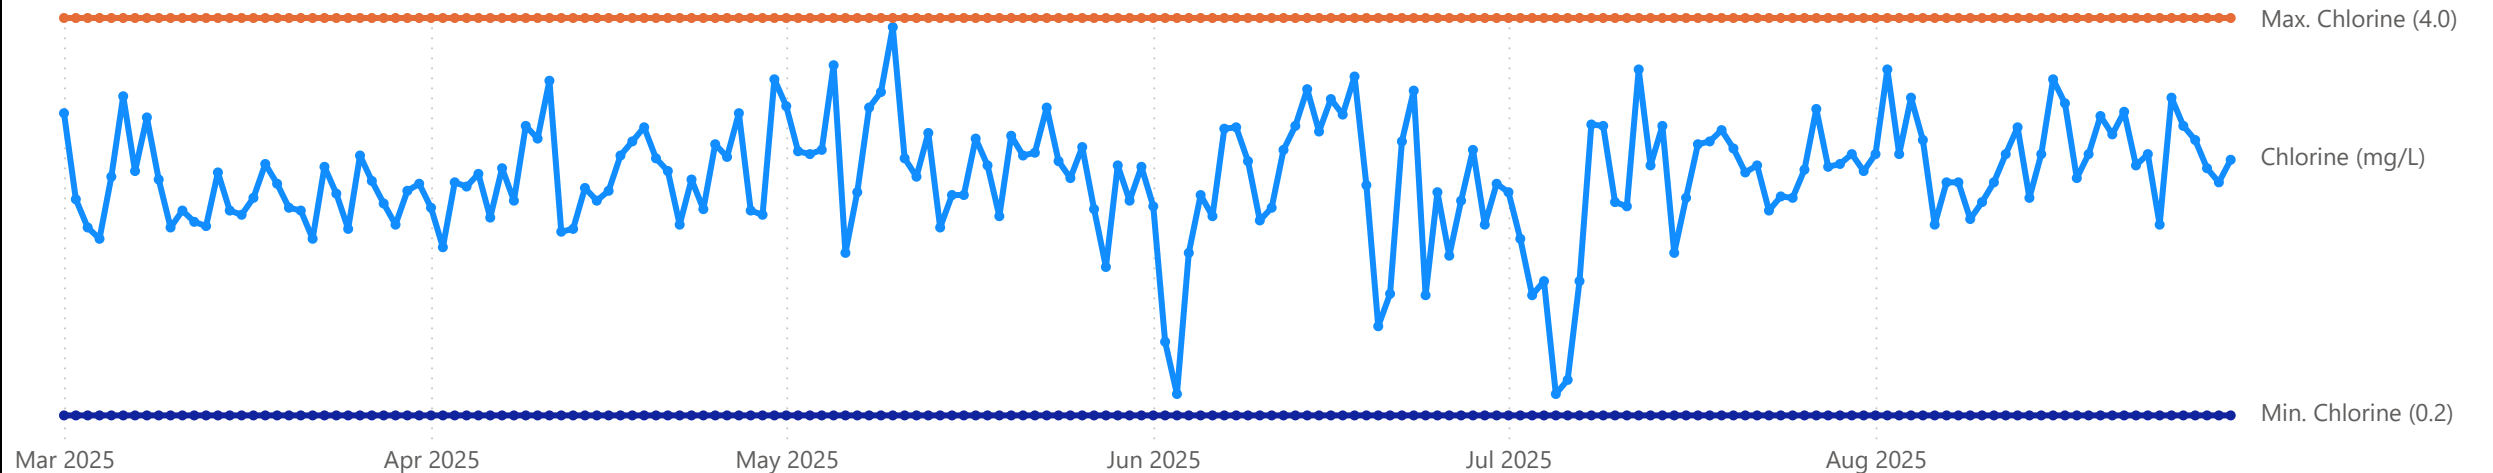



Executive Dashboard



Select Month

10/01/2024

01/01/2025

05/01/2025

08/01/2025


0

Count of Locations with Alkanity <15

0


Count of Locations with pH < 8.6

Distribution System Quality Data (Alk)

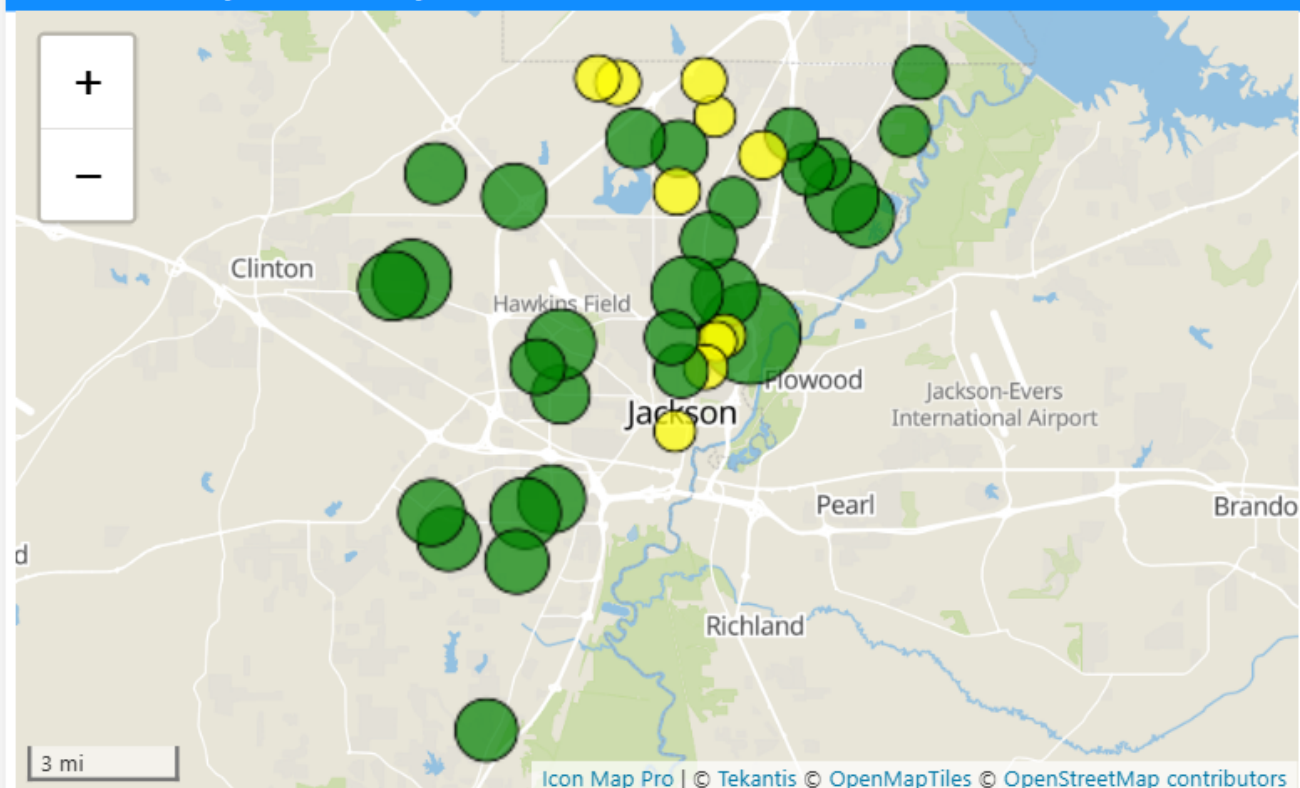

Alkaline Range: Yellow - < 25 Green - >= 25

Distribution System Quality Data (pH)

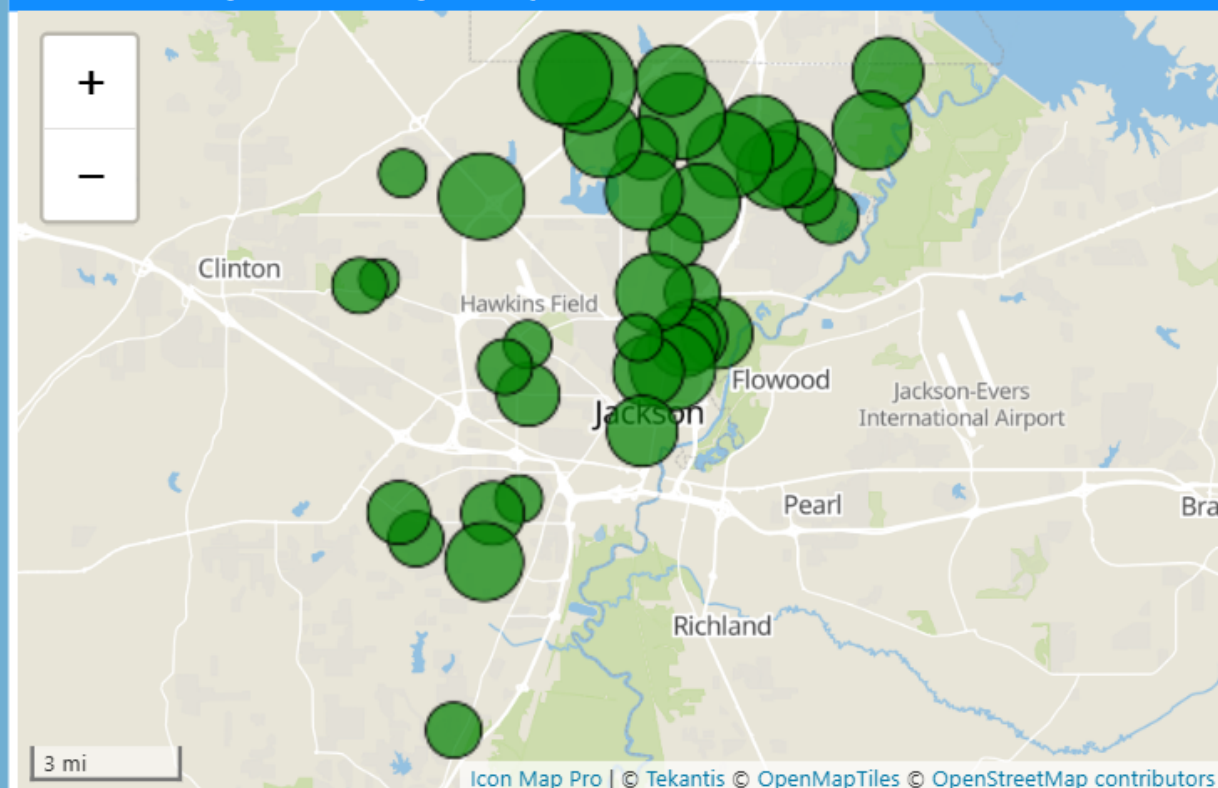

pH Range for all sites: Yellow - < 8.6 Green - >= 8.6 Selected sites: Yellow - < 8 and Green >= 8.0)