




Executive Dashboard



Data as of 09/30/2025

Daily Water Production

● J.H. Fewell (MG) ● O.B. Curtis Conv (MG) ● Total (MG) ● O.B. Curtis Mem (MG)

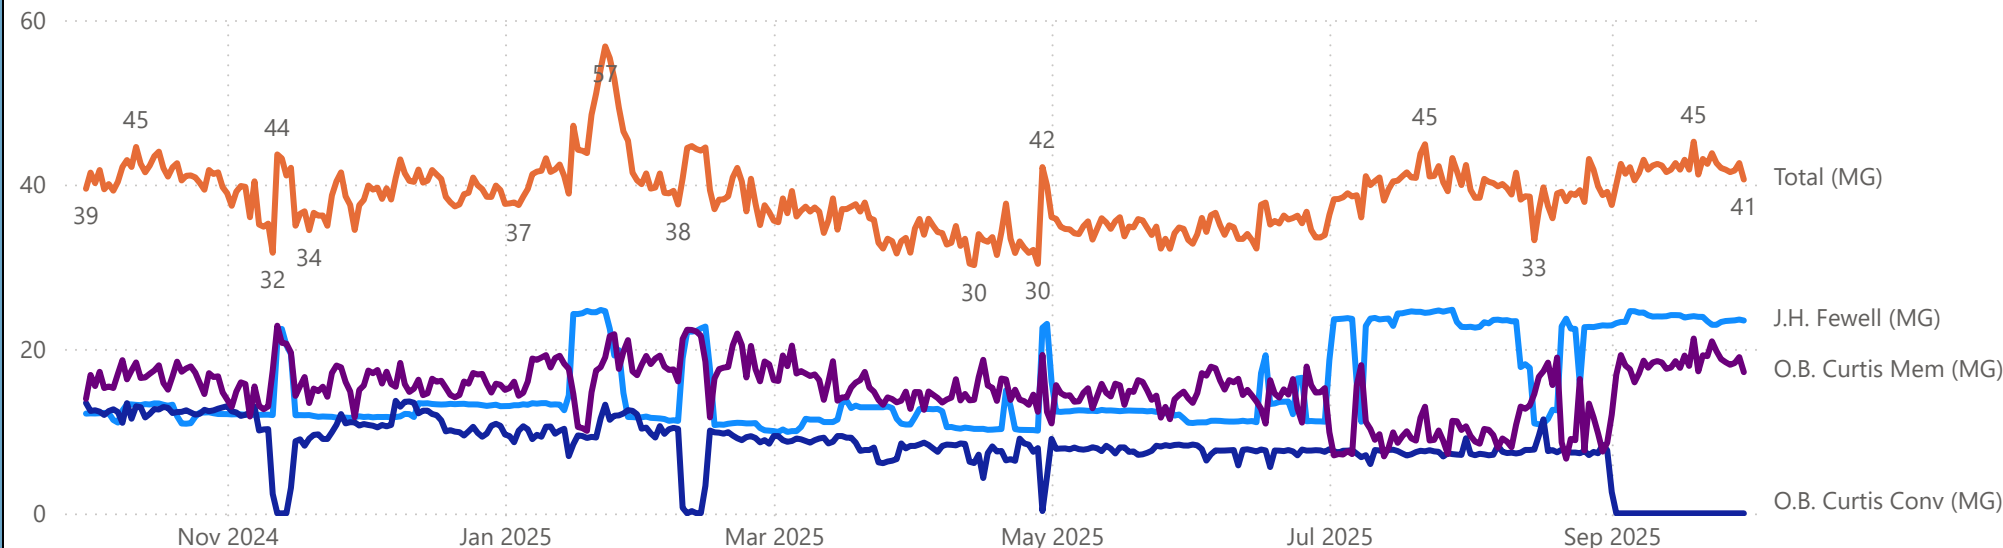

Water Production MG/Day (YTD)

Total Production (Min)

30.19

Total Production (Avg)

38.22

O.B. Curtis Membrane (Avg)

14.87

O.B. Curtis Conventional (Avg)

7.15


J.H. Fewell (Avg)

16.19

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2025	9	September	23.73	0.09	18.13
2025	8	August	20.04	7.67	11.27
2025	7	July	23.07	7.43	9.74
2025	6	June	12.40	7.49	15.02
2025	5	May	12.46	7.90	14.23
2025	4	April	11.87	7.30	14.64

Plant	Average Production Trend (MG/Day)						
	September 2025	September 2024	25'-24' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	23.73	12.60	88.30%	16.50	19.84	16.19	10-20
O.B. Curtis Conventional	0.09	13.15	-99.34%	6.61	5.70	7.15	10-20
O.B. Curtis Membrane	18.13	16.29	11.28%	14.06	13.49	14.87	23
Total	41.94	42.04	-0.24%	37.17	39.03	38.22	43-53

Avg Production Share by WTP (Rolling 6 months)

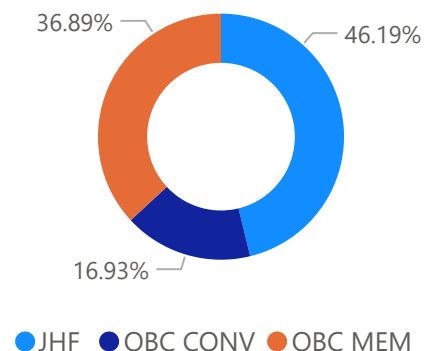




Executive Dashboard




Turbidity (JHF)

● Filter (Max) ● Max Value (.34)

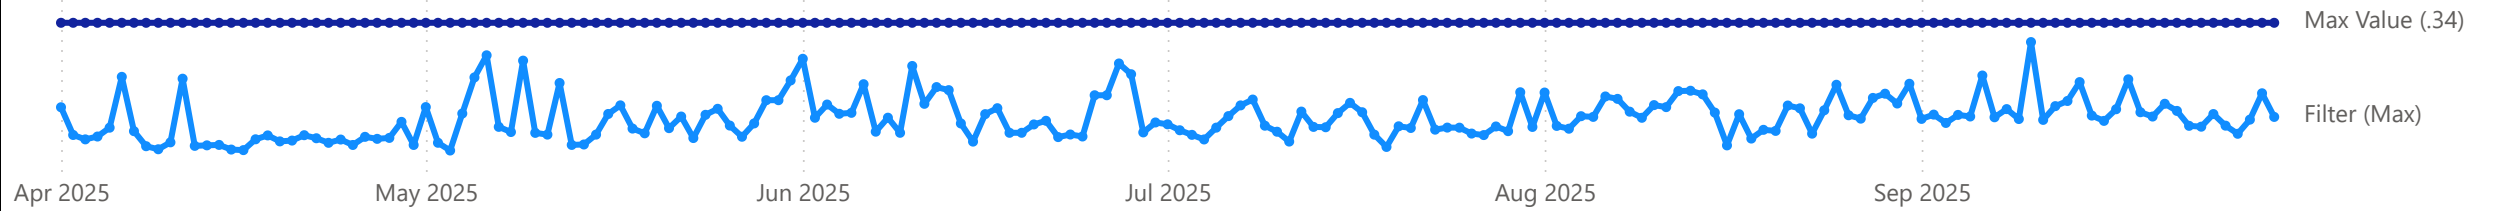


pH (JHF)

● JHF(pH) ● Min_pH(9.0)

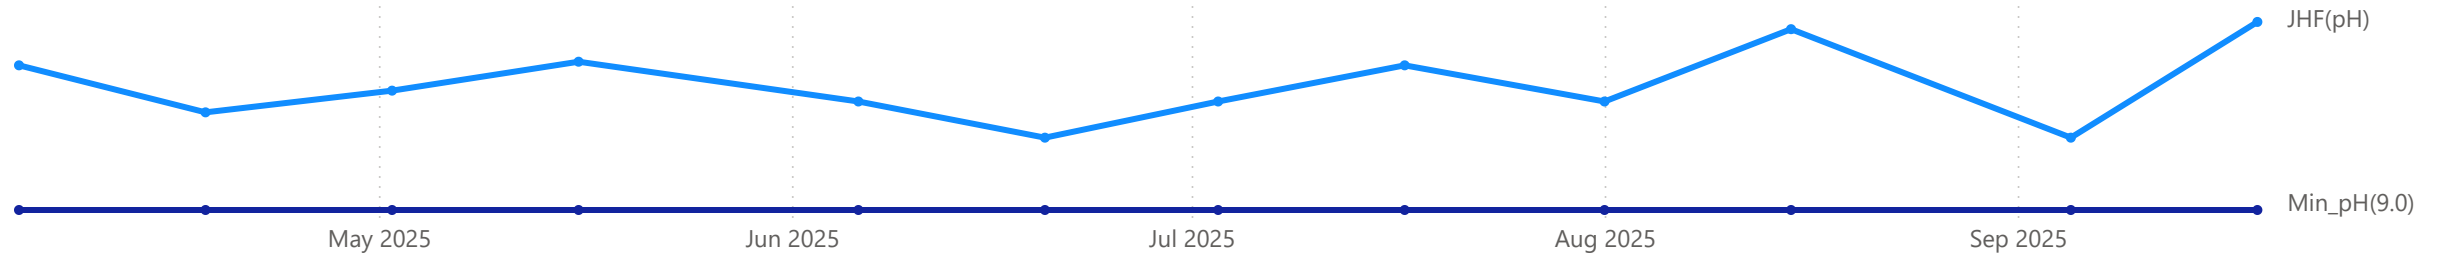

Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

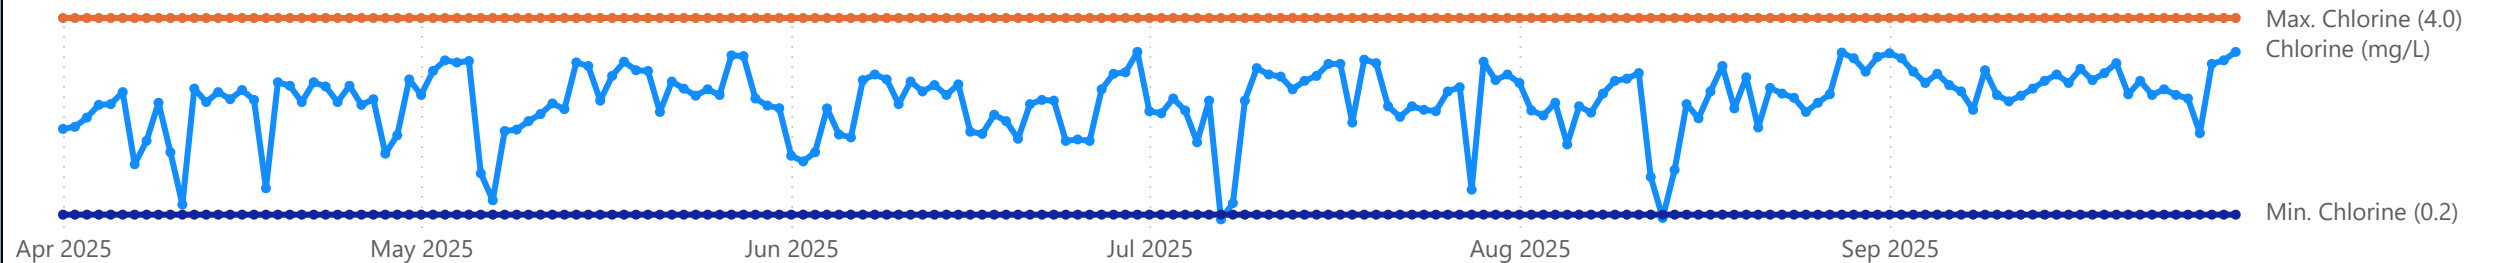




Executive Dashboard




Turbidity (OBC1 Conventional)

● CFE (Max) ● Max Turbidity (.34)

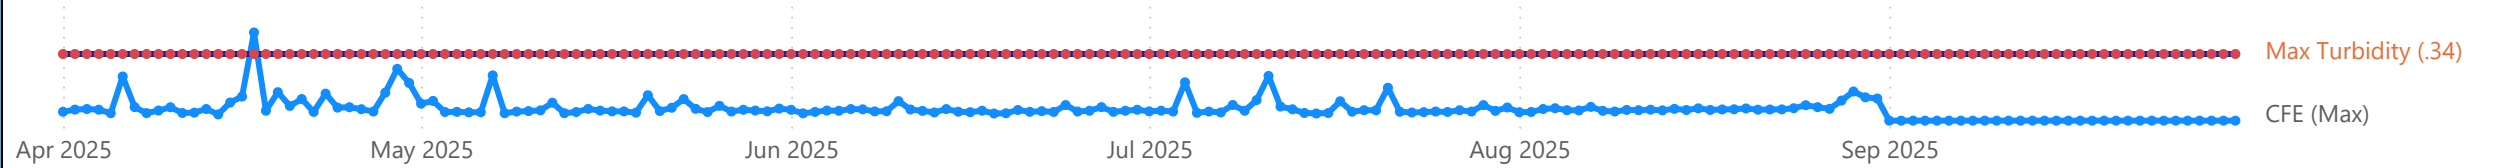


Turbidity (OBC2 Membrane)

● CFE (Max) ● Max_Turbidity (.34)

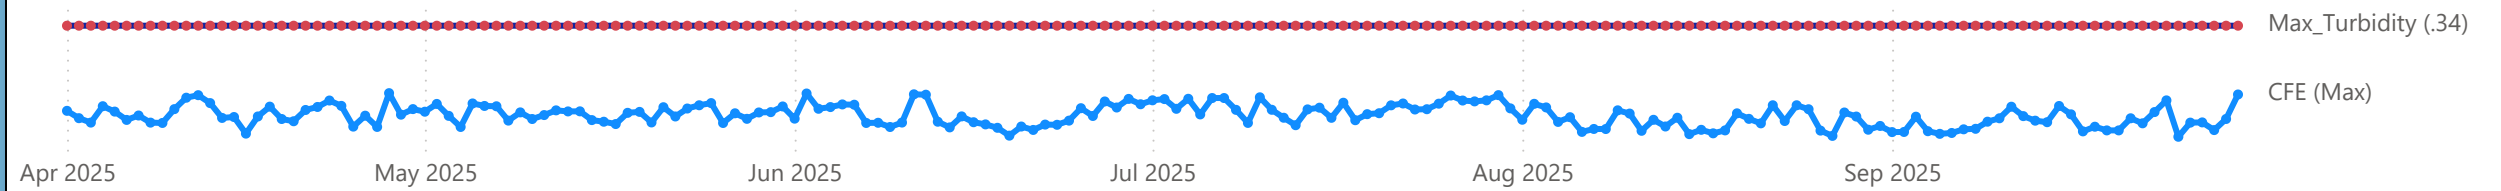

pH

● OBC(pH) ● Min_pH(9.0)

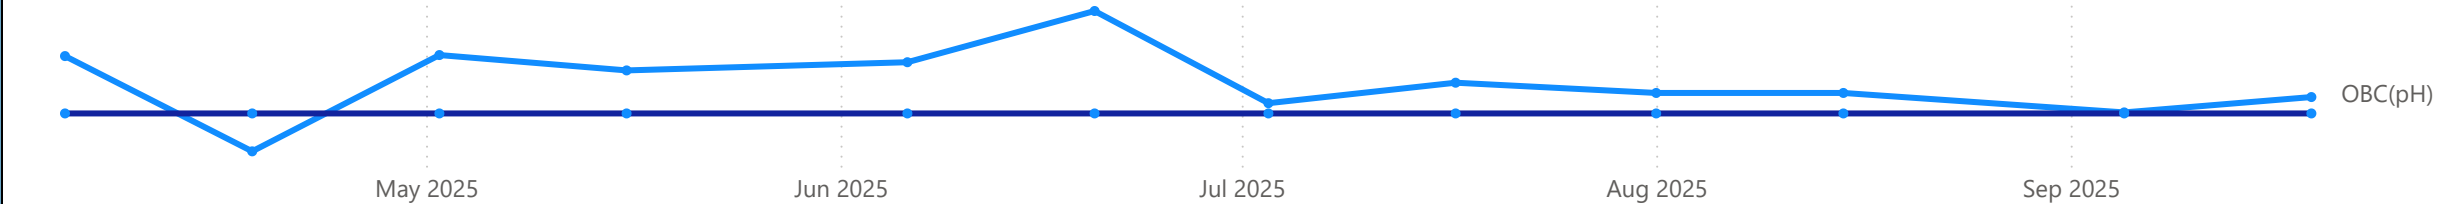




Executive Dashboard



OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

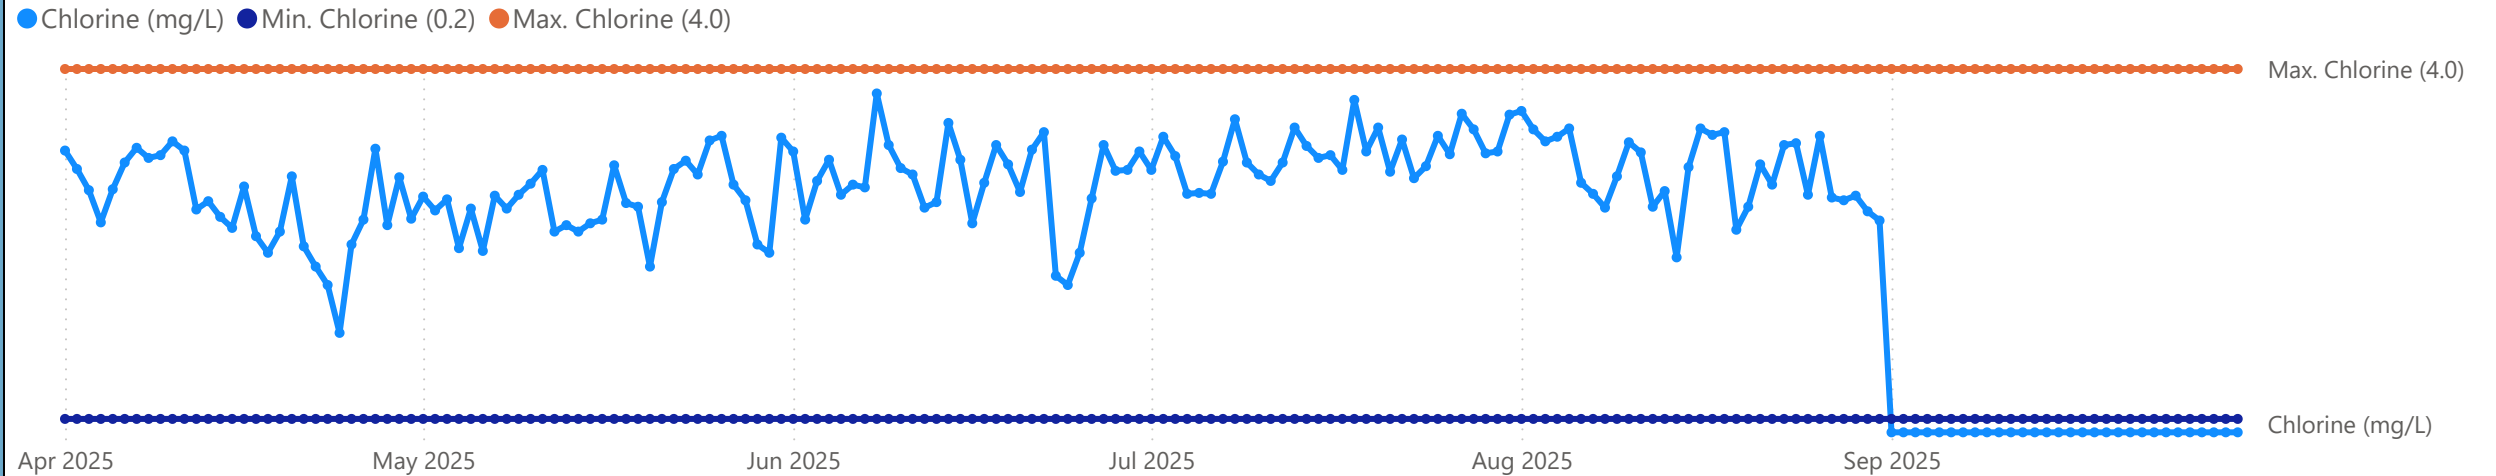

OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

