




Executive Dashboard



Data as of 10/31/2025

Daily Water Production

● J.H. Fewell (MG) ● O.B. Curtis Conv (MG) ● Total (MG) ● O.B. Curtis Mem (MG)

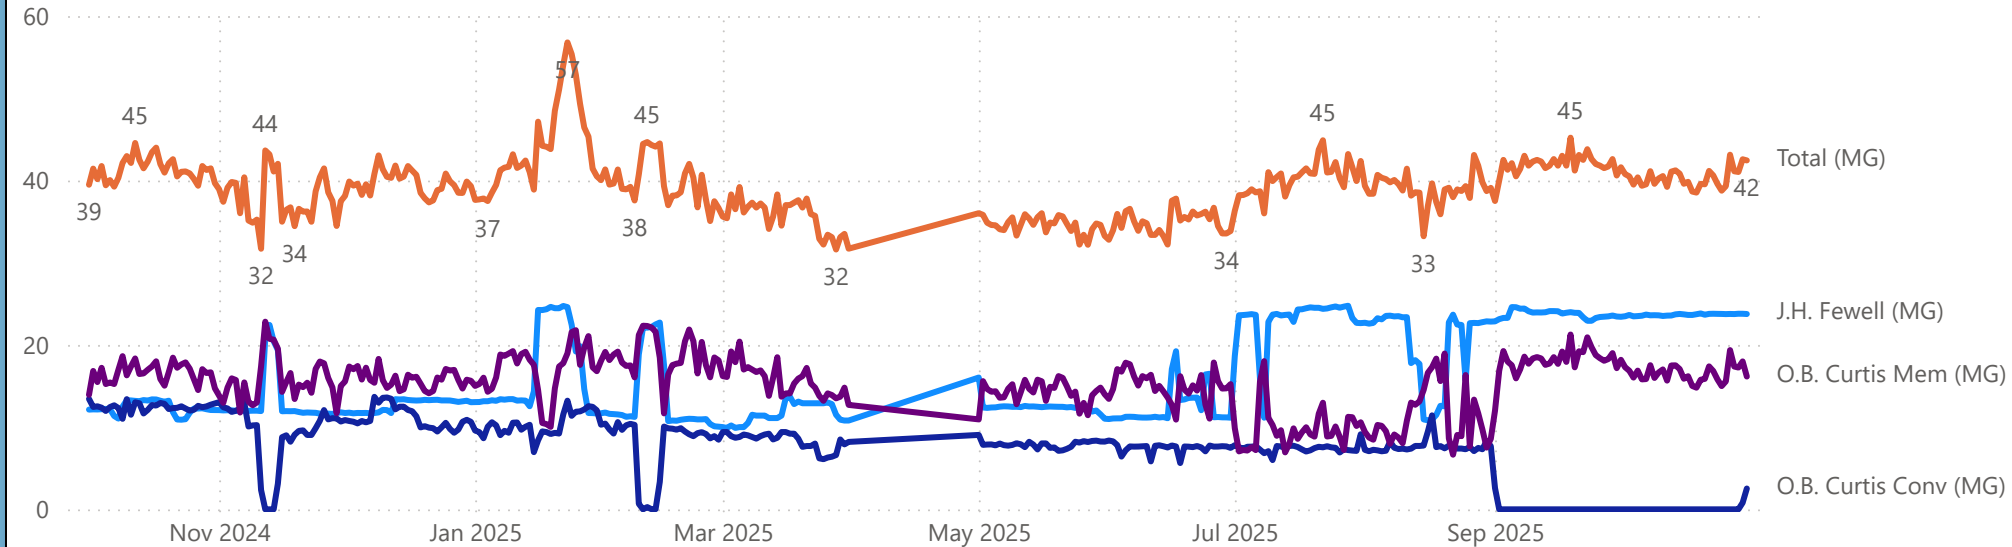

Water Production MG/Day (YTD)

Total Production (Min)
30.19

Total Production (Avg)
38.43

O.B. Curtis Membrane (Avg)
15.05


O.B. Curtis Conventional (Avg)
6.43

J.H. Fewell (Avg)
16.95

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2025	10	October	23.66	0.11	16.58
2025	9	September	23.73	0.09	18.13
2025	8	August	20.04	7.67	11.27
2025	7	July	23.07	7.43	9.74
2025	6	June	12.40	7.49	15.02
2025	5	May	12.46	7.90	14.23

Plant	Average Production Trend (MG/Day)						
	October 2025	October 2024	25'-24' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	23.66	12.35	91.54%	19.26	22.47	16.95	10-20
O.B. Curtis Conventional	0.11	12.44	-99.14%	5.11	2.65	6.43	10-20
O.B. Curtis Membrane	16.58	16.56	0.10%	14.15	15.29	15.05	23
Total	40.35	41.36	-2.44%	38.52	40.41	38.43	43-53

Avg Production Share by WTP (Rolling 6 months)

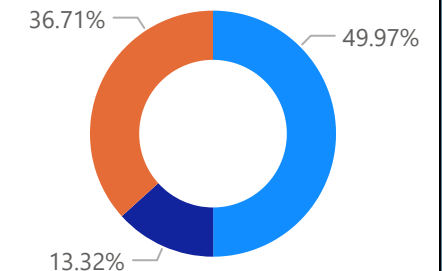

● JHF ● OBC CONV ● OBC MEM




Executive Dashboard




Turbidity (JHF)

● Filter (Max) ● Max Value (.34)

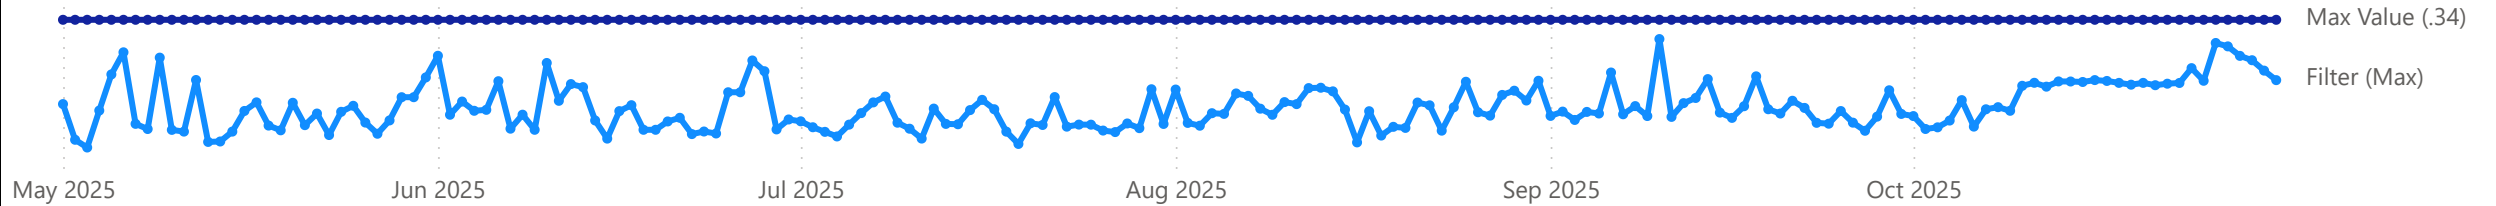


pH (JHF)

● JHF(pH) ● Min_pH(9.0)

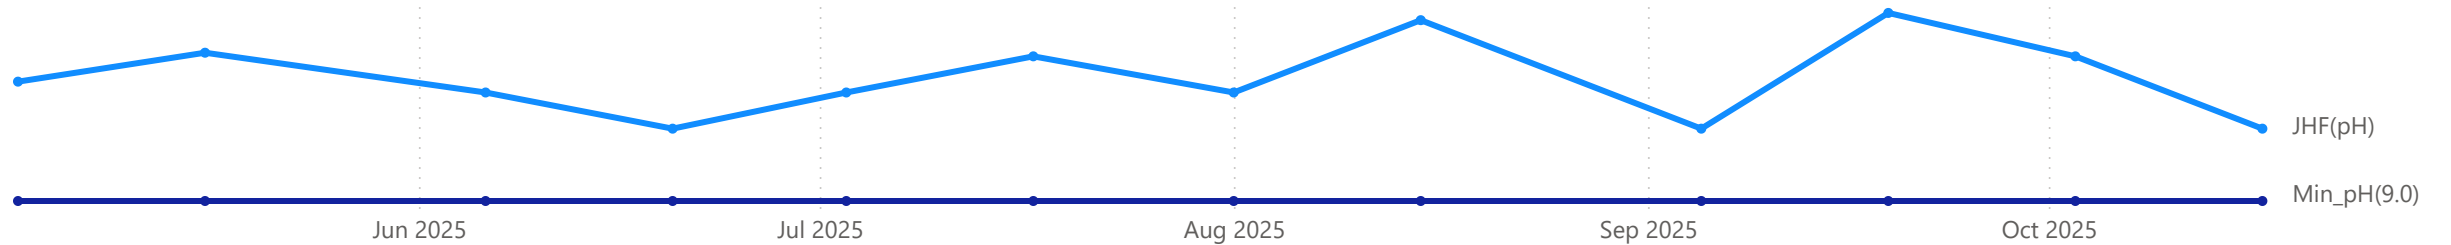

Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

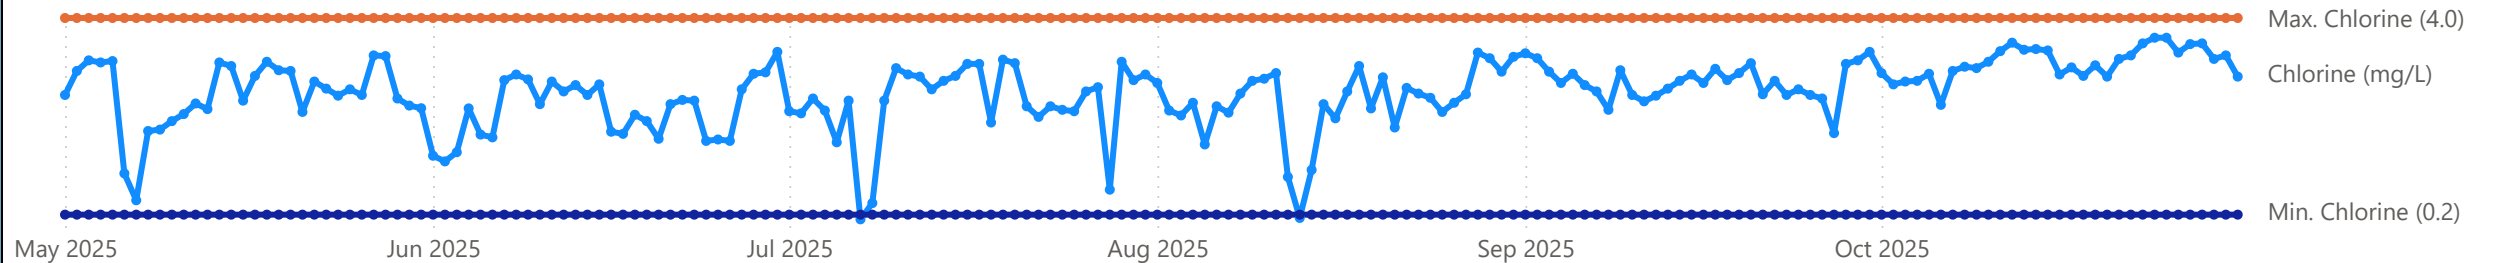




Executive Dashboard




Turbidity (OBC1 Conventional)

● CFE (Max) ● Max Turbidity (.34)

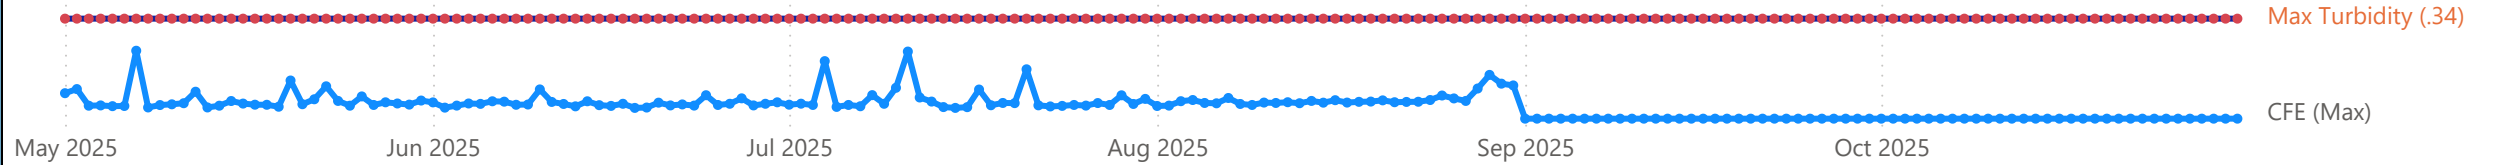


Turbidity (OBC2 Membrane)

● CFE (Max) ● Max_Turbidity (.34)

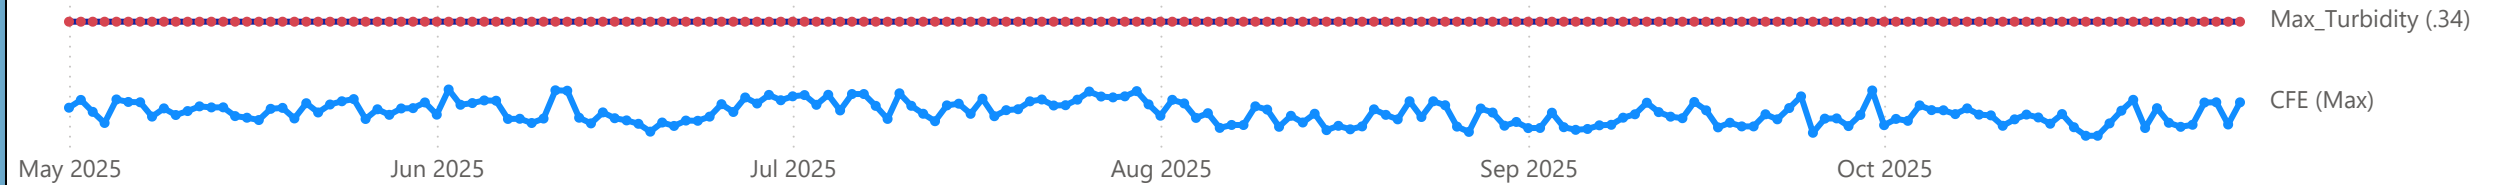

pH

● OBC(pH) ● Min_pH(9.0)

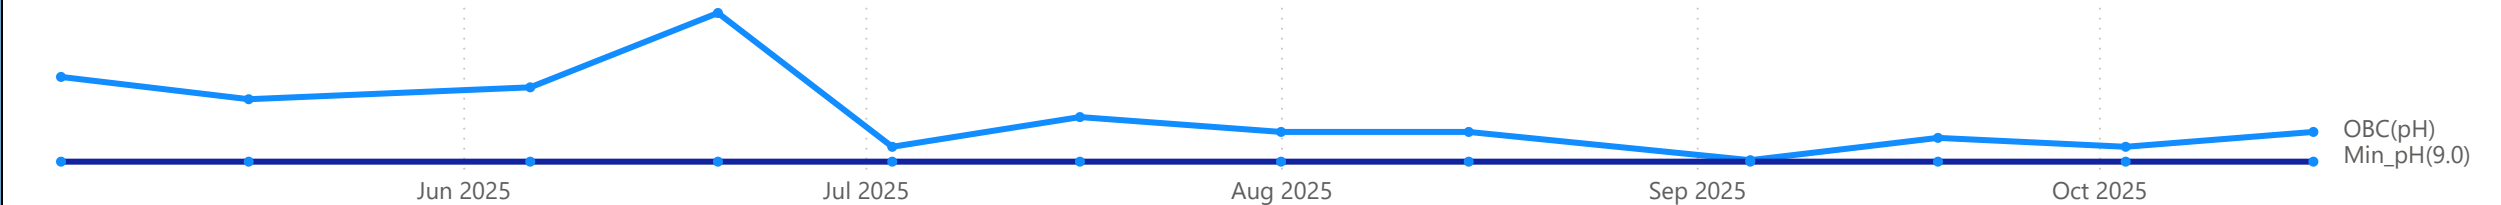




Executive Dashboard



OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

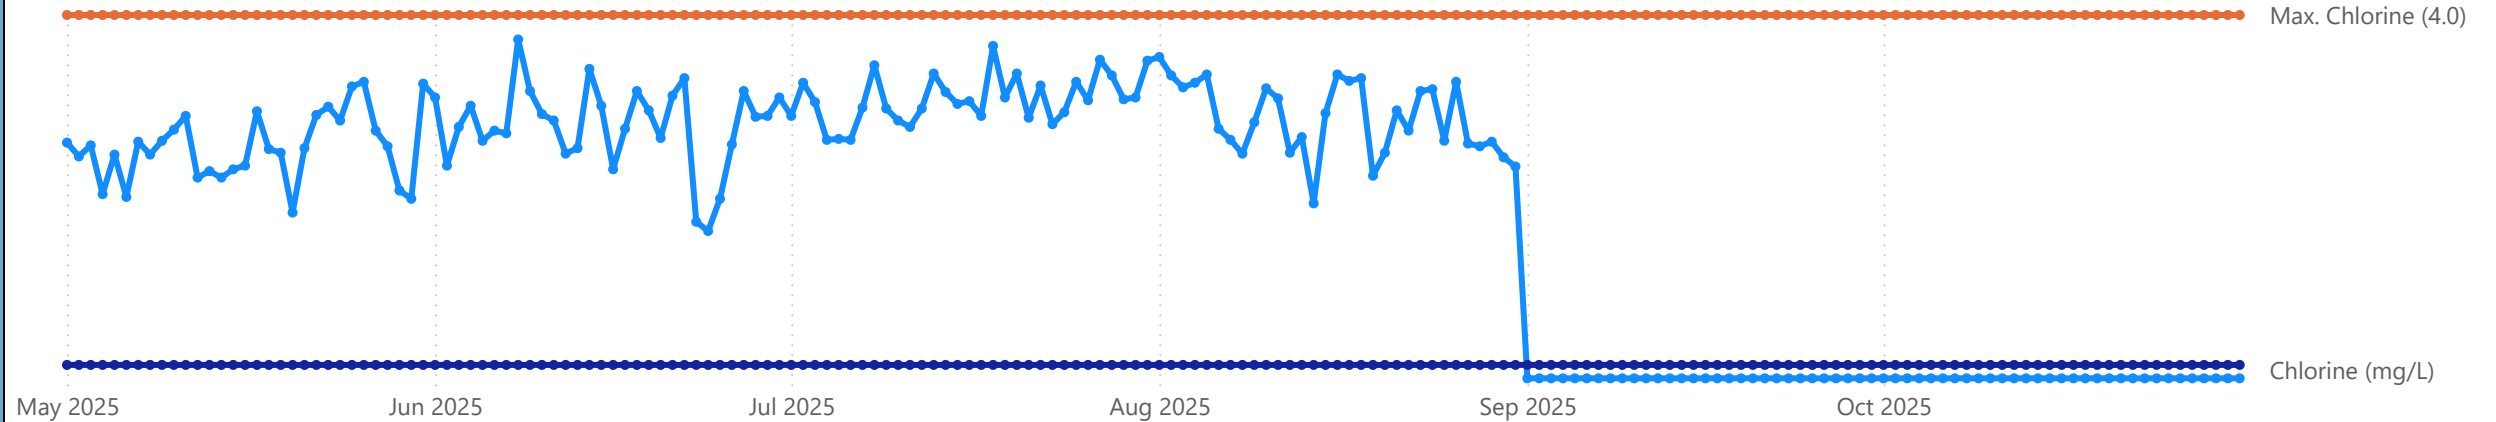

OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

