




Executive Dashboard



Data as of 01/31/2026

Daily Water Production

● J.H. Fewell (MG) ● O.B. Curtis Conv (MG) ● Total (MG) ● O.B. Curtis Mem (MG)

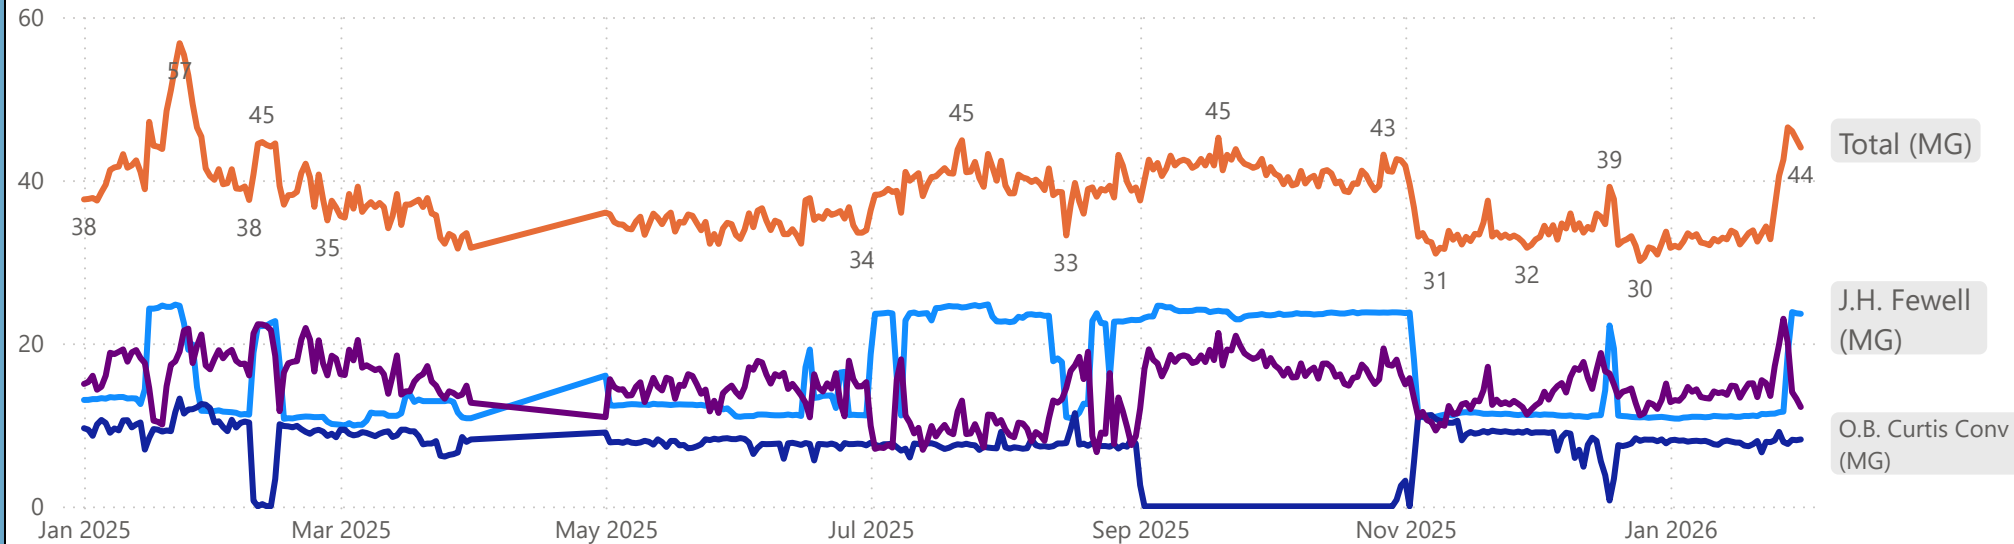

Water Production MG/Day (YTD)

Total Production (Min)
30.08

Total Production (Avg)
35.12

O.B. Curtis Membrane (Avg)
14.68


O.B. Curtis Conventional (Avg)
7.90

J.H. Fewell (Avg)
12.54

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2026	1	January	12.54	7.90	14.68
2025	12	December	11.79	7.37	14.44
2025	11	November	12.30	8.98	12.33
2025	10	October	23.66	0.11	16.58
2025	9	September	23.73	0.09	18.13
2025	8	August	20.04	7.67	11.27

Plant	Average Production Trend (MG/Day)						
	January 2026	January 2025	25'-26' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	12.54	16.69	-24.88%	17.31	12.21	12.54	10-20
O.B. Curtis Conventional	7.90	10.28	18.56%	5.35	8.08	7.90	10-20
O.B. Curtis Membrane	14.68	16.98	-13.56%	14.59	13.83	14.68	23
Total	35.13	43.96	-20.10%	37.25	34.12	35.12	43-53

Avg Production Share by WTP (Rolling 6 months)

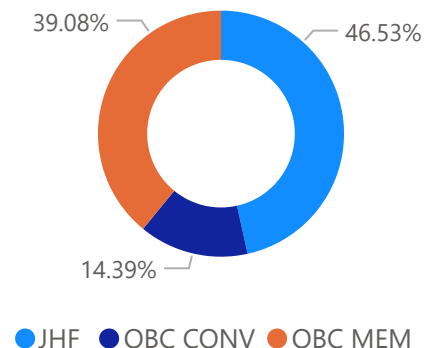




Executive Dashboard




Turbidity (JHF)

● Filter (Max) ● Max Value (.34)

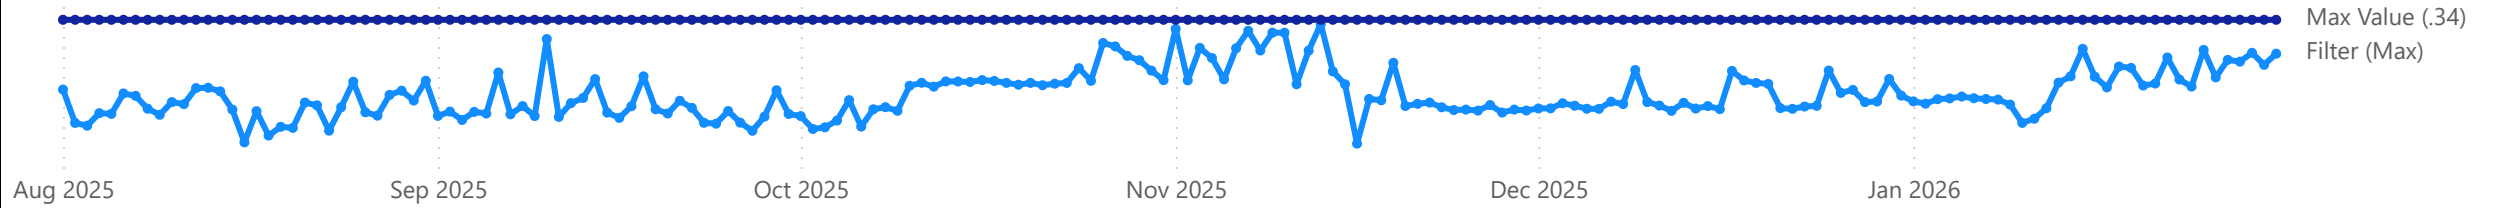


pH (JHF)

● JHF(pH) ● Min_pH(9.0)

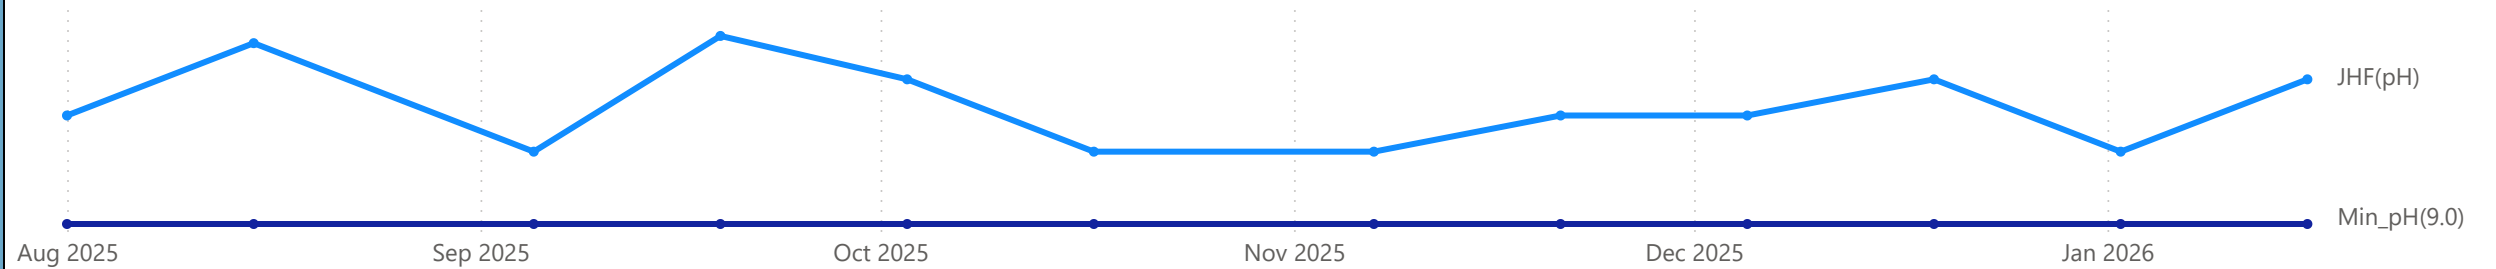

Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

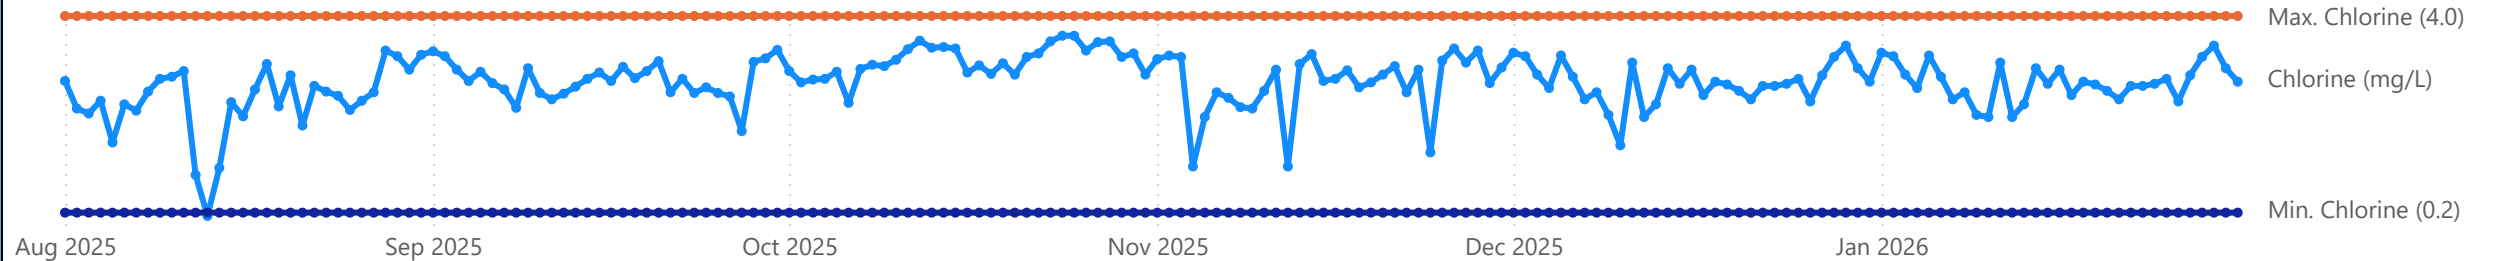





Executive Dashboard




Turbidity (OBC1 Conventional)

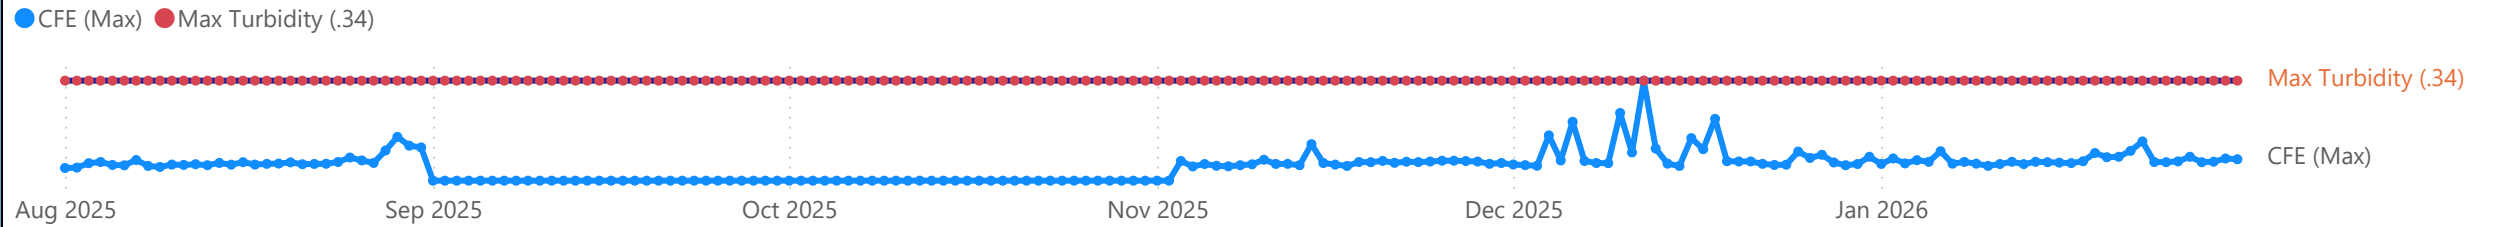

Turbidity (OBC2 Membrane)

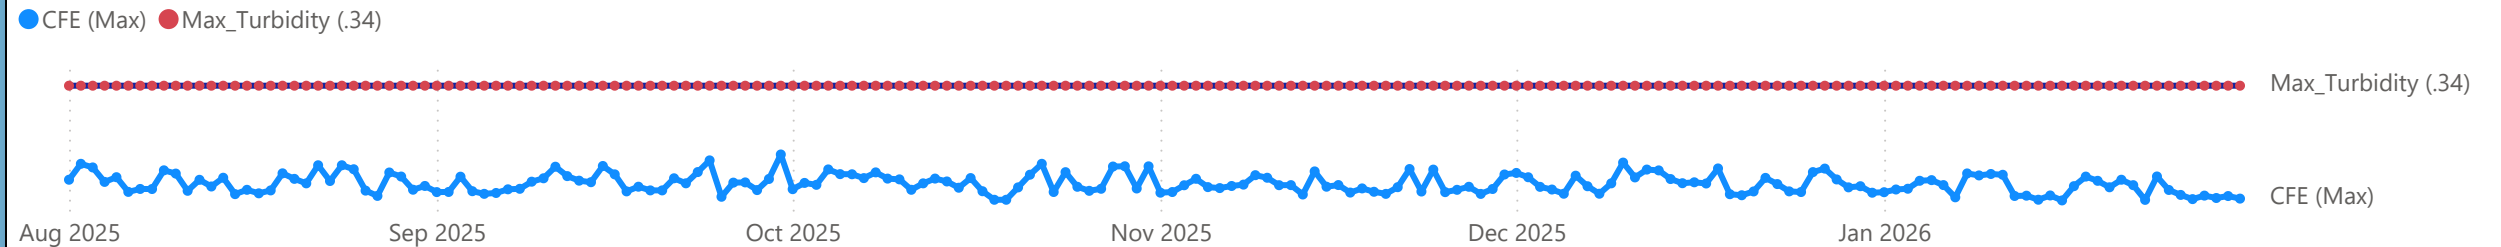

pH

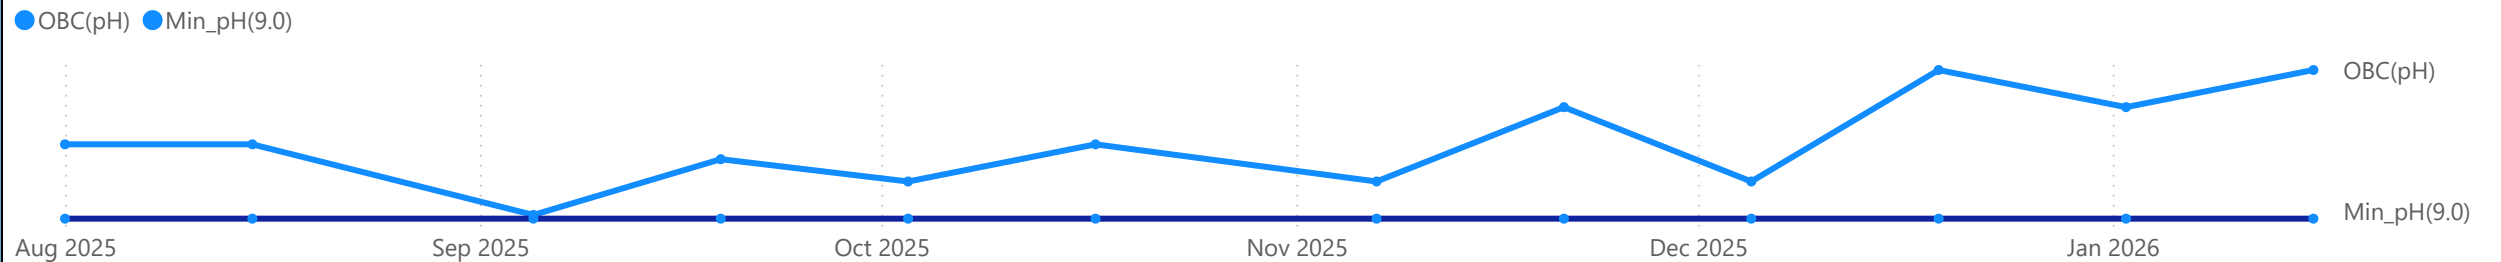




Executive Dashboard



OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

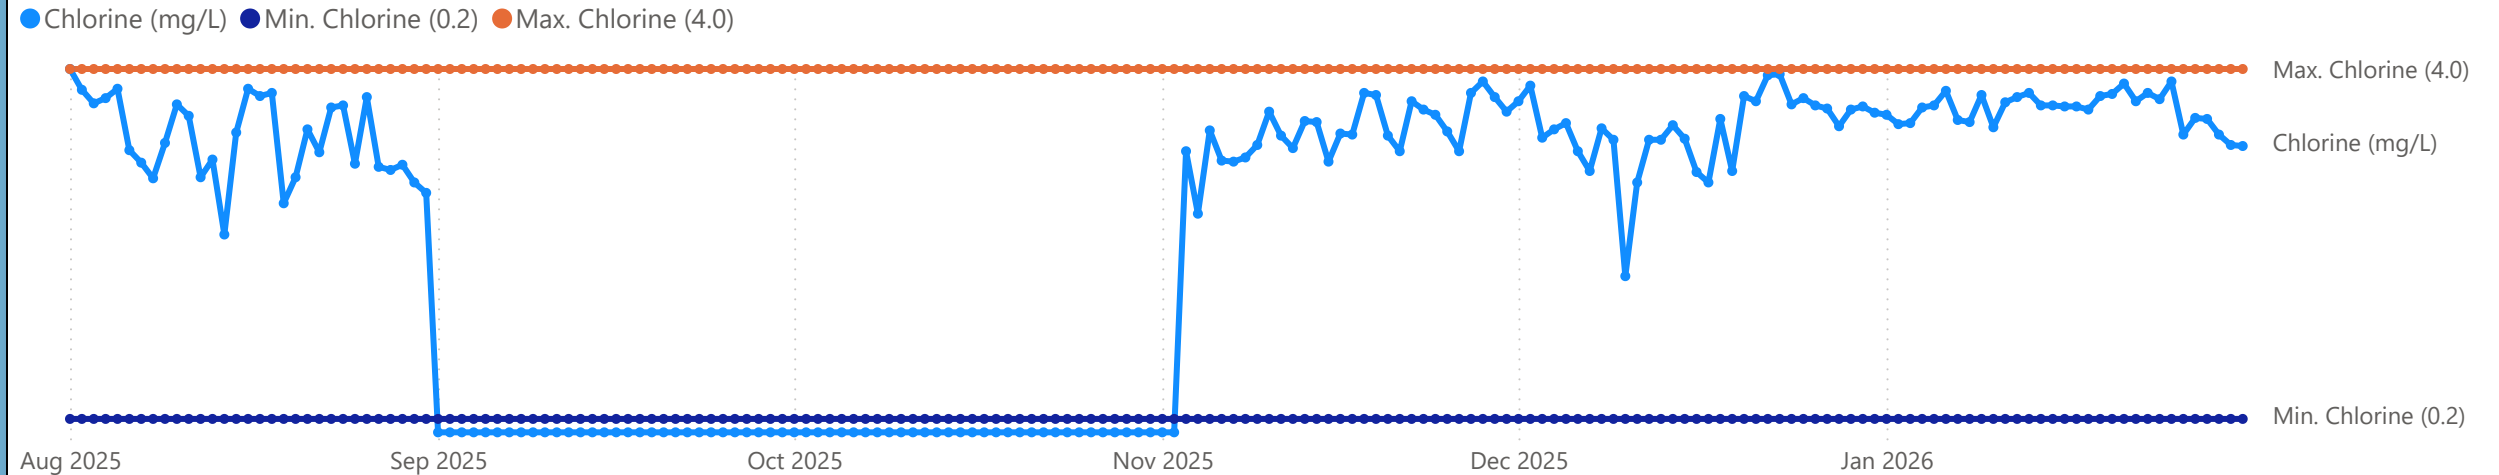

OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

