




# Executive Dashboard



Data as of 03/31/2026

## Daily Water Production

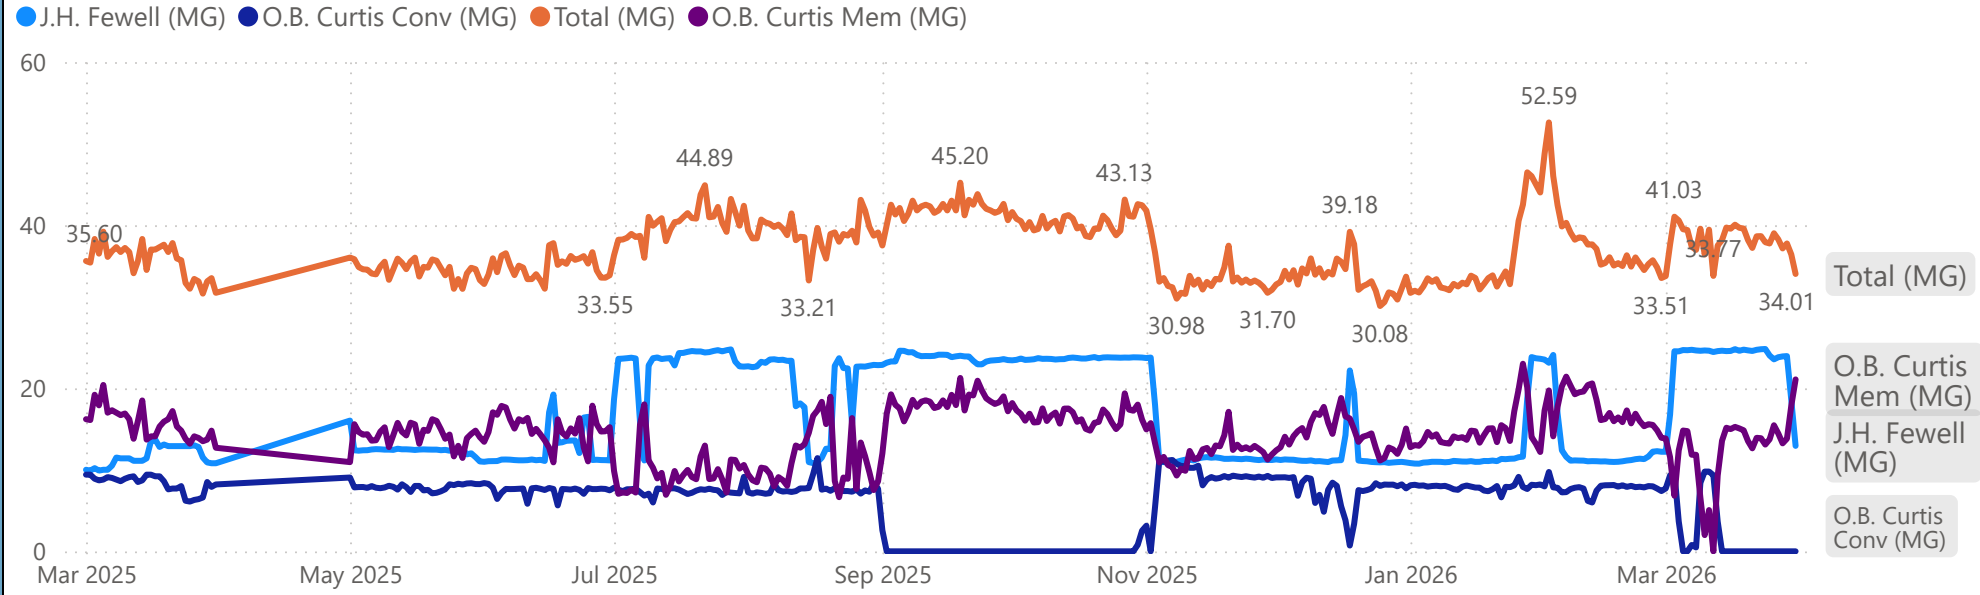


## Water Production MG/Day (YTD)

|                                |       |
|--------------------------------|-------|
| Total Production (Min)         | 30.08 |
| Total Production (Avg)         | 37.04 |
| O.B. Curtis Membrane (Avg)     | 14.76 |
| O.B. Curtis Conventional (Avg) | 5.95  |
| J.H. Fewell (Avg)              | 16.34 |

| Year | Month | Title    | J.H. Fewell | O.B. Curtis - Conventional | O.B. Curtis - Membrane |
|------|-------|----------|-------------|----------------------------|------------------------|
| 2026 | 3     | March    | 23.28       | 2.34                       | 12.46                  |
| 2026 | 2     | February | 12.85       | 7.77                       | 17.40                  |
| 2026 | 1     | January  | 12.54       | 7.90                       | 14.68                  |
| 2025 | 12    | December | 11.79       | 7.37                       | 14.44                  |
| 2025 | 11    | November | 12.30       | 8.98                       | 12.33                  |
| 2025 | 10    | October  | 23.66       | 0.11                       | 16.58                  |

| Plant                    | Average Production Trend (MG/Day) |              |                    |               |               |              |              |
|--------------------------|-----------------------------------|--------------|--------------------|---------------|---------------|--------------|--------------|
|                          | March 2026                        | March 2025   | 25'-26' YOY Change | Rolling 6-mos | Rolling 3-mos | YTD          | Target       |
| J.H. Fewell              | 23.28                             | 11.65        | 99.83%             | 16.10         | 16.34         | 16.34        | 10-20        |
| O.B. Curtis Conventional | 2.34                              | 8.33         | -71.91%            | 5.73          | 5.95          | 5.95         | 10-20        |
| O.B. Curtis Membrane     | 12.46                             | 15.66        | -20.43%            | 14.60         | 14.76         | 14.76        | 23           |
| <b>Total</b>             | <b>38.08</b>                      | <b>35.64</b> | <b>6.85%</b>       | <b>36.43</b>  | <b>37.04</b>  | <b>37.04</b> | <b>43-53</b> |

## Avg Production Share by WTP (Rolling 6 months)

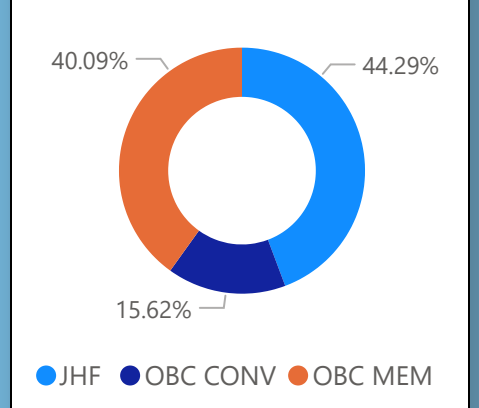




# Executive Dashboard




## Turbidity (JHF)

● Filter (Max) ● Max Value (.34)

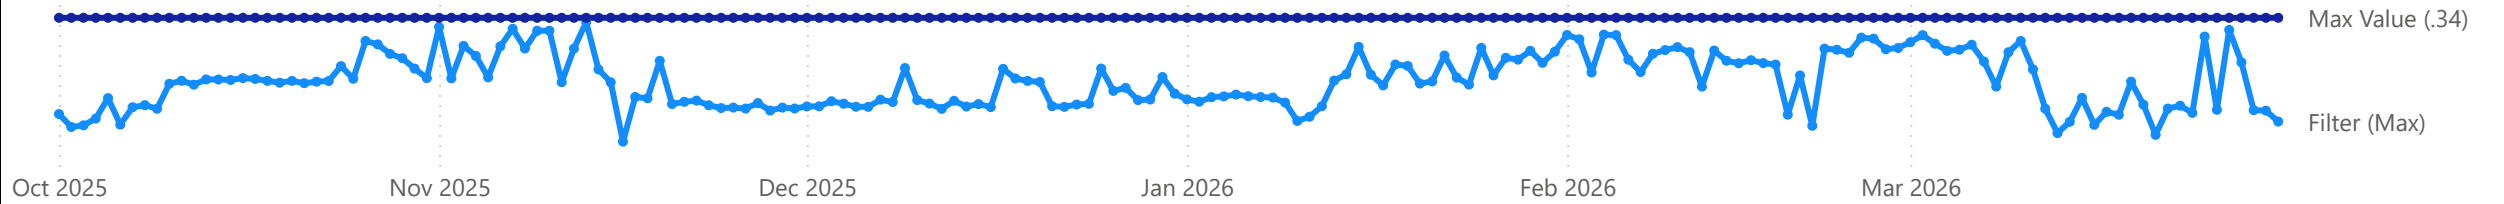


## pH (JHF)

● JHF(pH) ● Min\_pH(9.0)

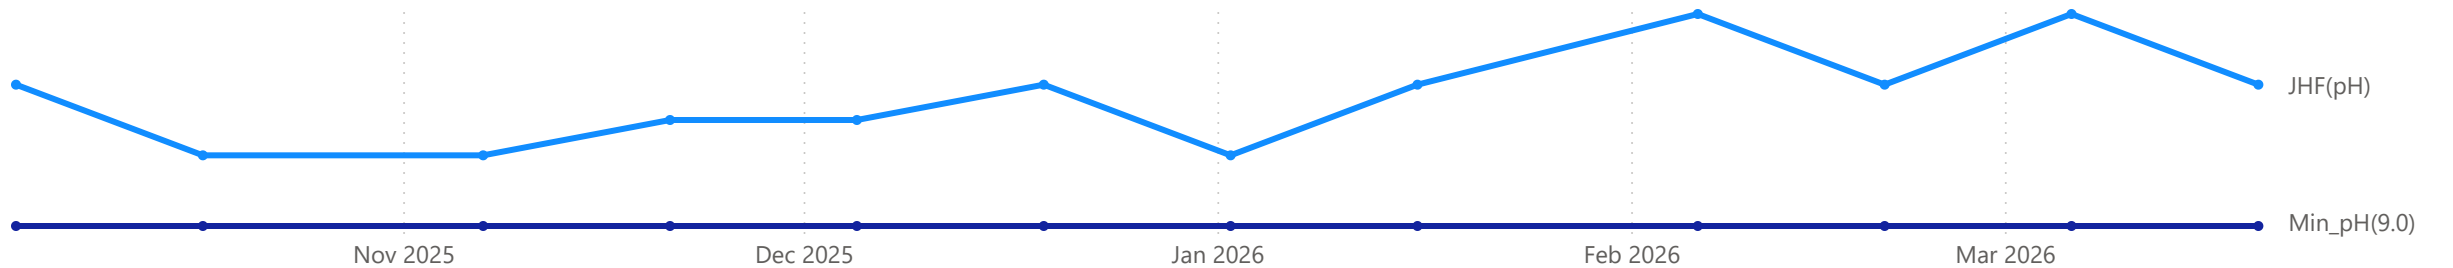

## Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

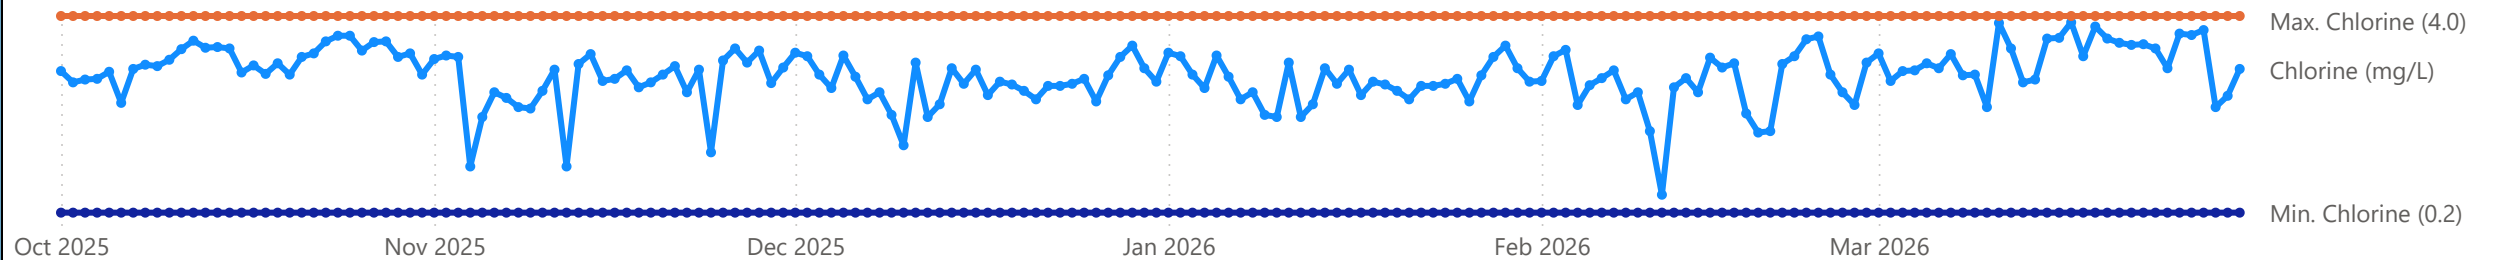





# Executive Dashboard




## Turbidity (OBC1 Conventional)

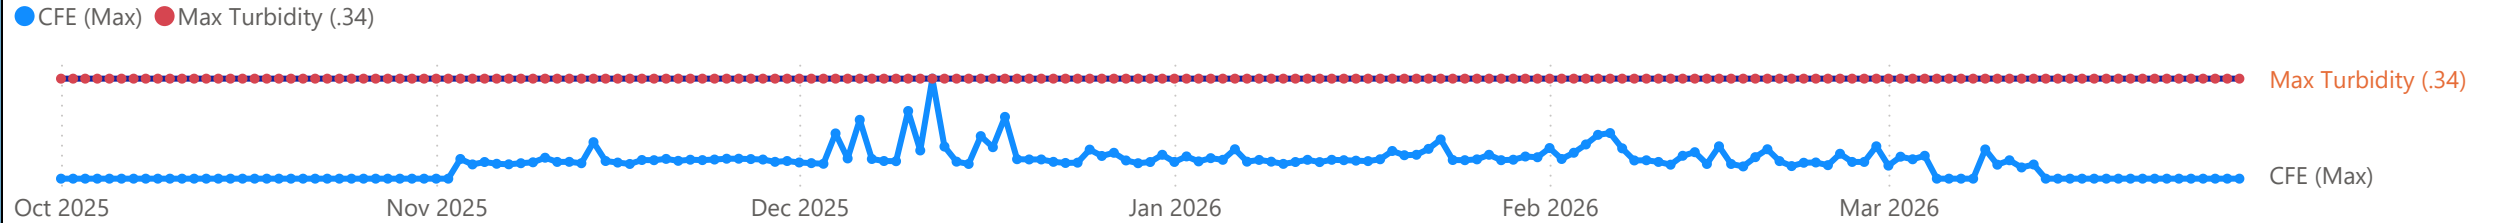

## Turbidity (OBC2 Membrane)

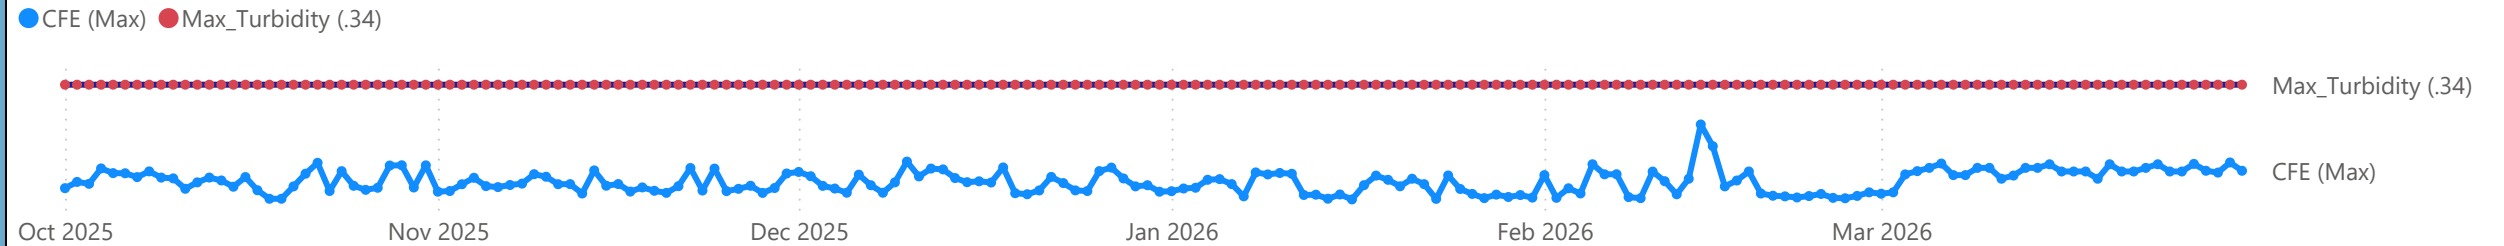

## pH

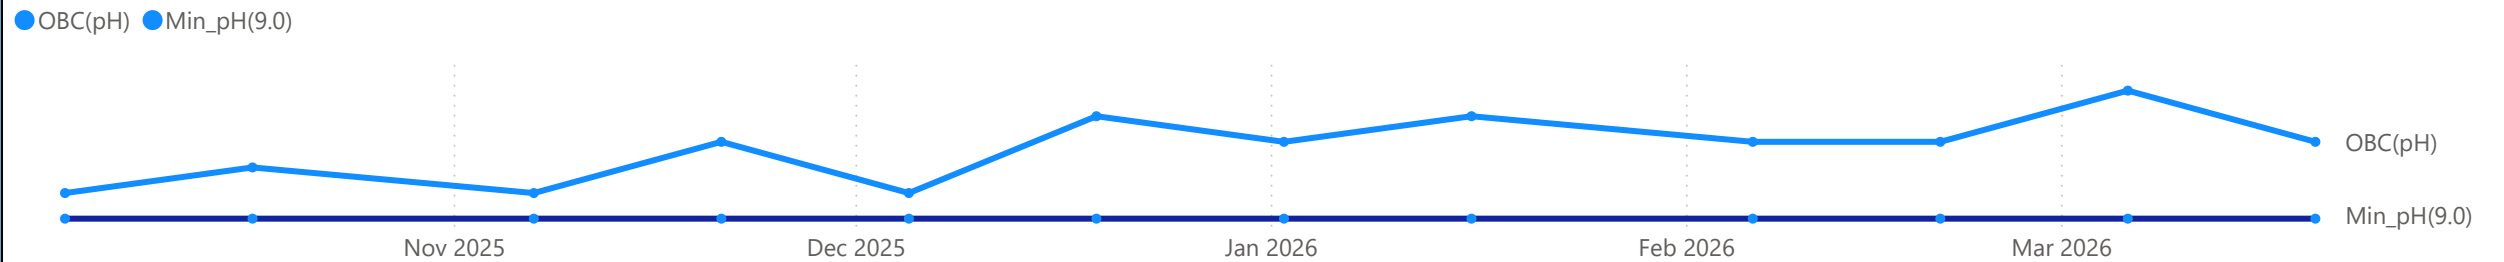




# Executive Dashboard



## OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

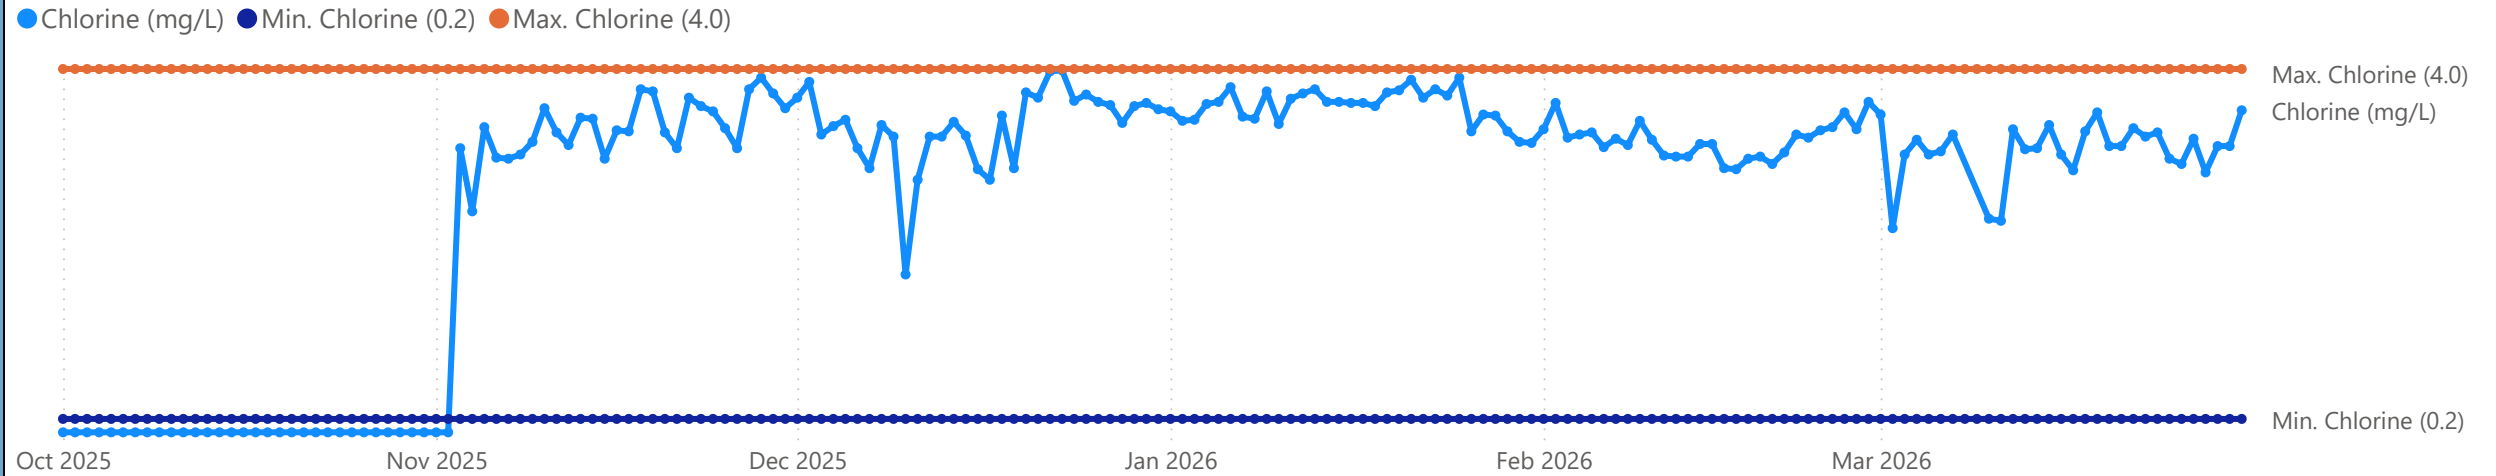

## OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

