




Executive Dashboard



Data as of 04/30/2026

Daily Water Production

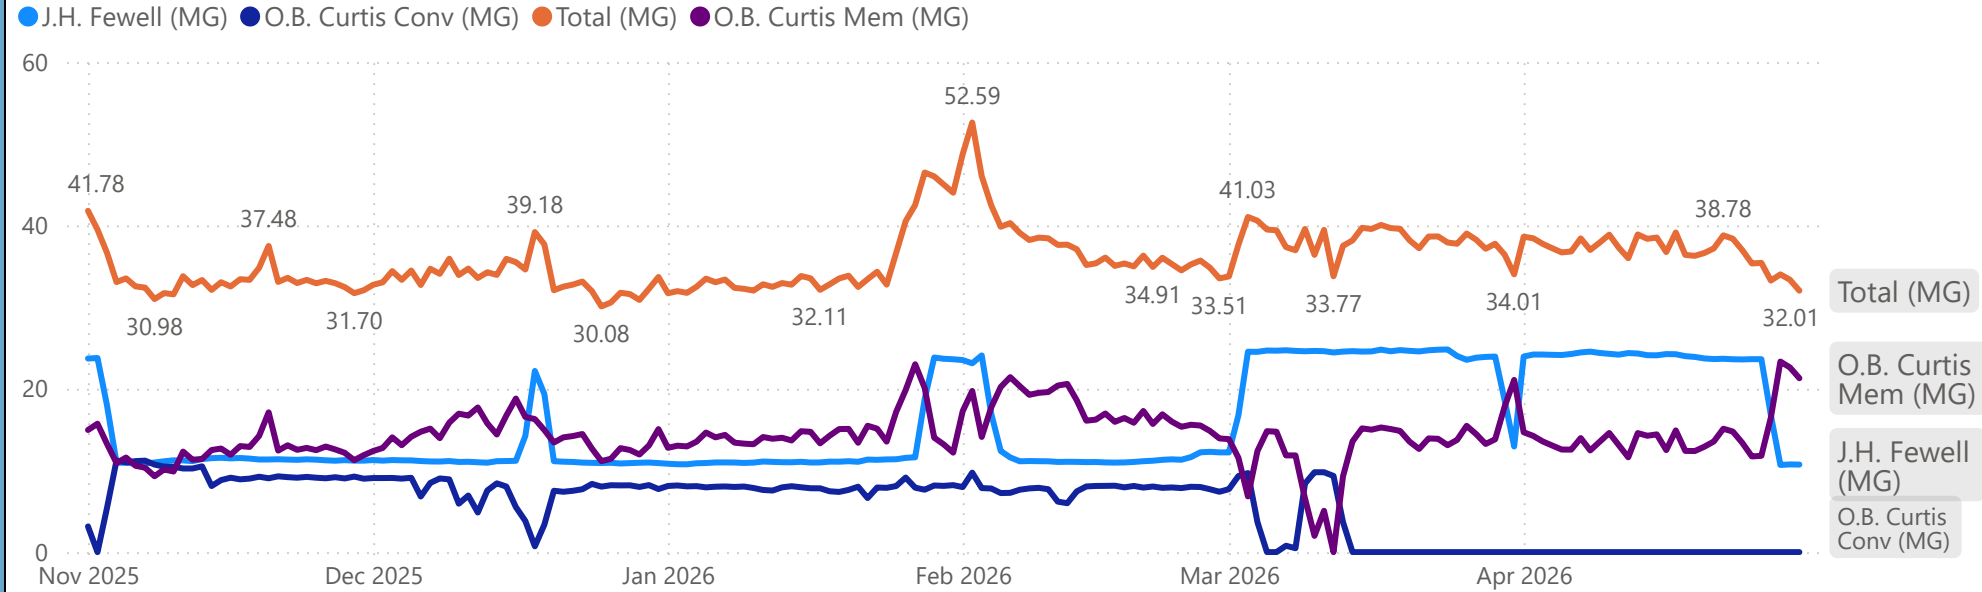


Water Production MG/Day (YTD)

Total Production (Min)	30.08
Total Production (Avg)	37.00
O.B. Curtis Membrane (Avg)	14.67
O.B. Curtis Conventional (Avg)	4.46
J.H. Fewell (Avg)	17.87

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2026	4	April	22.48	0.00	14.40
2026	3	March	23.28	2.34	12.46
2026	2	February	12.85	7.77	17.40
2026	1	January	12.54	7.90	14.68
2025	12	December	11.79	7.37	14.44
2025	11	November	12.30	8.98	12.33

Plant	Average Production Trend (MG/Day)						
	Apr 2026	Apr 2025	25'-26' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	22.48	11.87	89.39%	15.86	19.73	17.87	10-20
O.B. Curtis Conventional	0.00	7.30	-100.00%	5.72	3.26	4.46	10-20
O.B. Curtis Membrane	14.40	14.64	-1.64%	14.24	14.67	14.67	23
Total	36.88	33.80	9.11%	35.82	37.66	37.00	43-53

Avg Production Share by WTP (Rolling 6 months)

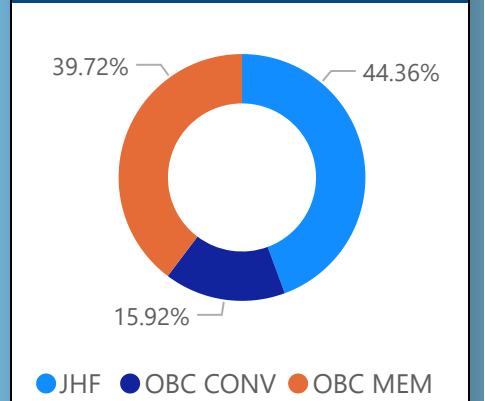




Executive Dashboard




Turbidity (JHF)

● Filter (Max) ● Max Value (.34)

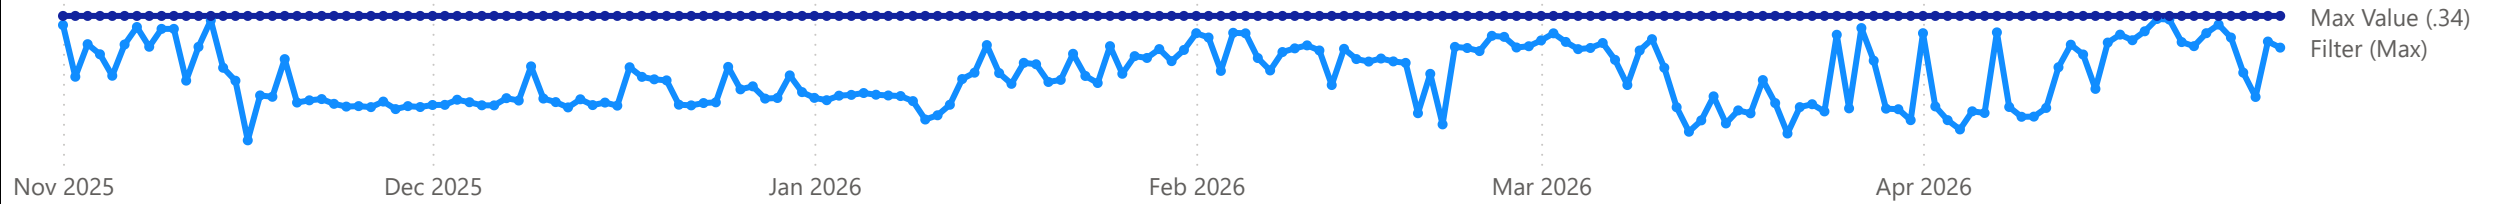


pH (JHF)

● JHF(pH) ● Min_pH(9.0)

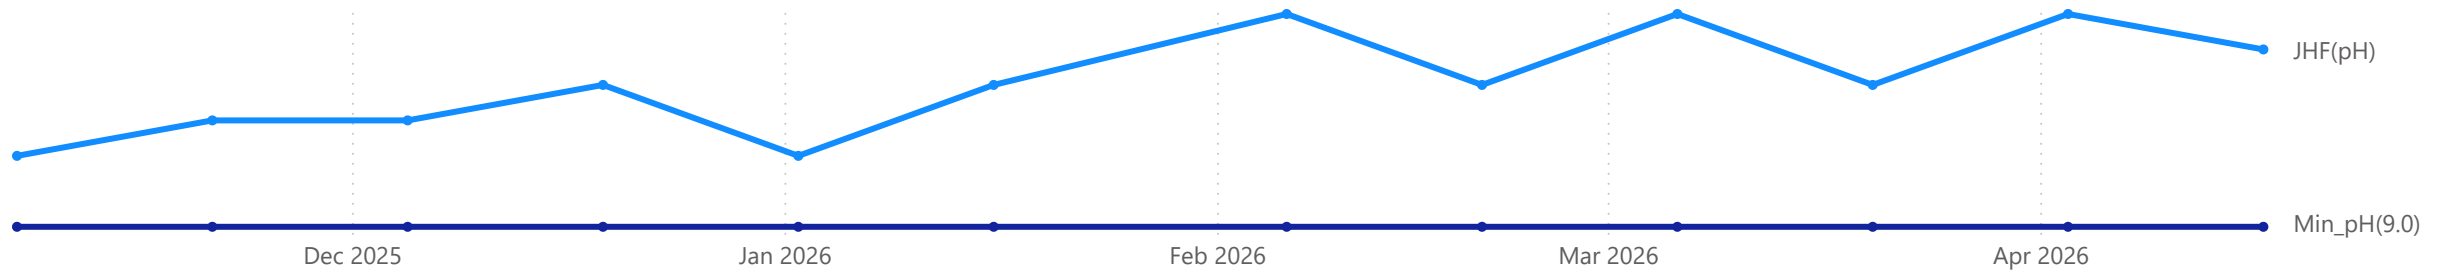

Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

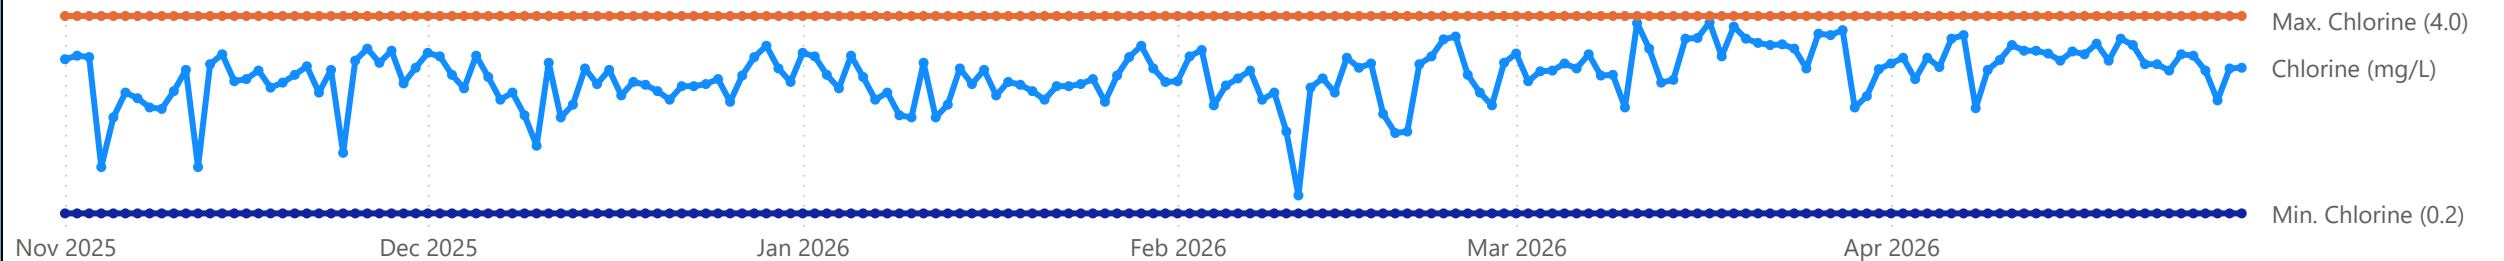





Executive Dashboard




Turbidity (OBC1 Conventional)

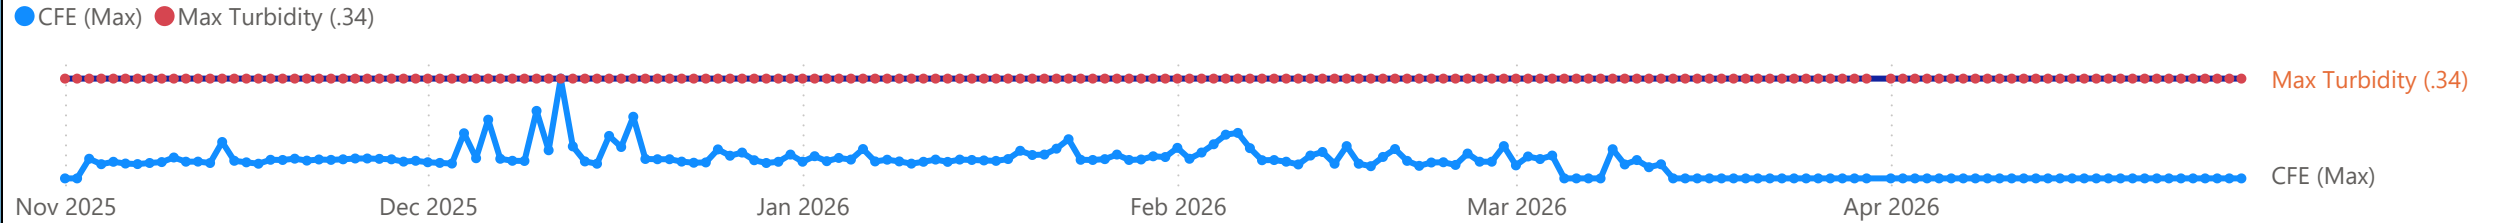

Turbidity (OBC2 Membrane)

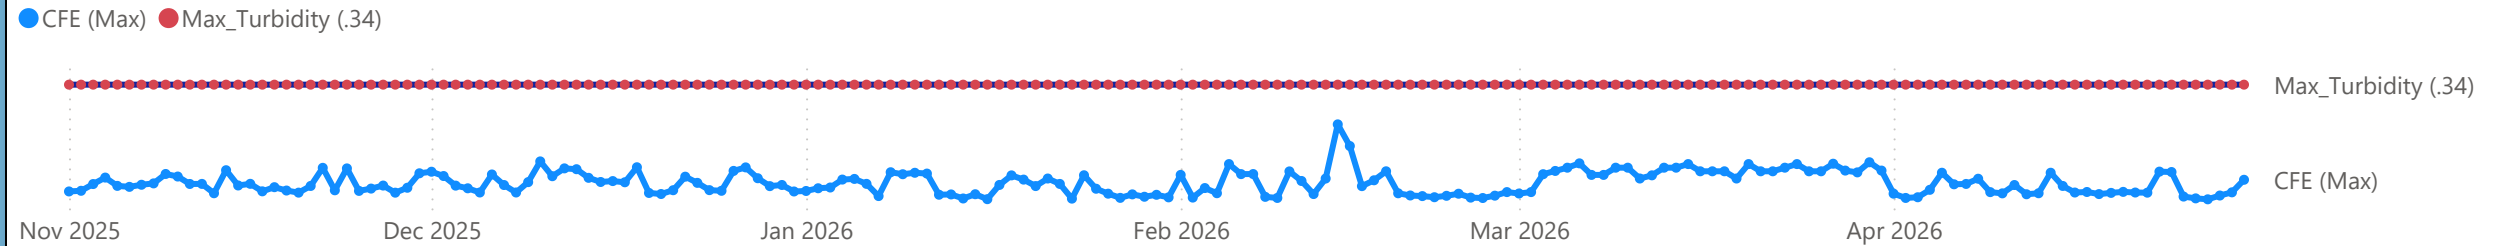

pH

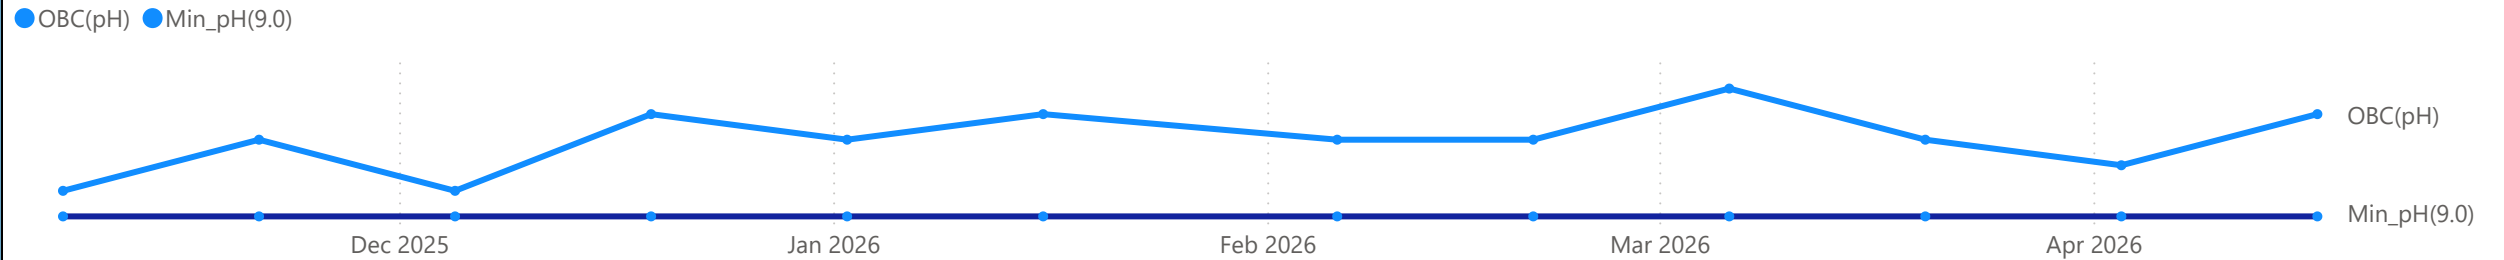




Executive Dashboard



OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

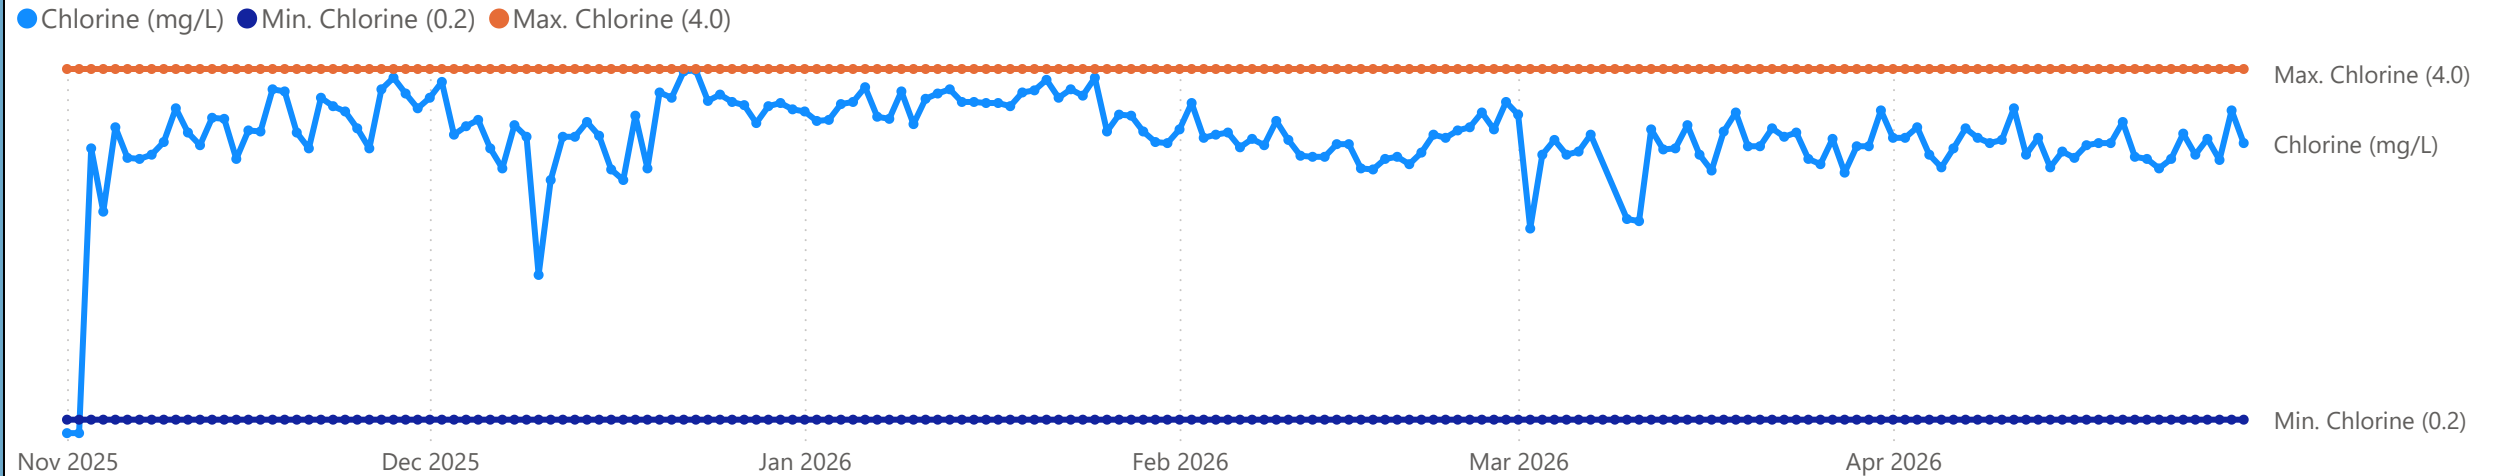

OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

