




# Executive Dashboard



Data as of 05/31/2026

## Daily Water Production

● J.H. Fewell (MG) ● O.B. Curtis Conv (MG) ● Total (MG) ● O.B. Curtis Mem (MG)

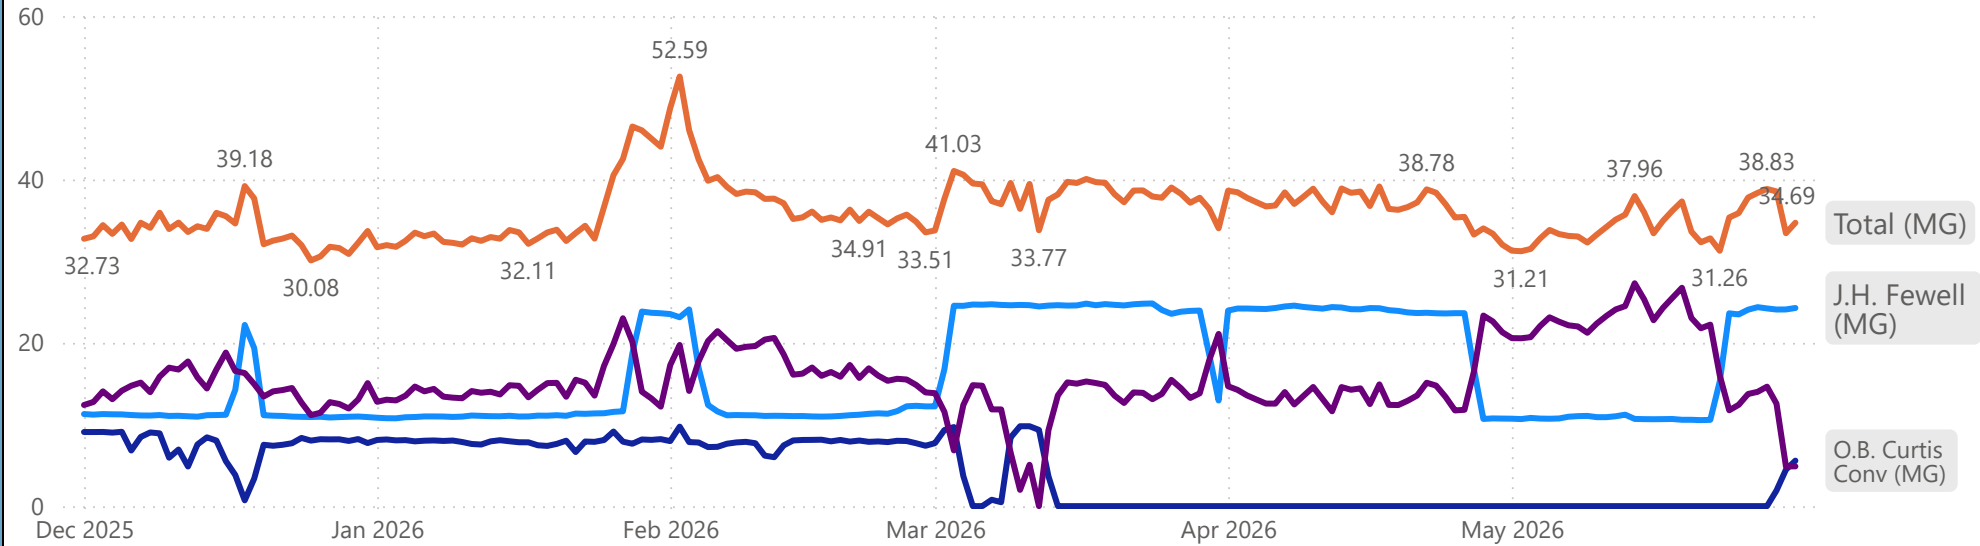

## Water Production MG/Day (YTD)

Total Production (Min)  
**30.08**

Total Production (Avg)  
**36.48**

O.B. Curtis Membrane (Avg)  
**15.72**


O.B. Curtis Conventional (Avg)  
**3.62**

J.H. Fewell (Avg)  
**17.14**

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2026	5	May	14.33	0.39	19.77
2026	4	April	22.48	0.00	14.40
2026	3	March	23.28	2.34	12.46
2026	2	February	12.85	7.77	17.40
2026	1	January	12.54	7.90	14.68
2025	12	December	11.79	7.37	14.44

Plant	Average Production Trend (MG/Day)						
	May 2026	May 2025	25'-26' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	14.33	12.46	15.01%	16.26	20.00	17.14	10-20
O.B. Curtis Conventional	0.39	7.90	-95.06%	4.23	0.92	3.62	10-20
O.B. Curtis Membrane	19.77	14.23	38.93%	15.52	15.56	15.72	23
<b>Total</b>	<b>34.48</b>	<b>34.59</b>	<b>-0.32%</b>	<b>36.01</b>	<b>36.47</b>	<b>36.48</b>	<b>43-53</b>

## Avg Production Share by WTP (Rolling 6 months)

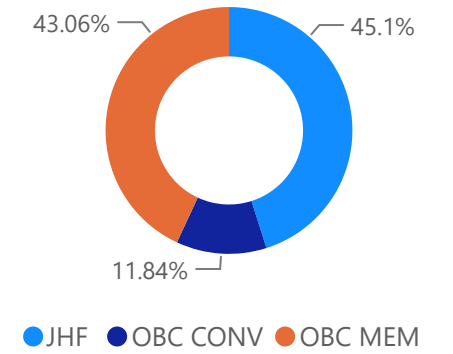




# Executive Dashboard




## Turbidity (JHF)

● Filter (Max) ● Max Value (.34)

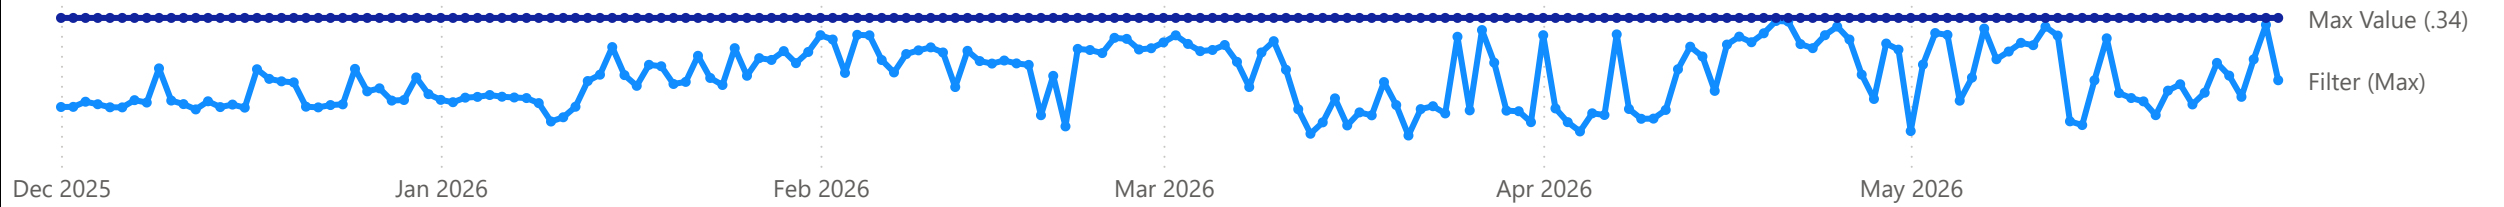


## pH (JHF)

● JHF(pH) ● Min\_pH(9.0)

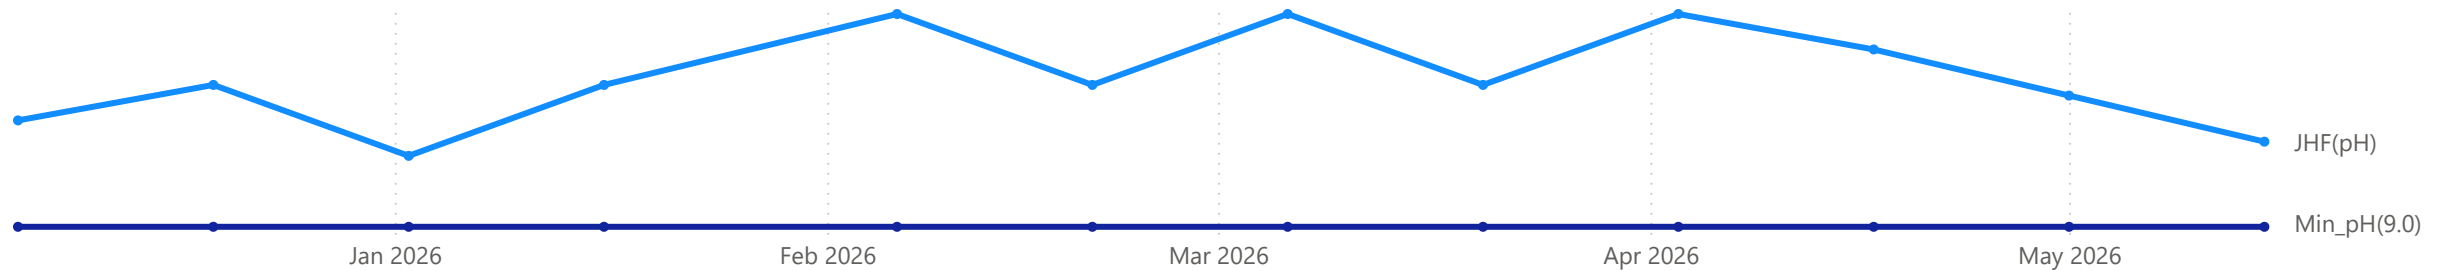

## Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

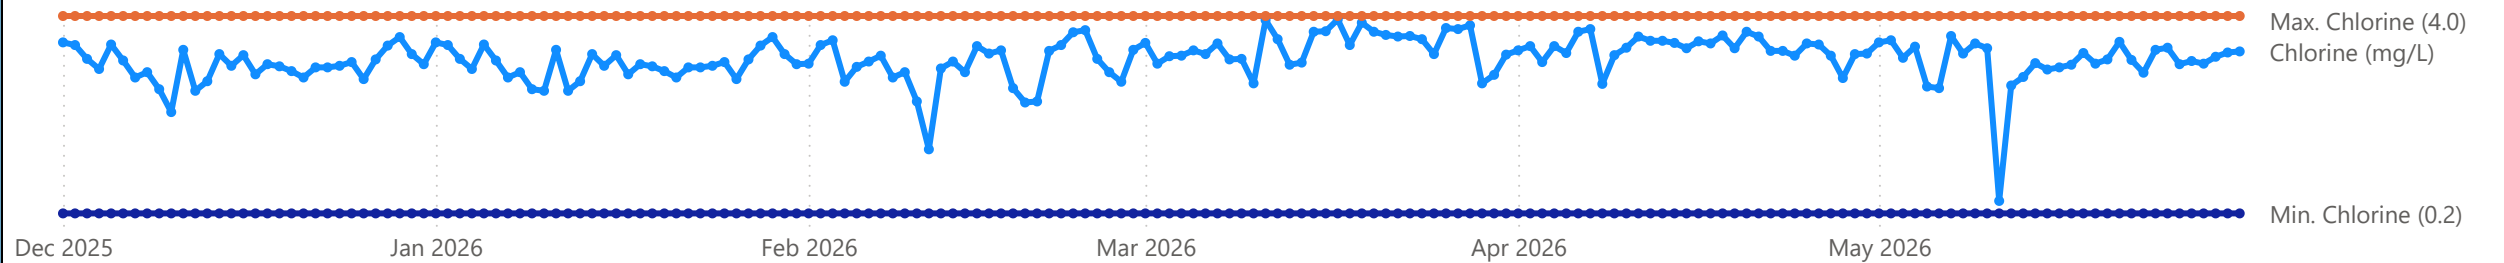





# Executive Dashboard




## Turbidity (OBC1 Conventional)

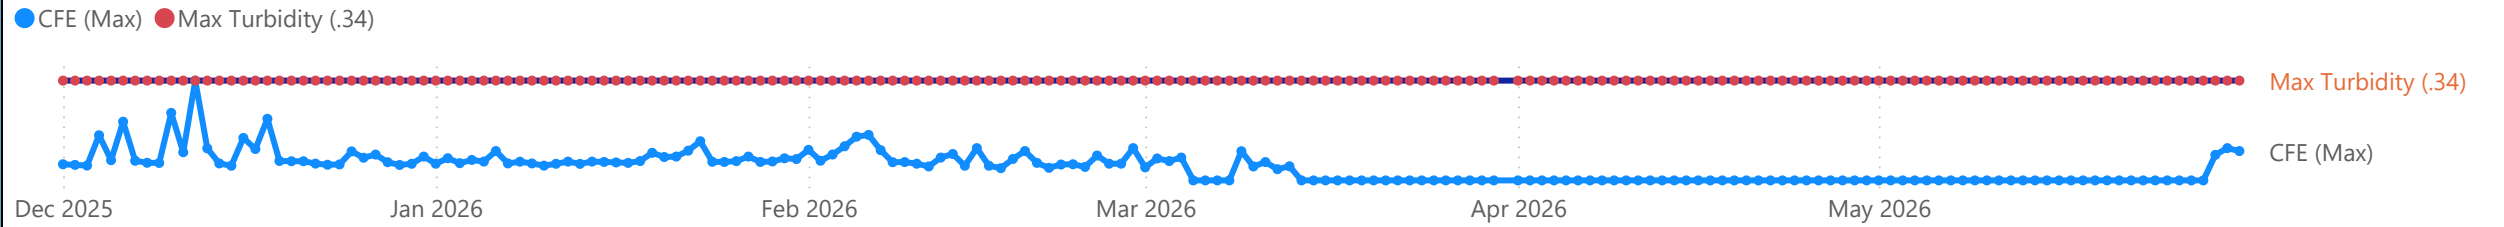

## Turbidity (OBC2 Membrane)

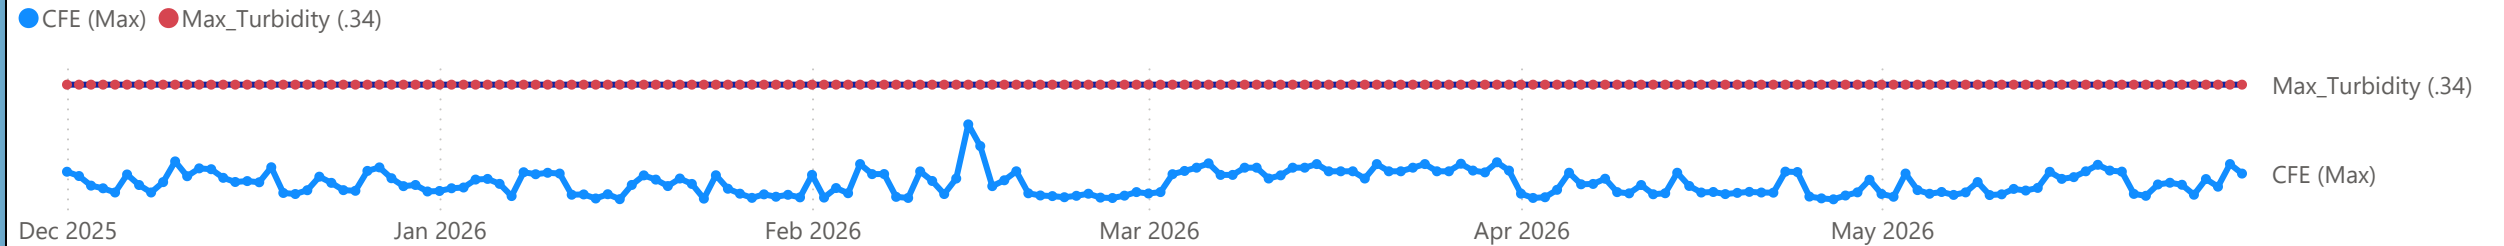

## pH

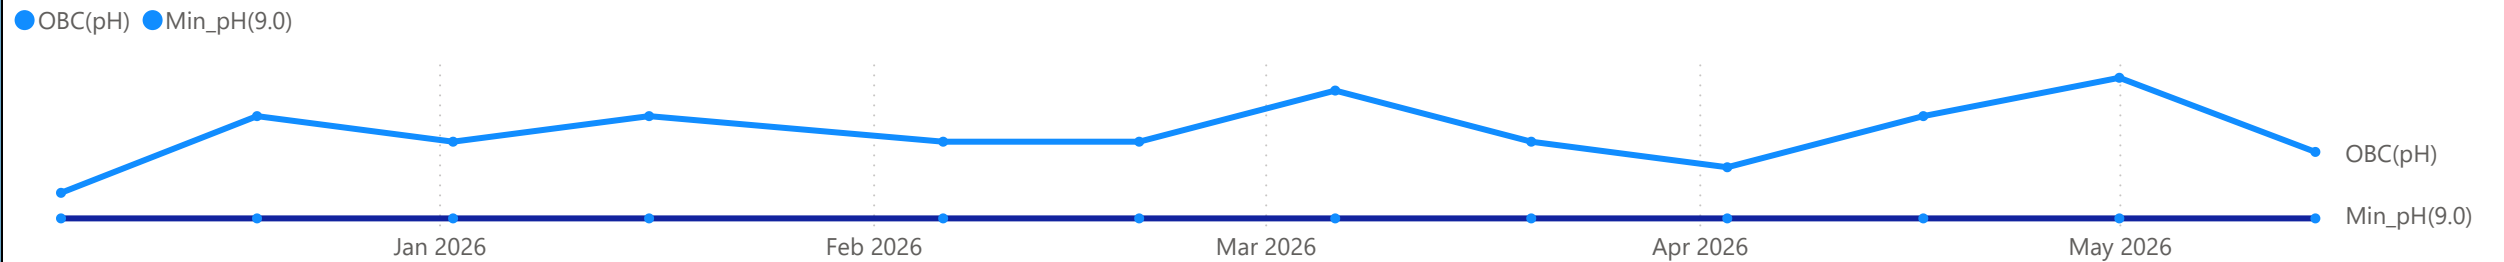





# Executive Dashboard



## OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

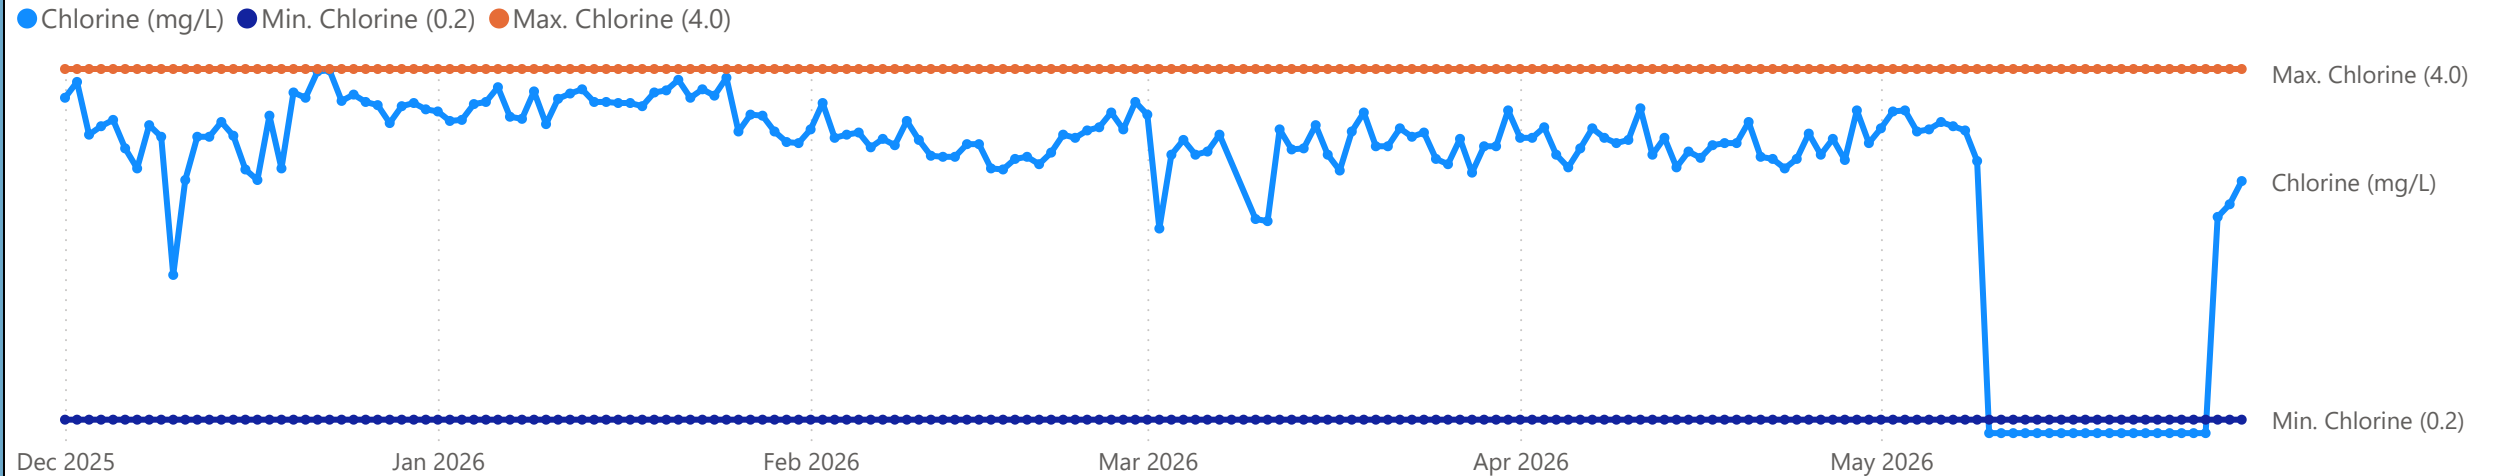

## OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

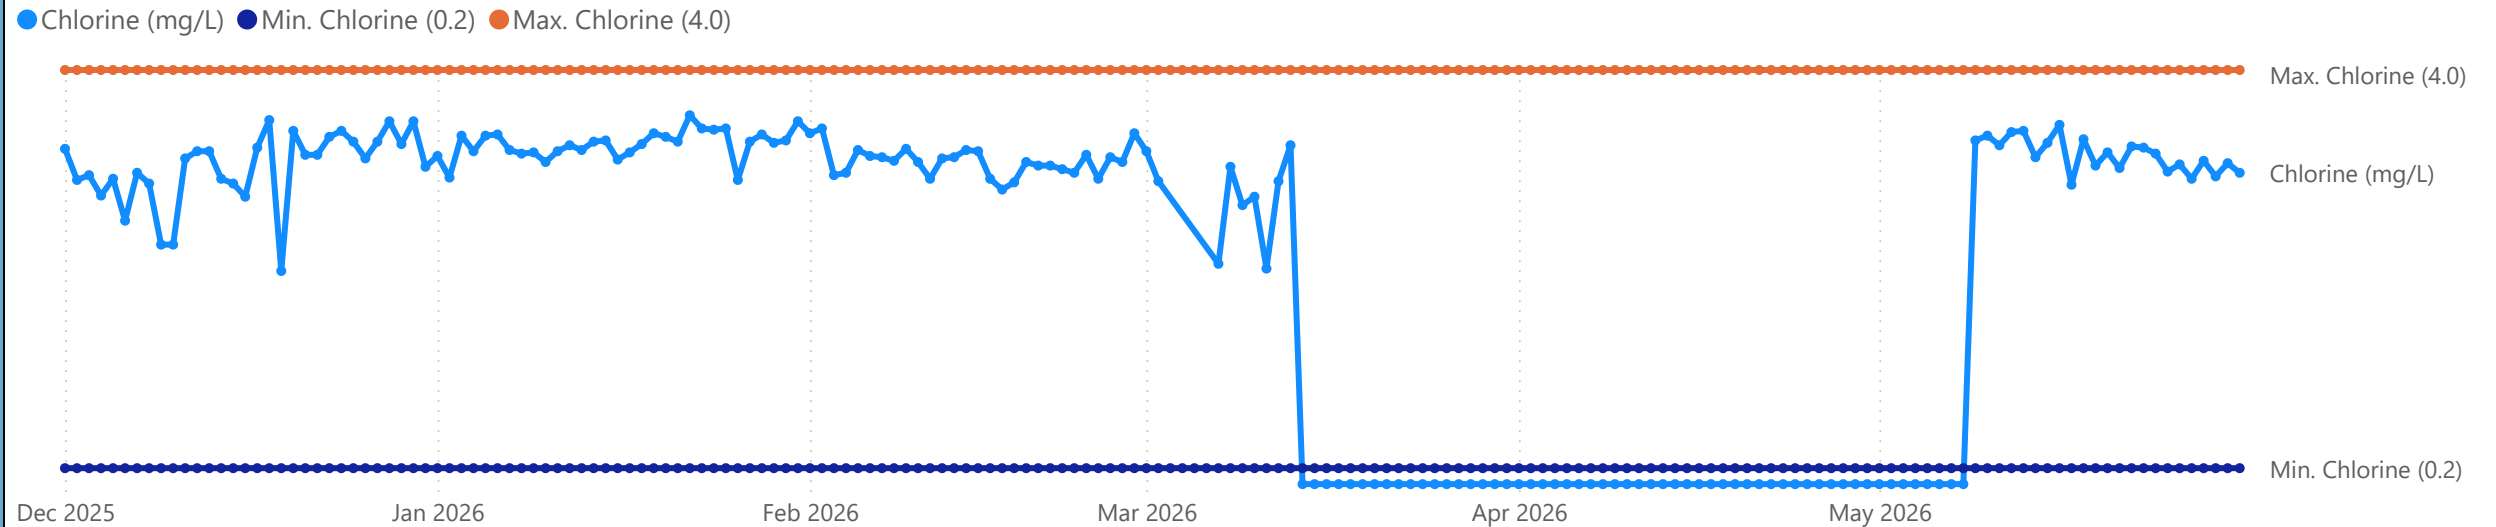



# Executive Dashboard



Select Month

01/01/2025

05/01/2025

08/01/2025

11/01/2025

02/01/2026

05/01/2026


0

Count of Locations with Alkanity < 15

0

Count of Locations with pH < 8.6

## Distribution System Quality Data (Alk)


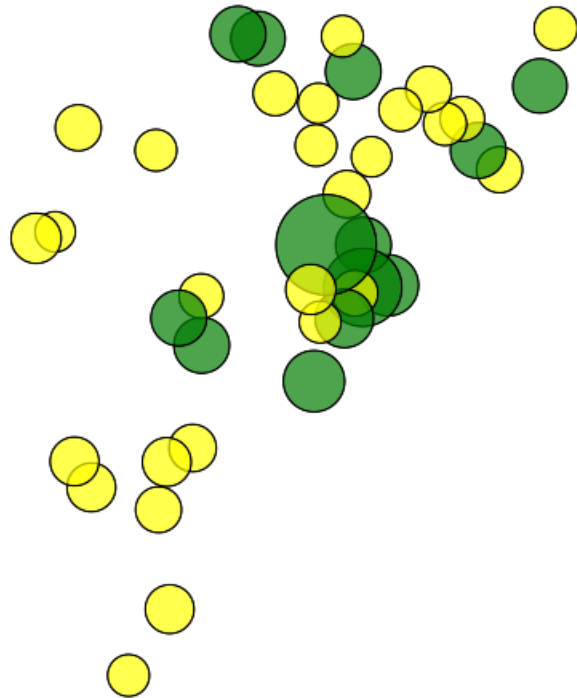


3 mi

Icon Map Pro

Alkaline Range: Yellow - < 25 Green - >= 25

## Distribution System Quality Data (pH)

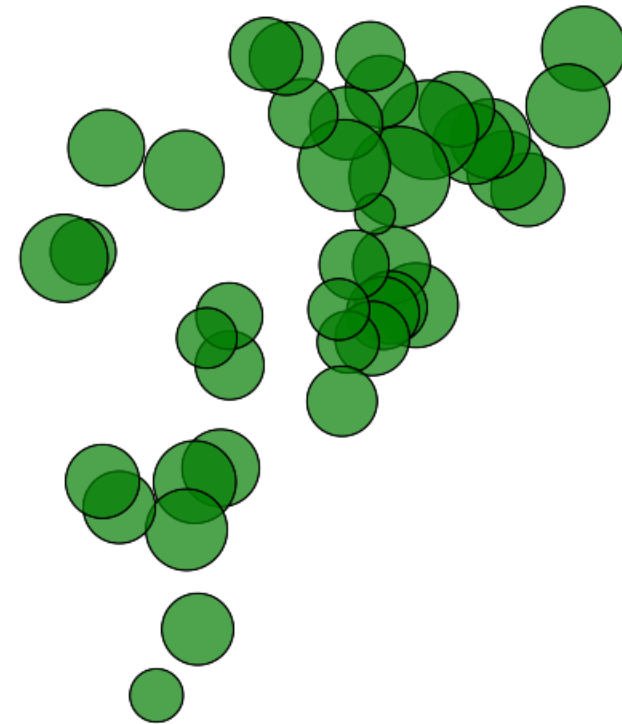

3 mi

Icon Map Pro

pH Range for all sites: Yellow - < 8.6 Green - >= 8.6 Selected sites: Yellow - < 8 and Green >= 8.0)