




Executive Dashboard



Data as of 06/30/2026

Daily Water Production

● J.H. Fewell (MG) ● O.B. Curtis Conv (MG) ● Total (MG) ● O.B. Curtis Mem (MG)

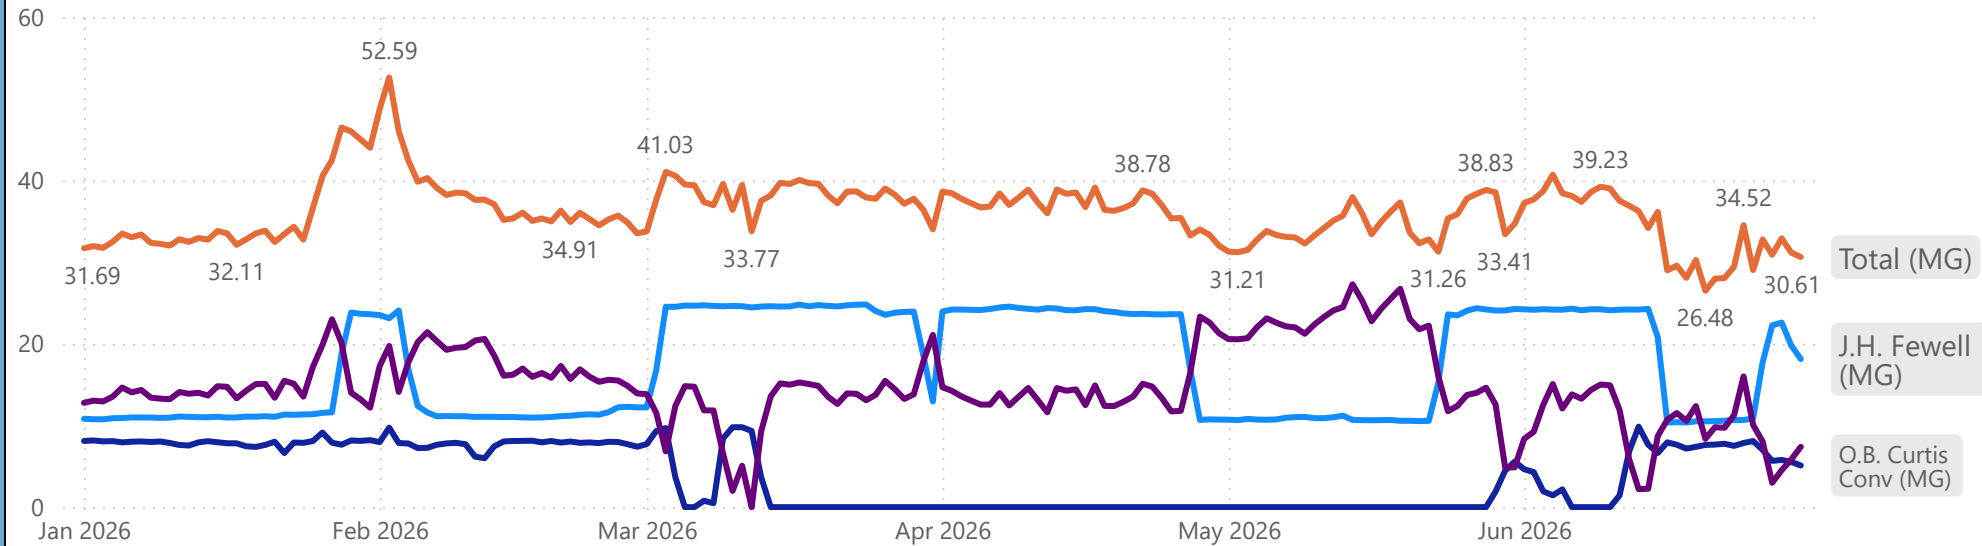

Water Production MG/Day (YTD)

Total Production (Min)
30.08

Total Production (Avg)
36.05

O.B. Curtis Membrane (Avg)
14.76


O.B. Curtis Conventional (Avg)
3.86

J.H. Fewell (Avg)
17.43

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2026	6	June	18.85	5.08	9.95
2026	5	May	14.33	0.39	19.77
2026	4	April	22.48	0.00	14.40
2026	3	March	23.28	2.34	12.46
2026	2	February	12.85	7.77	17.40
2026	1	January	12.54	7.90	14.68

Plant	Average Production Trend (MG/Day)						
	June 2026	June 2025	25'-26' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	18.85	12.40	52.02%	17.46	18.50	17.43	10-20
O.B. Curtis Conventional	5.08	7.50	-32.27%	3.84	1.81	3.86	10-20
O.B. Curtis Membrane	9.95	15.02	-33.75%	14.77	14.76	14.76	23
Total	33.89	34.91	-2.92%	36.08	35.07	36.05	43-53

Avg Production Share by WTP (Rolling 6 months)

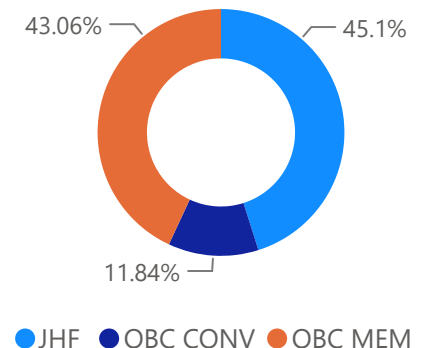





Executive Dashboard




Turbidity (JHF)

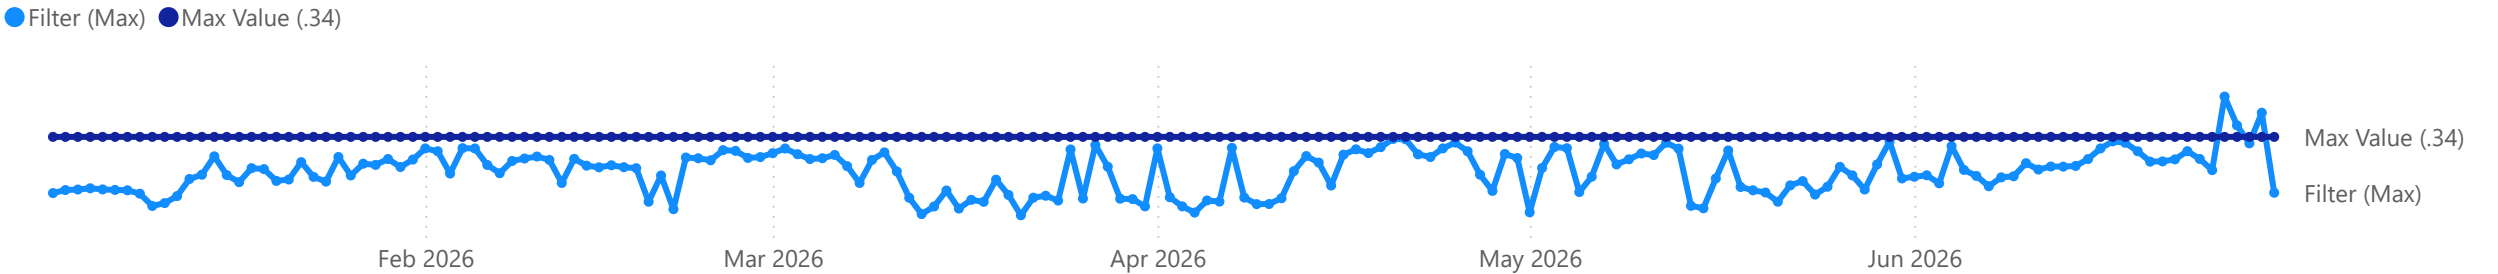

pH (JHF)

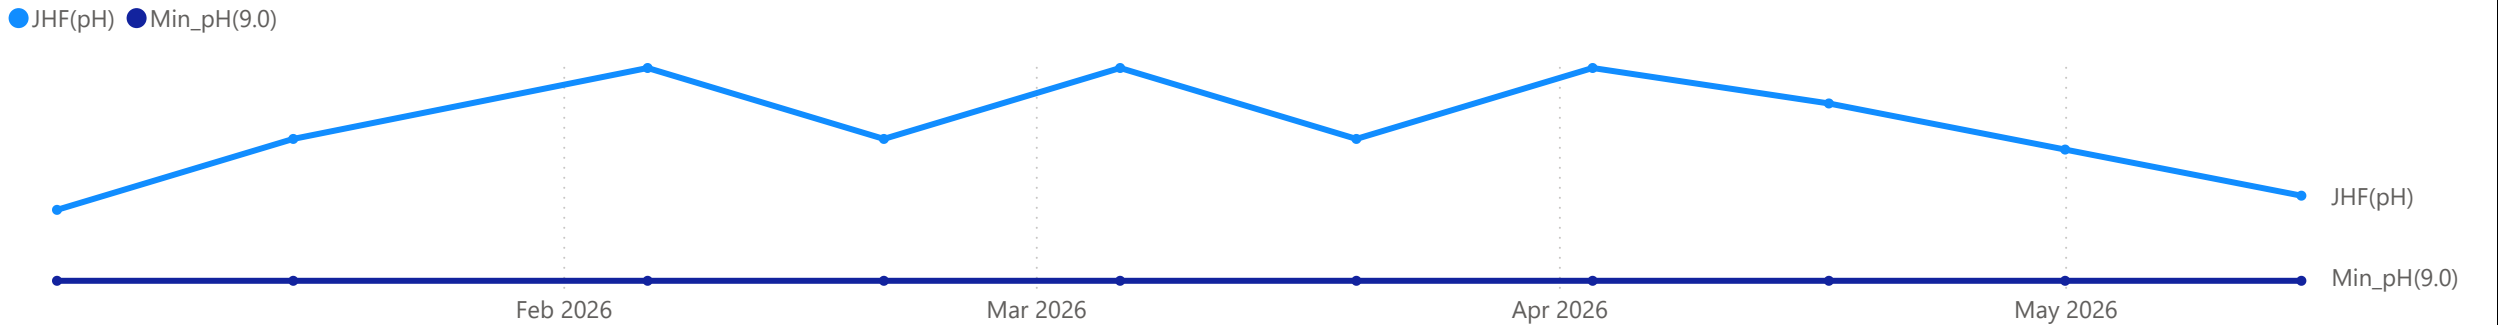

Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

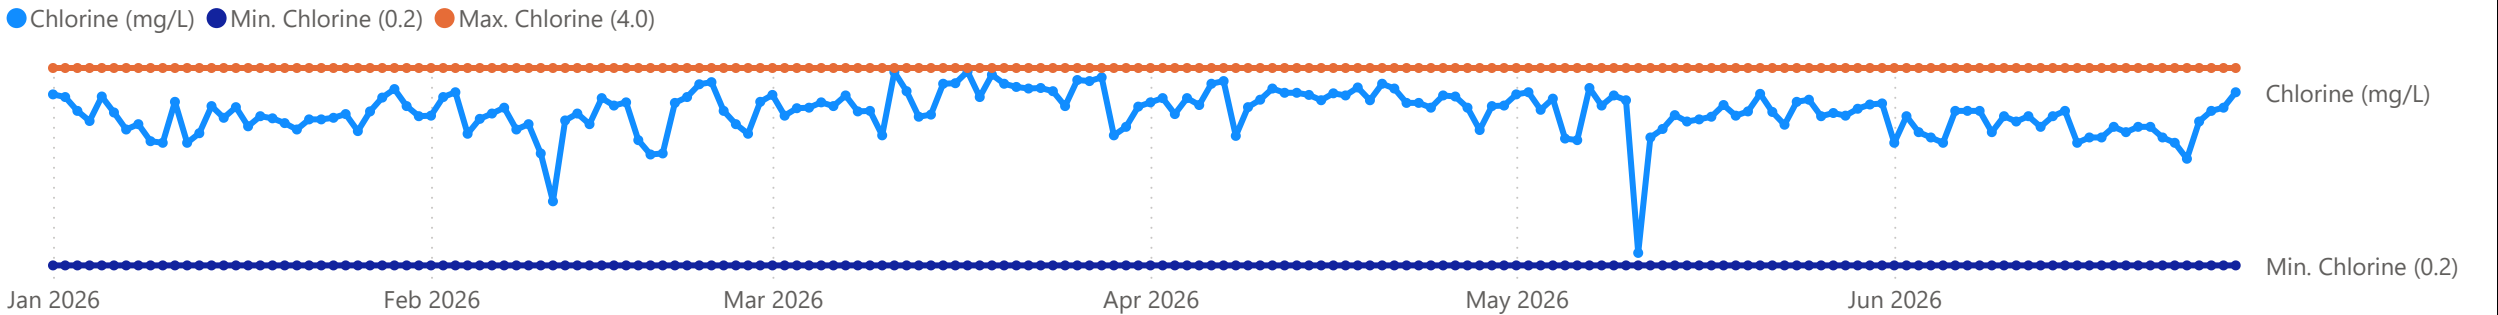




Executive Dashboard




Turbidity (OBC1 Conventional)

● CFE (Max) ● Max Turbidity (.34)

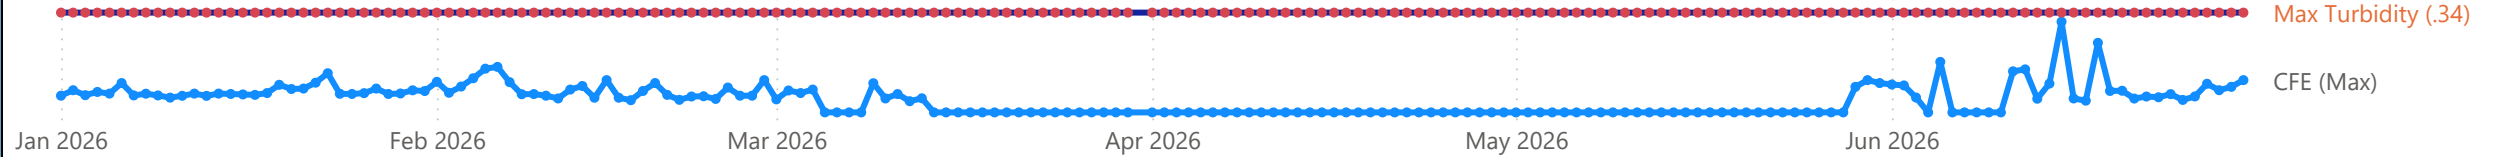


Turbidity (OBC2 Membrane)

● CFE (Max) ● Max_Turbidity (.34)

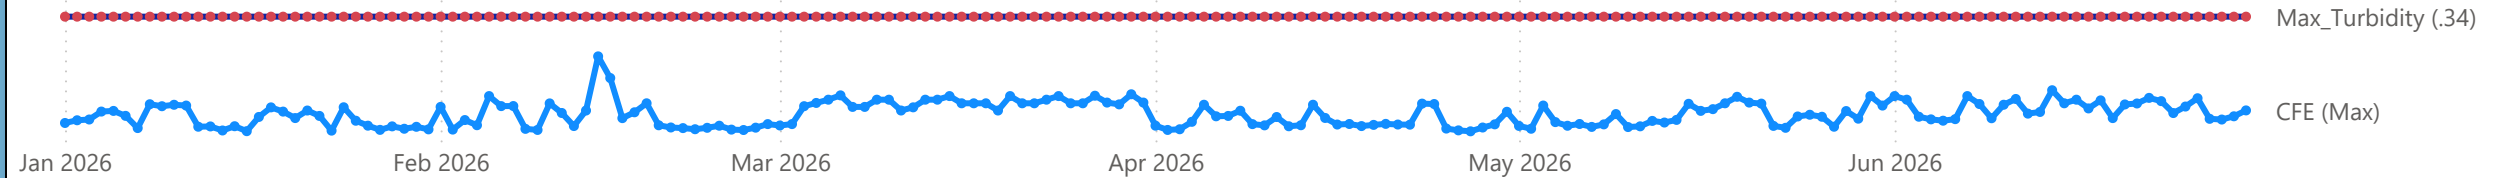

pH

● OBC(pH) ● Min_pH(9.0)

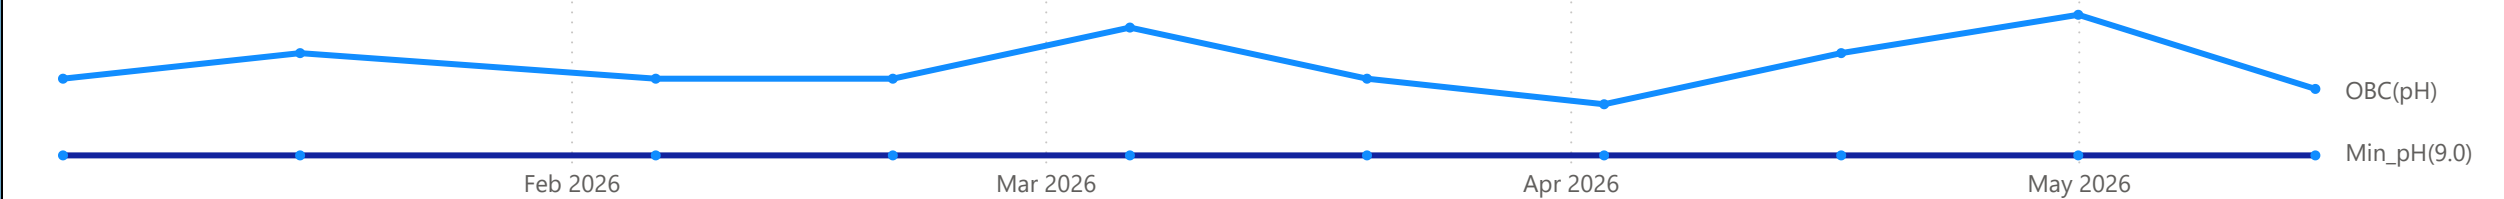




Executive Dashboard



OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

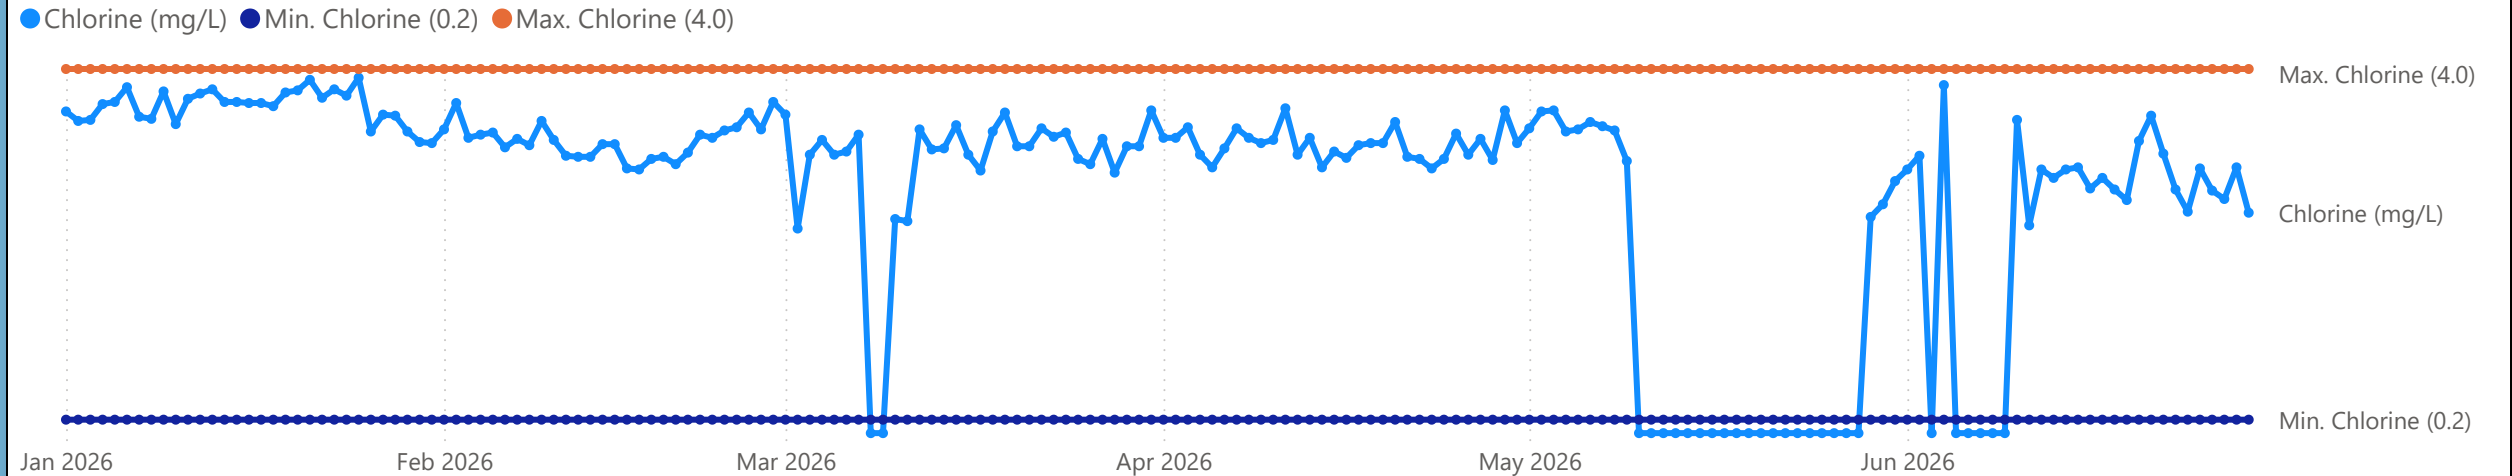

OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

