




Executive Dashboard

Power BI Desktop



Data as of 12/31/2025

Daily Water Production

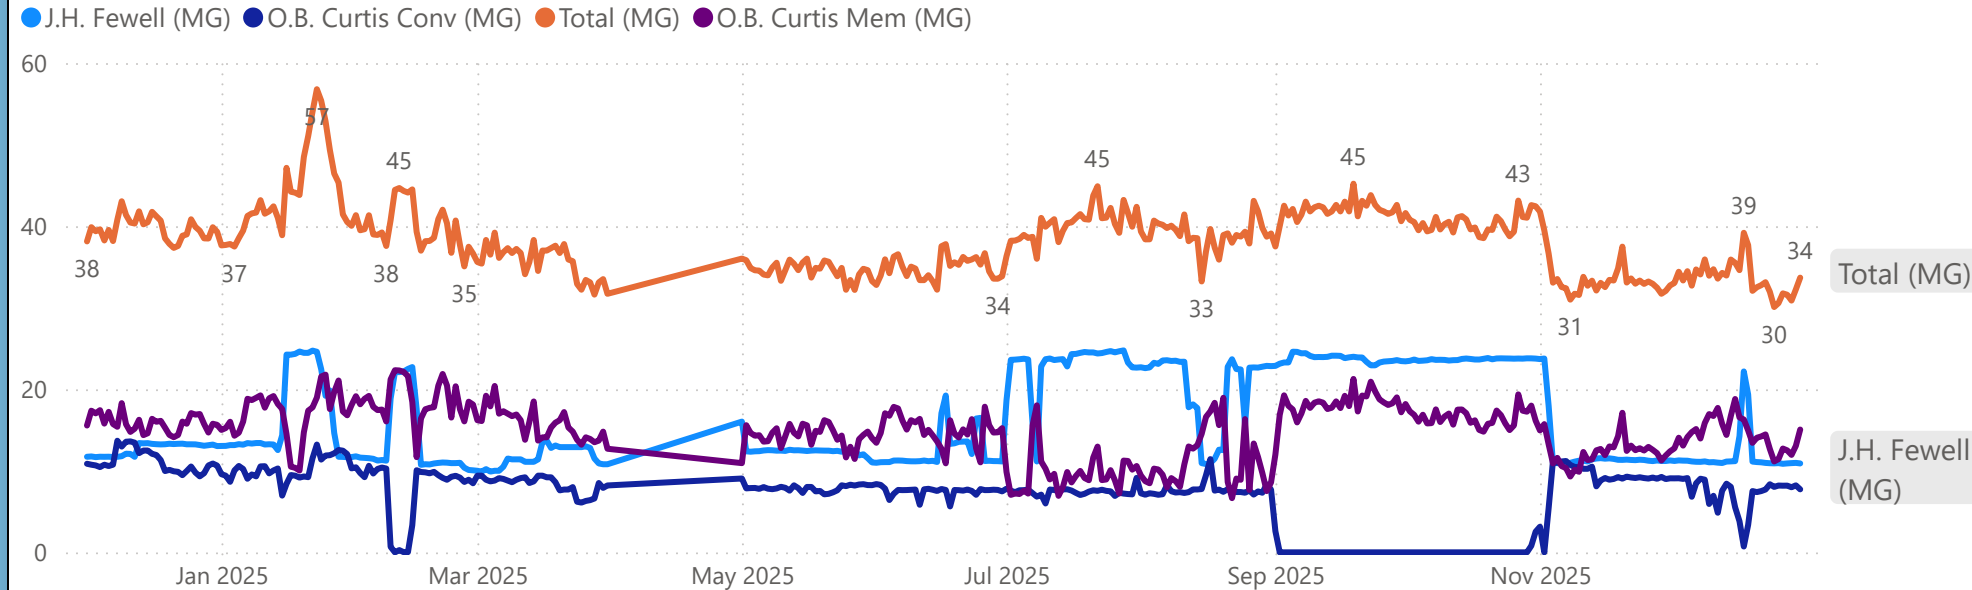

Water Production MG/Day (YTD)

Total Production (Min)
30.08

Total Production (Avg)
37.63

O.B. Curtis Membrane (Avg)
14.77


O.B. Curtis Conventional (Avg)
6.72

J.H. Fewell (Avg)
16.13

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2025	12	December	11.79	7.37	14.44
2025	11	November	12.30	8.98	12.33
2025	10	October	23.66	0.11	16.58
2025	9	September	23.73	0.09	18.13
2025	8	August	20.04	7.67	11.27
2025	7	July	23.07	7.43	9.74

Plant	Average Production Trend (MG/Day)						
	December 2025	December 2024	25'-24' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	11.79	12.68	-7.01%	19.12	15.96	16.13	10-20
O.B. Curtis Conventional	7.37	11.14	-33.80%	5.27	5.45	6.72	10-20
O.B. Curtis Membrane	14.44	15.87	-9.01%	13.75	14.47	14.77	23
Total	33.60	39.69	-15.33%	38.13	35.88	37.63	43-53

Avg Production Share by WTP (Rolling 6 months)

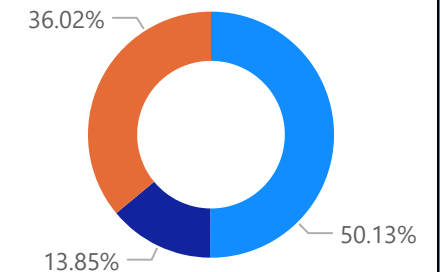

● JHF ● OBC CONV ● OBC MEM




Executive Dashboard

Power BI Desktop




Turbidity (JHF)

● Filter (Max) ● Max Value (.34)

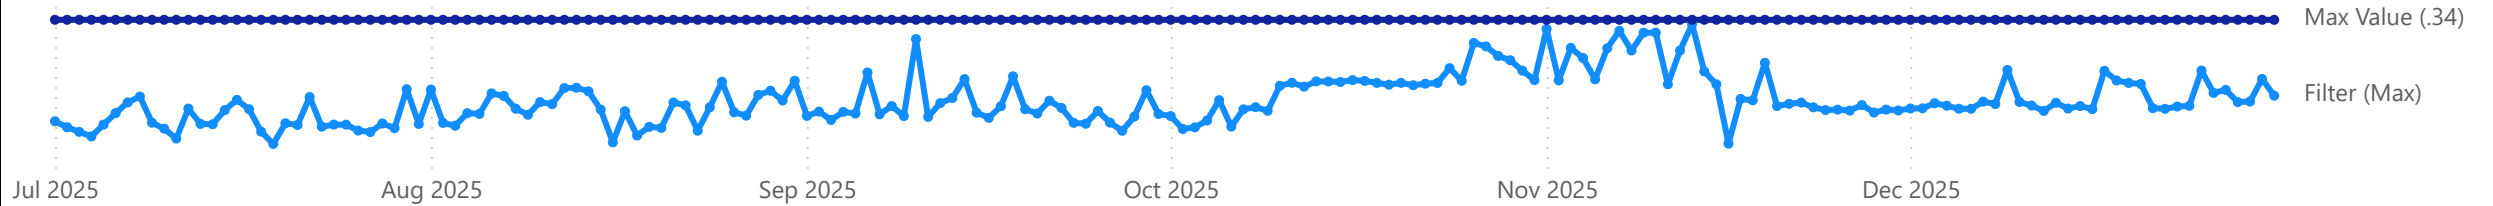


pH (JHF)

● JHF(pH) ● Min_pH(9.0)

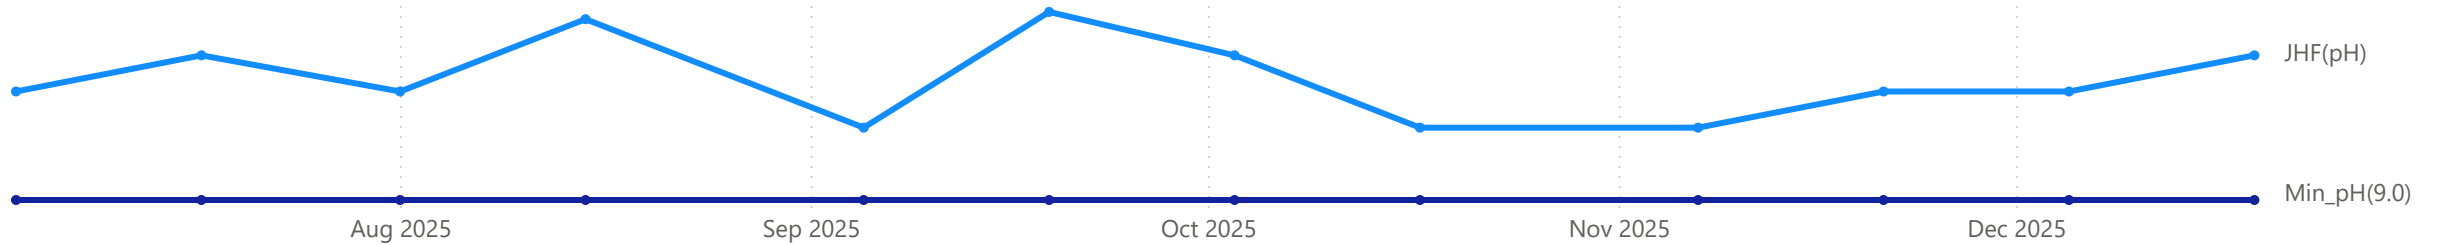

Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

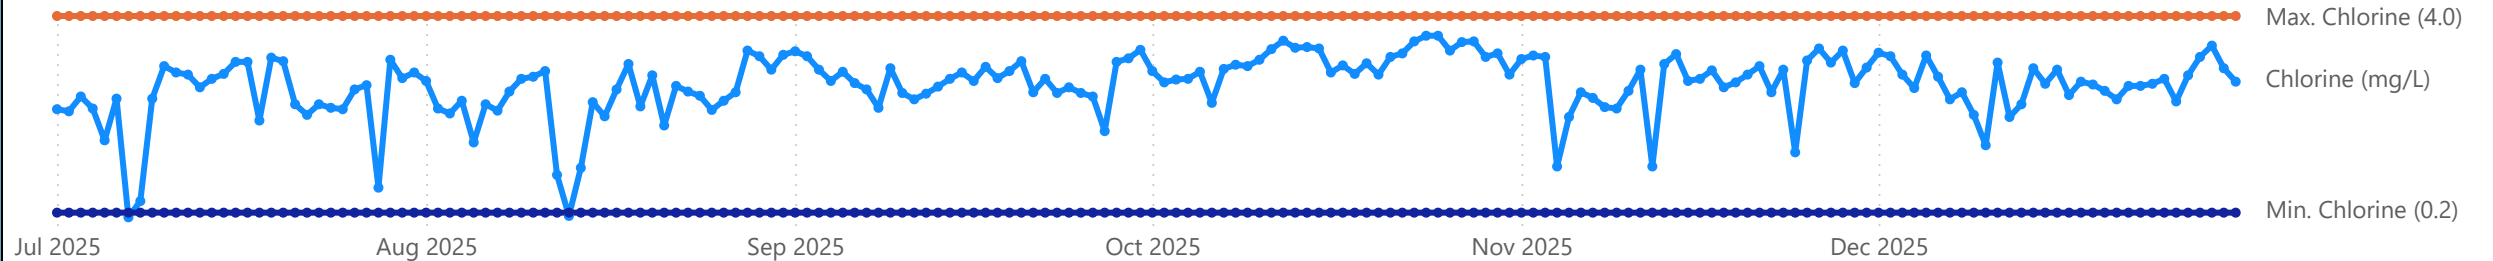



Executive Dashboard

Power BI Desktop




Turbidity (OBC1 Conventional)

● CFE (Max) ● Max Turbidity (.34)




Turbidity (OBC2 Membrane)

● CFE (Max) ● Max_Turbidity (.34)

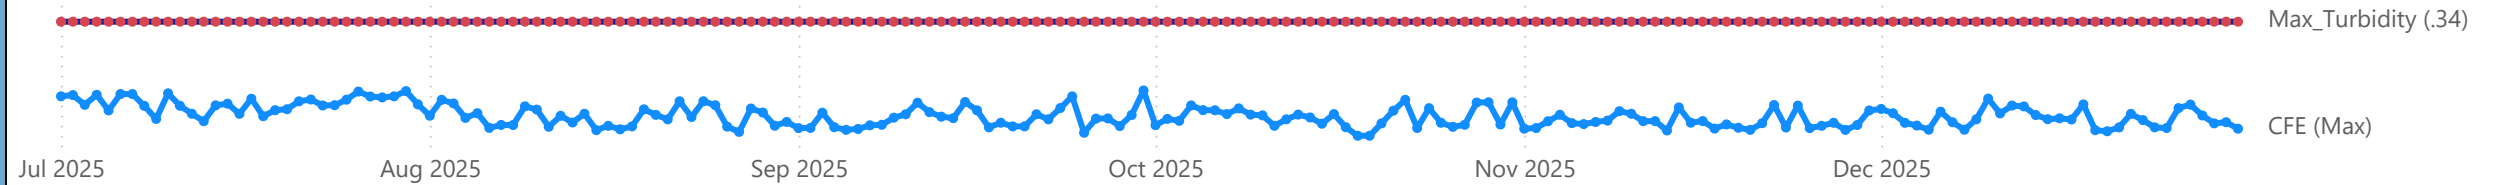

pH

● OBC(pH) ● Min_pH(9.0)

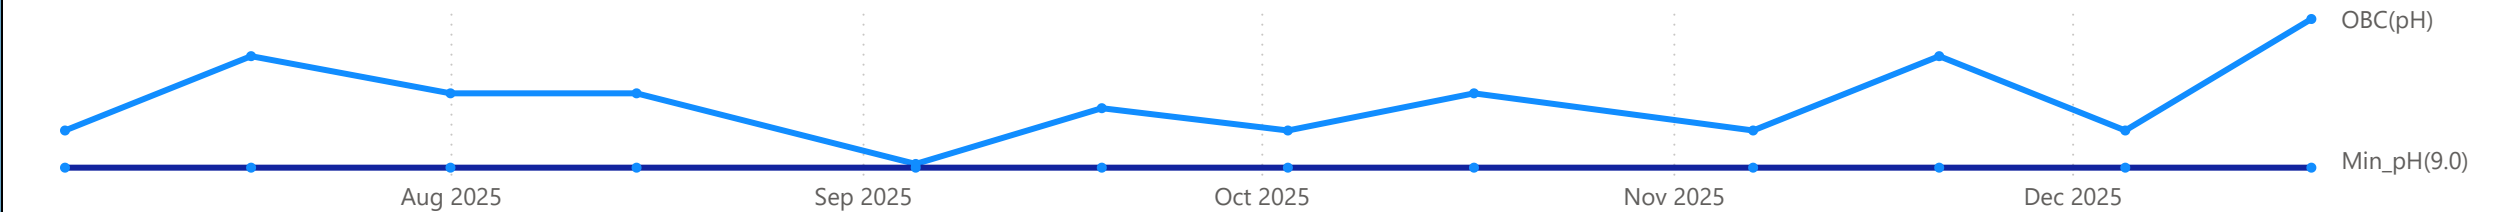




Executive Dashboard

Power BI Desktop



OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

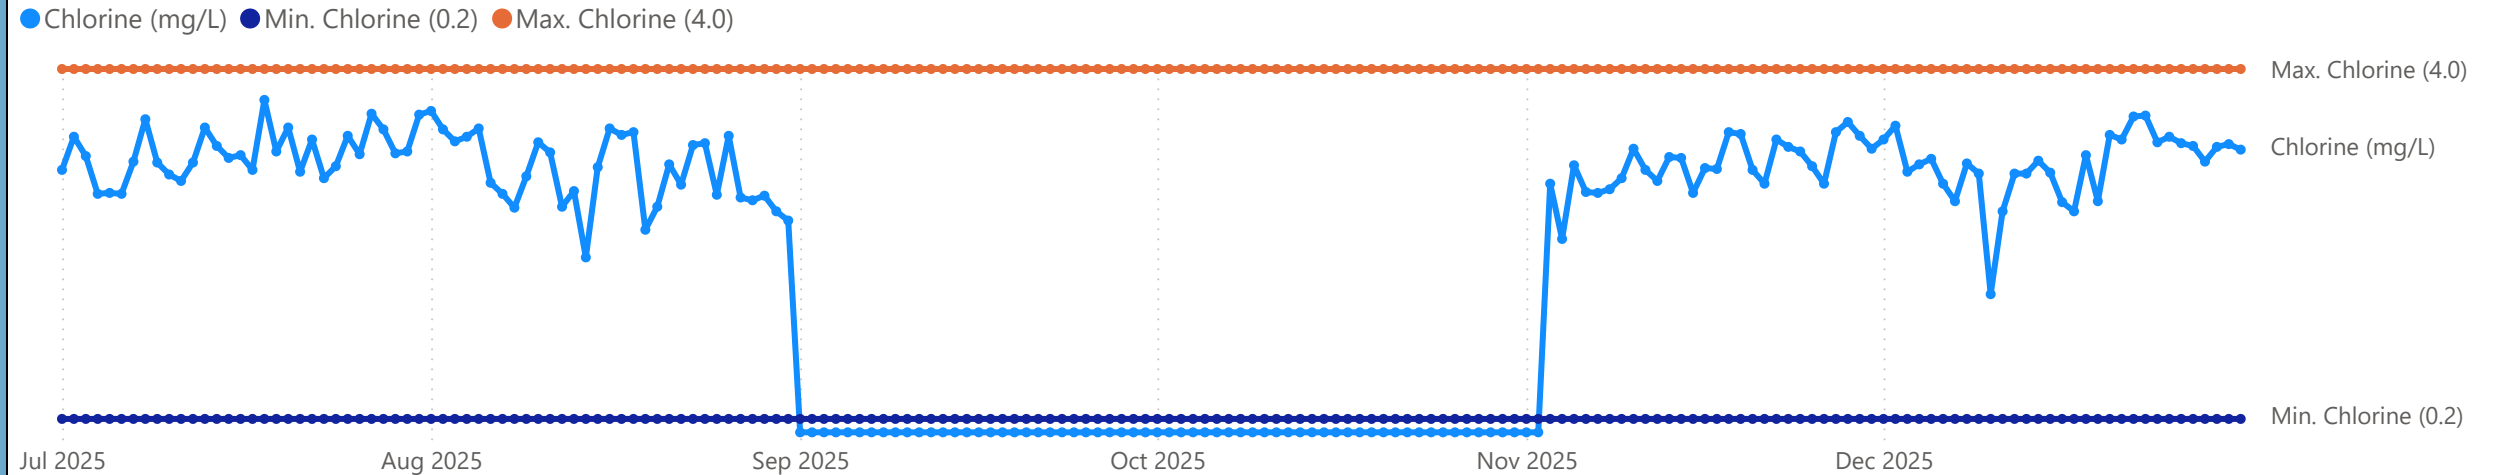

OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

