




Executive Dashboard

Power BI Desktop



Data as of 07/31/2026

Daily Water Production

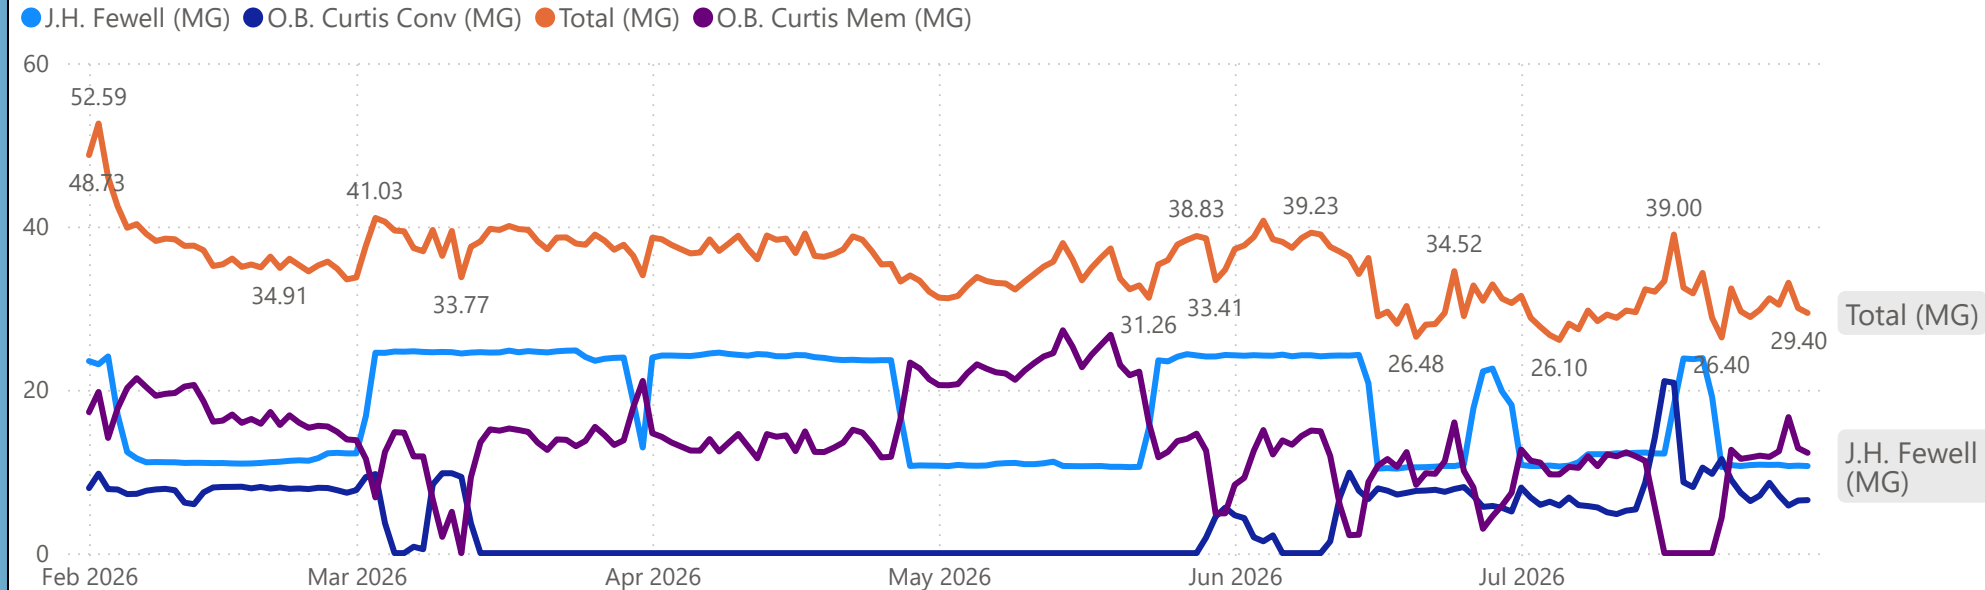

Water Production MG/Day (YTD)

Total Production (Min)

30.08

Total Production (Avg)

35.20

O.B. Curtis Membrane (Avg)

13.93

O.B. Curtis Conventional (Avg)

4.50


J.H. Fewell (Avg)

16.77

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2026	7	July	12.93	8.21	9.07
2026	6	June	18.85	5.08	9.95
2026	5	May	14.33	0.39	19.77
2026	4	April	22.48	0.00	14.40
2026	3	March	23.28	2.34	12.46
2026	2	February	12.85	7.77	17.40

Plant	Average Production Trend (MG/Day)						
	July 2026	July 2025	25'-26' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	12.93	23.07	-43.95%	17.49	15.33	16.77	10-20
O.B. Curtis Conventional	8.21	7.43	10.50%	3.92	4.56	4.50	10-20
O.B. Curtis Membrane	9.07	9.74	-6.88%	13.80	12.96	13.93	23
Total	30.22	40.24	-24.90%	35.21	32.85	35.20	43-53

Avg Production Share by WTP (Rolling 6 months)

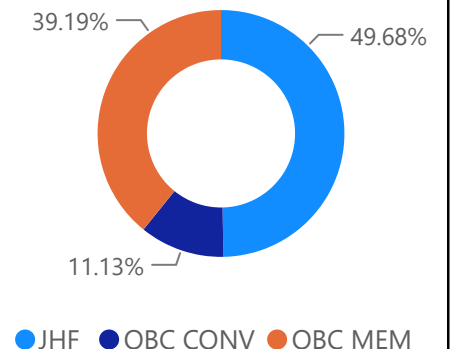




Executive Dashboard

Power BI Desktop




Turbidity (JHF)

● Filter (Max) ● Max Value (.34)

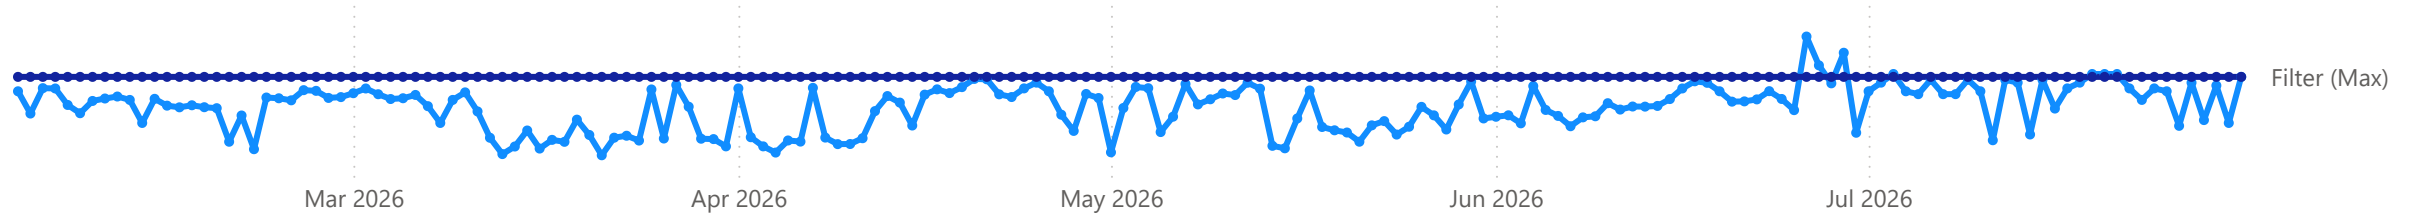


pH (JHF)

● JHF(pH) ● Min_pH(9.0)

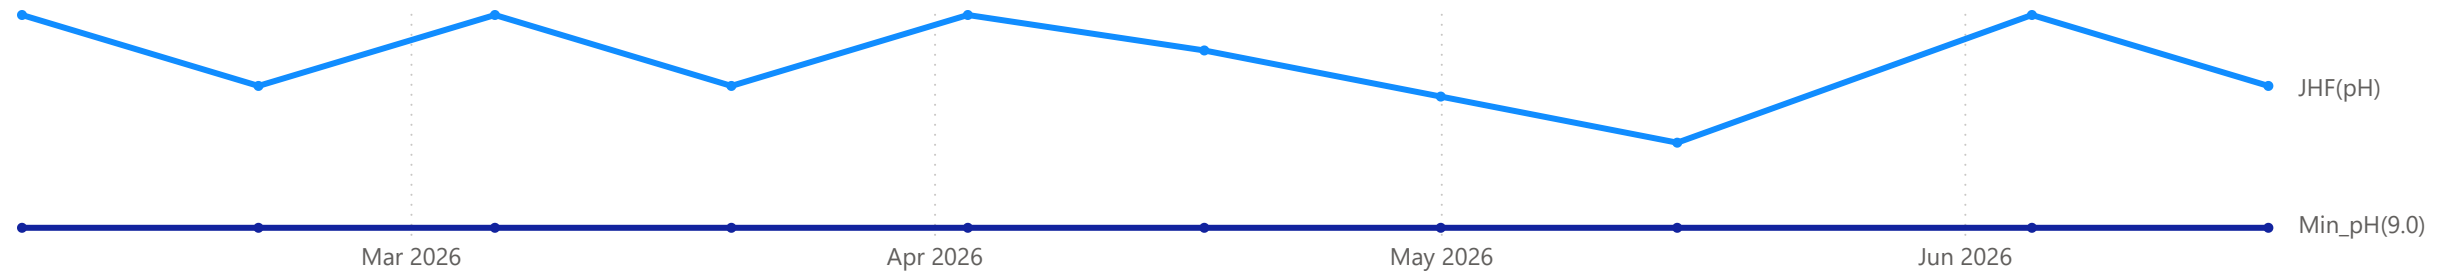

Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

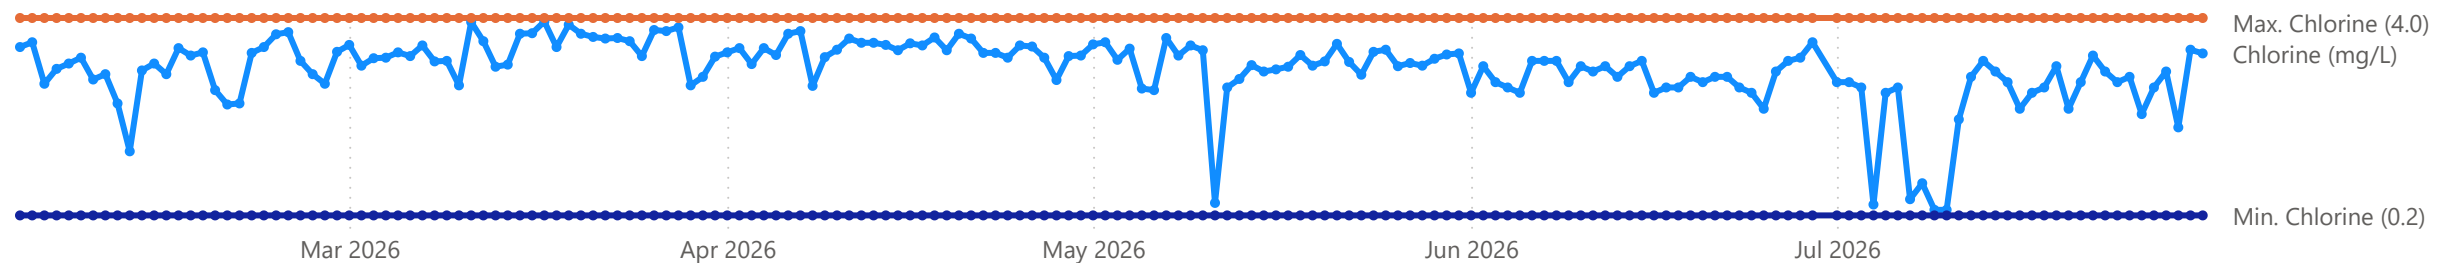




Executive Dashboard

Power BI Desktop




Turbidity (OBC1 Conventional)

● CFE (Max) ● Max Turbidity (.34)

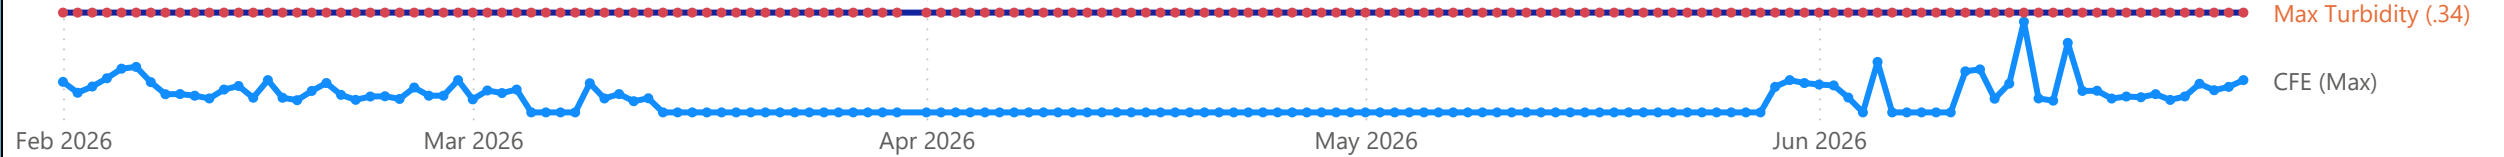


Turbidity (OBC2 Membrane)

● CFE (Max) ● Max_Turbidity (.34)

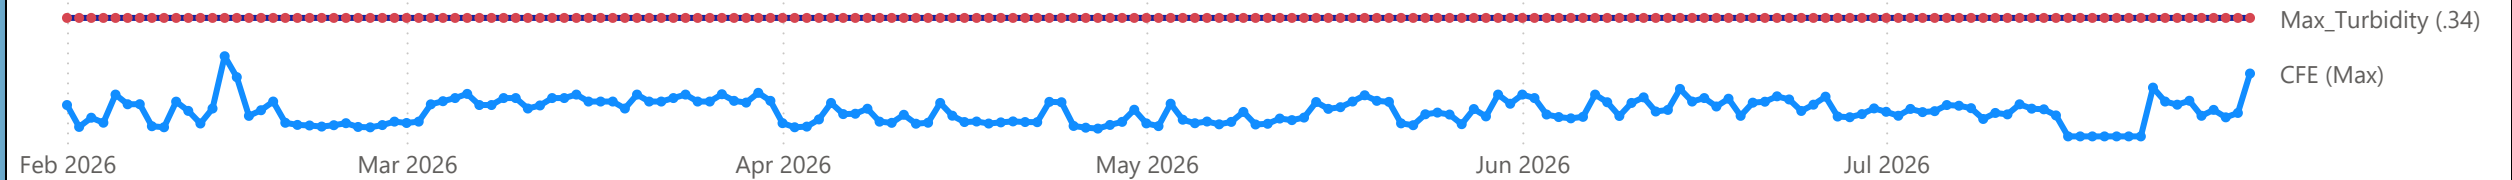

pH

● OBC(pH) ● Min_pH(9.0)

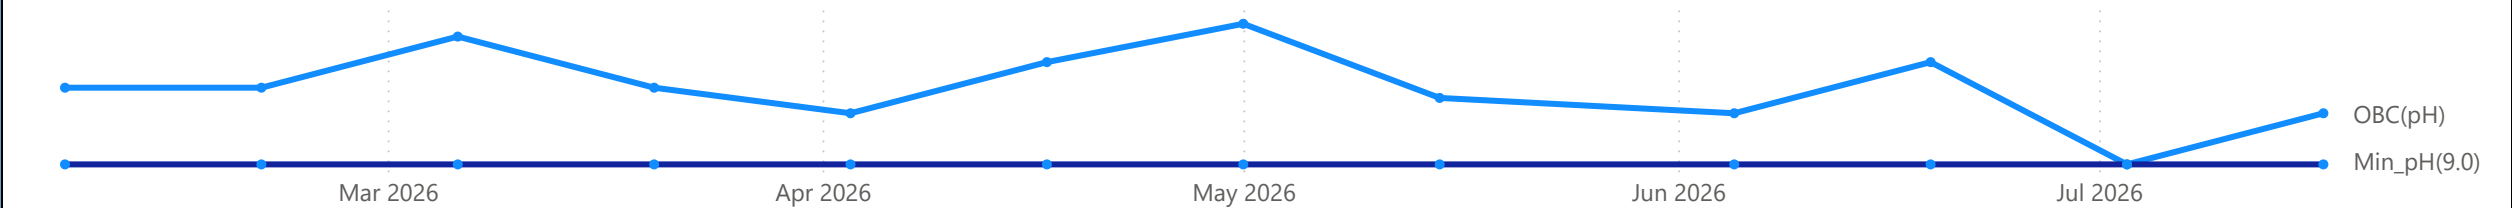




Executive Dashboard

Power BI Desktop



OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

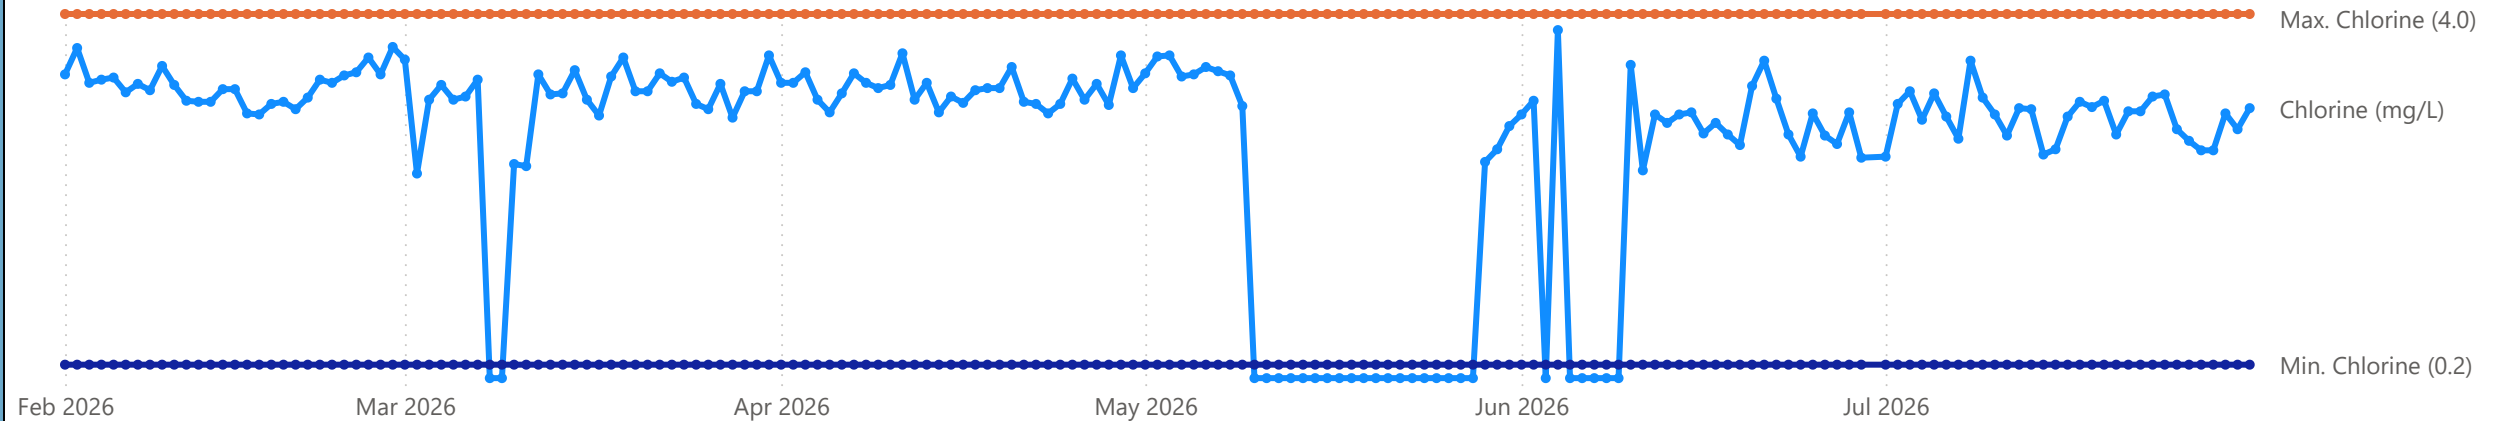

OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

