



Executive Dashboard


Power BI Desktop



Data as of 0/9/30/2026

Daily Water Production

● J.H. Fewell (MG) ● O.B. Curtis Conv (MG) ● Total (MG) ● O.B. Curtis Mem (MG)

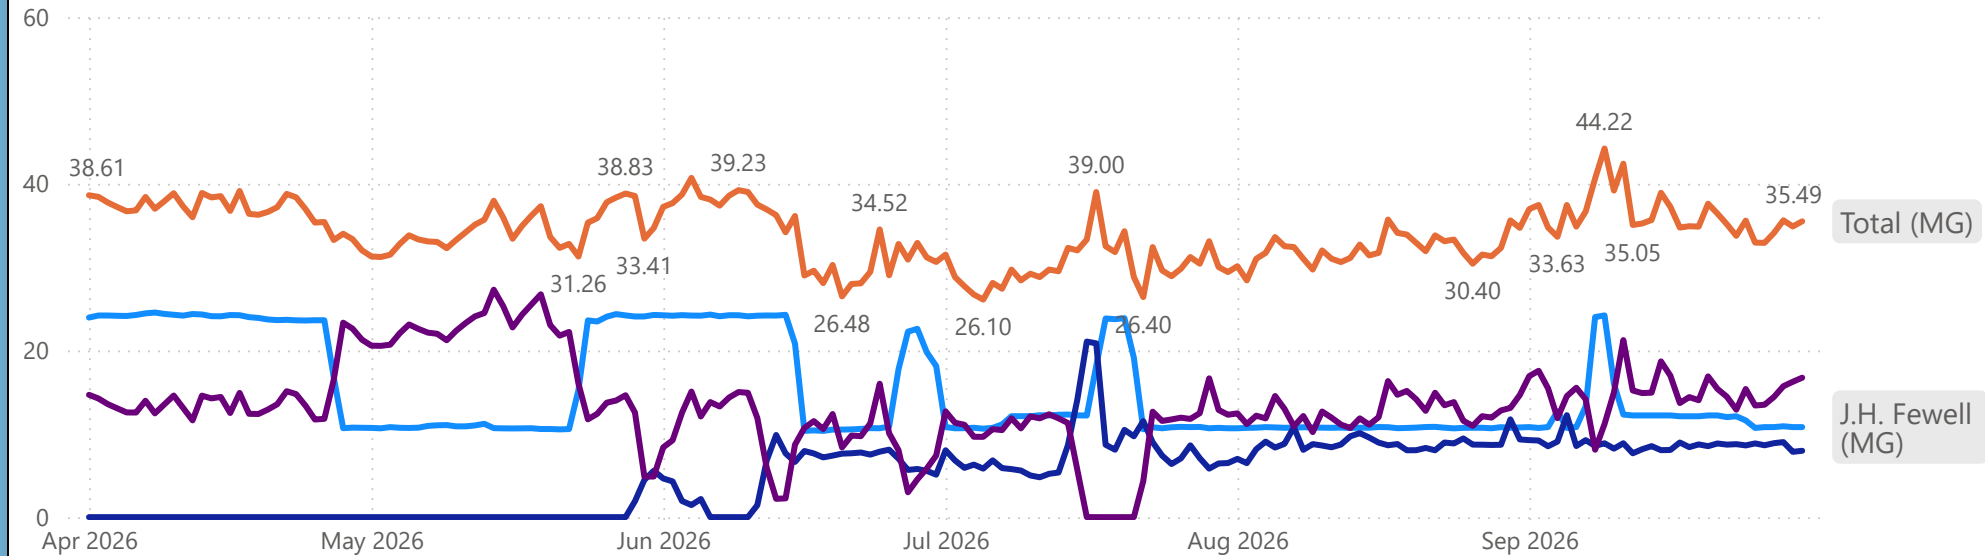

Water Production MG/Day (YTD)

Total Production (Min)
30.08

Total Production (Avg)
34.98

O.B. Curtis Membrane (Avg)
13.90


O.B. Curtis Conventional (Avg)
5.45

J.H. Fewell (Avg)
15.63

Year	Month	Title	J.H. Fewell	O.B. Curtis - Conventional	O.B. Curtis - Membrane
2026	9	September	12.62	8.72	14.97
2026	8	August	10.74	8.78	12.64
2026	7	July	12.93	8.21	9.07
2026	6	June	18.85	5.08	9.95
2026	5	May	14.33	0.39	19.77
2026	4	April	22.48	0.00	14.40

Plant	Average Production Trend (MG/Day)						
	Sep 2026	Sep 2025	25'-26' YOY Change	Rolling 6-mos	Rolling 3-mos	YTD	Target
J.H. Fewell	12.62	23.73	-46.82%	15.28	12.15	15.63	10-20
O.B. Curtis Conventional	8.72	0.09	9588.89%	5.21	8.53	5.45	10-20
O.B. Curtis Membrane	14.97	18.13	-17.43%	13.47	12.15	13.90	23
Total	36.30	41.94	-13.45%	33.96	32.83	34.98	43-53

Avg Production Share by WTP (Rolling 6 months)

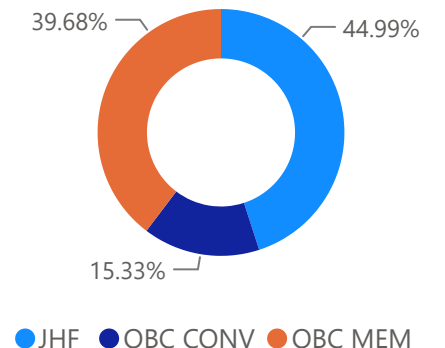




Executive Dashboard

Power BI Desktop




Turbidity (JHF)

● Filter (Max) ● Max Value (.34)

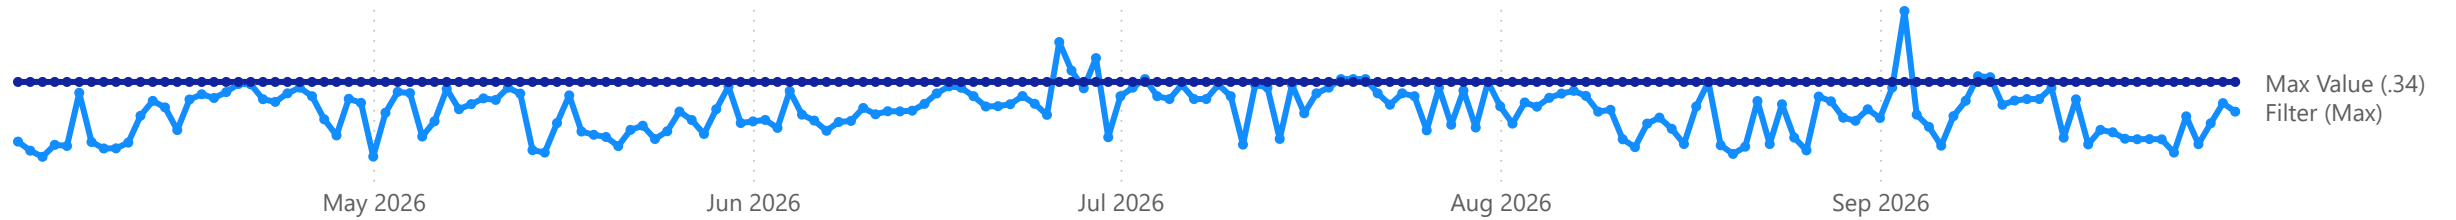


pH (JHF)

● JHF(pH) ● Min_pH(9.0)

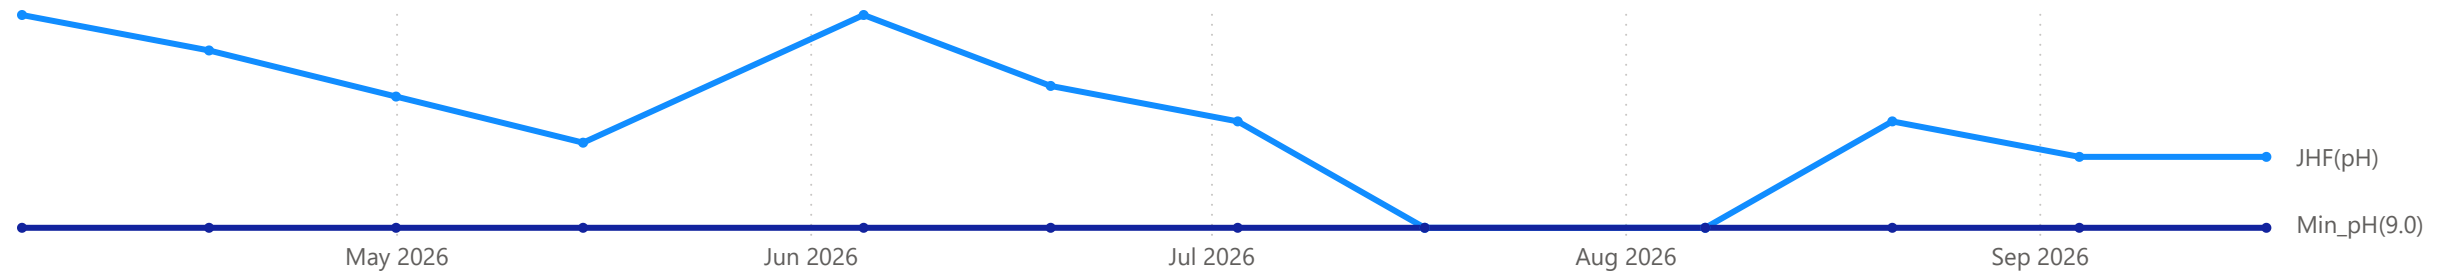

Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine (mg/L) ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

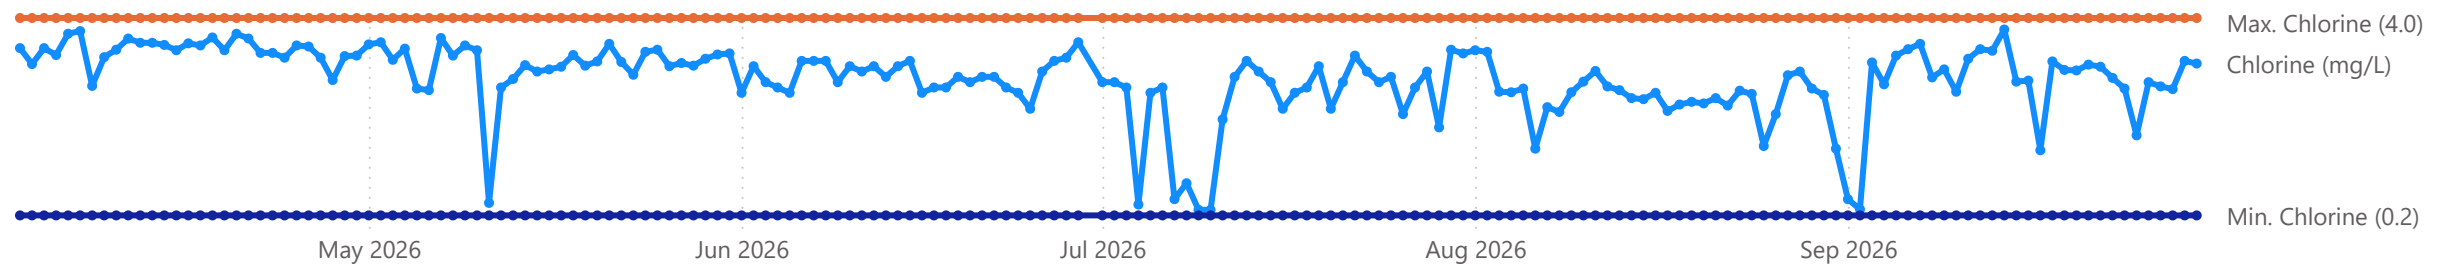



Executive Dashboard

Power BI Desktop



Turbidity (OBC1 Conventional)


● CFE (Max) ● Max Turbidity (.34)



*Conventional treatment train was off line from 3/19/2026-6/11/2026 for sediment basin upgrades.


Turbidity (OBC2 Membrane)

● CFE (Max) ● Max_Turbidity (.34)

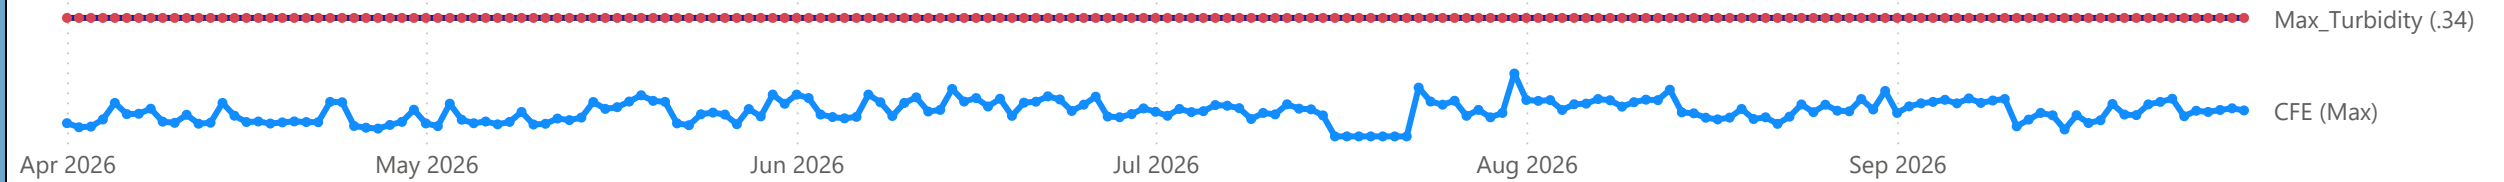

pH

● OBC(pH) ● Min_pH(9.0)

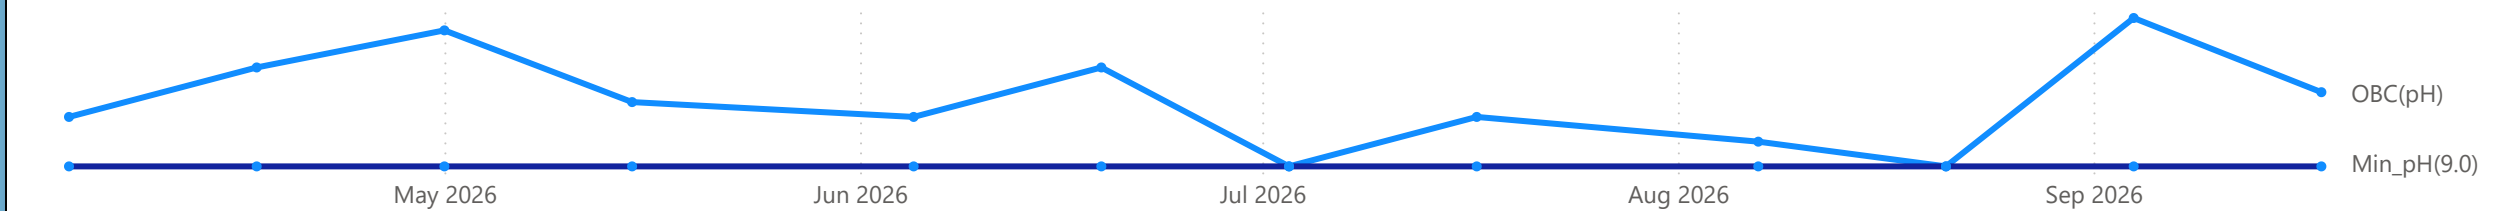




Executive Dashboard

Power BI Desktop



OBC 1 (Conventional) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

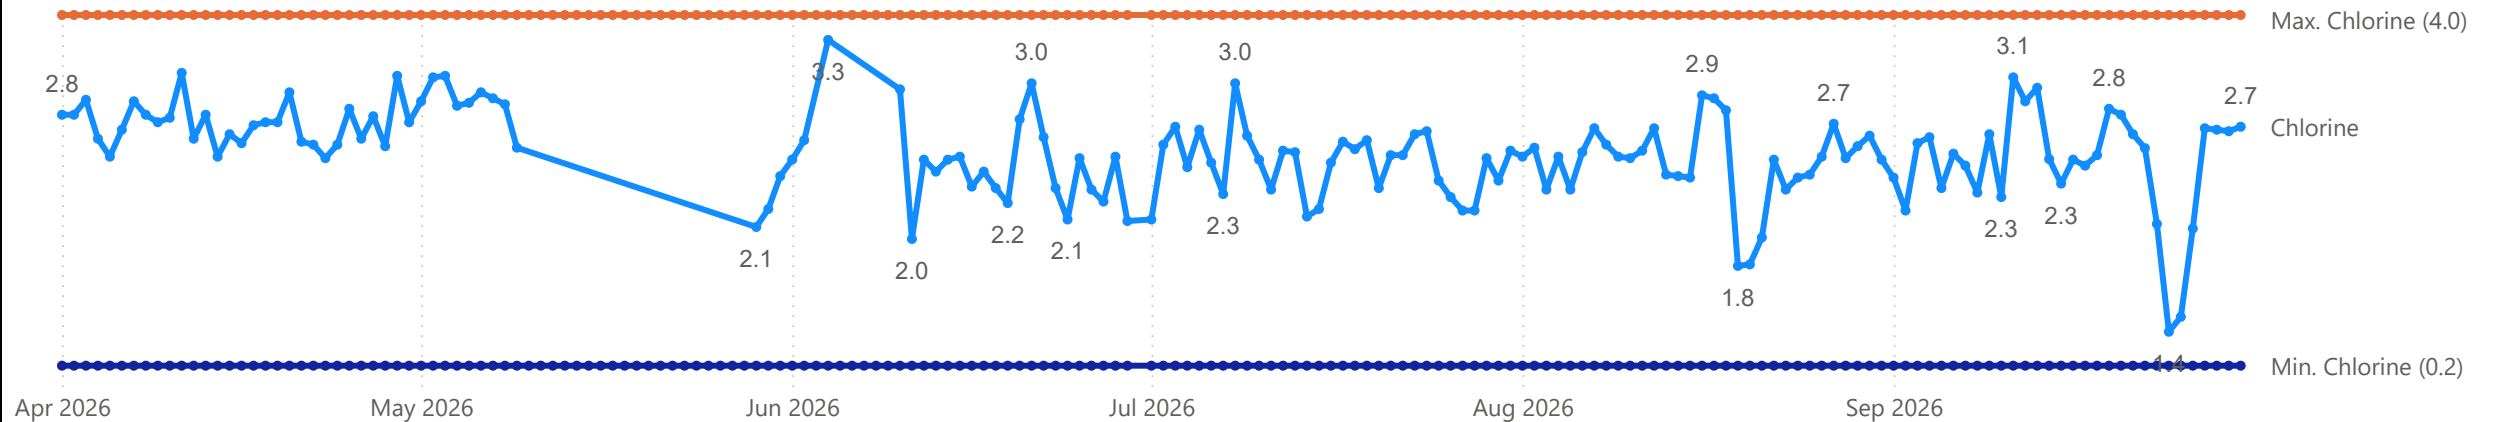

*Clearwell #2 and HSPS #2 were out-of-service from 3/16/2026-5/8/2026 for the corrosion control upgrade project. Membrane treated water was pumped to Clearwell #1 and pumped out to distribution via HSPS #1. CT being met using normal POAs.

OBC 2 (Membrane) - Lowest Disinfectant Entering Distribution System - Chlorine (mg/L)

● Chlorine OBC2 ● Min. Chlorine (0.2) ● Max. Chlorine (4.0)

